



WATER HEATER SCHEDULE																
TAG NUMBER	MANUFAC./ MODEL	GAS TYPE	GAS CONSUMPTION MBTU/H		THERMAL EFF/ ENERGY FACTOR	DIMENSION W"xH"xD"	WEIGHT (LBS)	GAS INLET (N)	WATER CONNECTION			AREA SERVED (LOCATION)	CAPACITY RANGE (GPM)		VENTING OPTION	ELECTRICAL SERVICE (W/ #/ Hz)
			MINIMUM	MAXIMUM					INLET(IN)	OUTLET(IN)	CONDENSATE DRAIN(IN)		MINIMUM	MAXIMUM		
G.I.W.H#1	NORITZ/ NRC1111--OD--LP	PROPANE	16 000	199 000	95 %/ 92%	18.3"x24.2"x9.4"	66	3/4"	3/4"	3/4"	1/2"	OUTDOOR	0.5	11.1	–	120/ 1/ 60 (LESS THAN 4 AMPS)
G.I.W.H#2	NORITZ/ NCC300--OD--LP	PROPANE	15 000	300 000	97 %/ 92%	18.9"x32.7"x14.2"	108	3/4"	1"	1"	1/2"	OUTDOOR	–	13.2	–	120/ 1/ 60 (LESS THAN 4 AMPS)

NOTE:
GAS PIPE LONGEST RUN:152.0 FT
TOTAL BTU LOAD: 1'039.0 MBTU
GAS TYPE: LP (LIQUID PROPANE)
AS PER TABLE 402.4(35) POLY PIPE MATERIAL
AS PER TABLE 402.4(28) GALVANIZED SCHEDULE 40
(LOW PRESSURE LESS THAN 2 PSI)

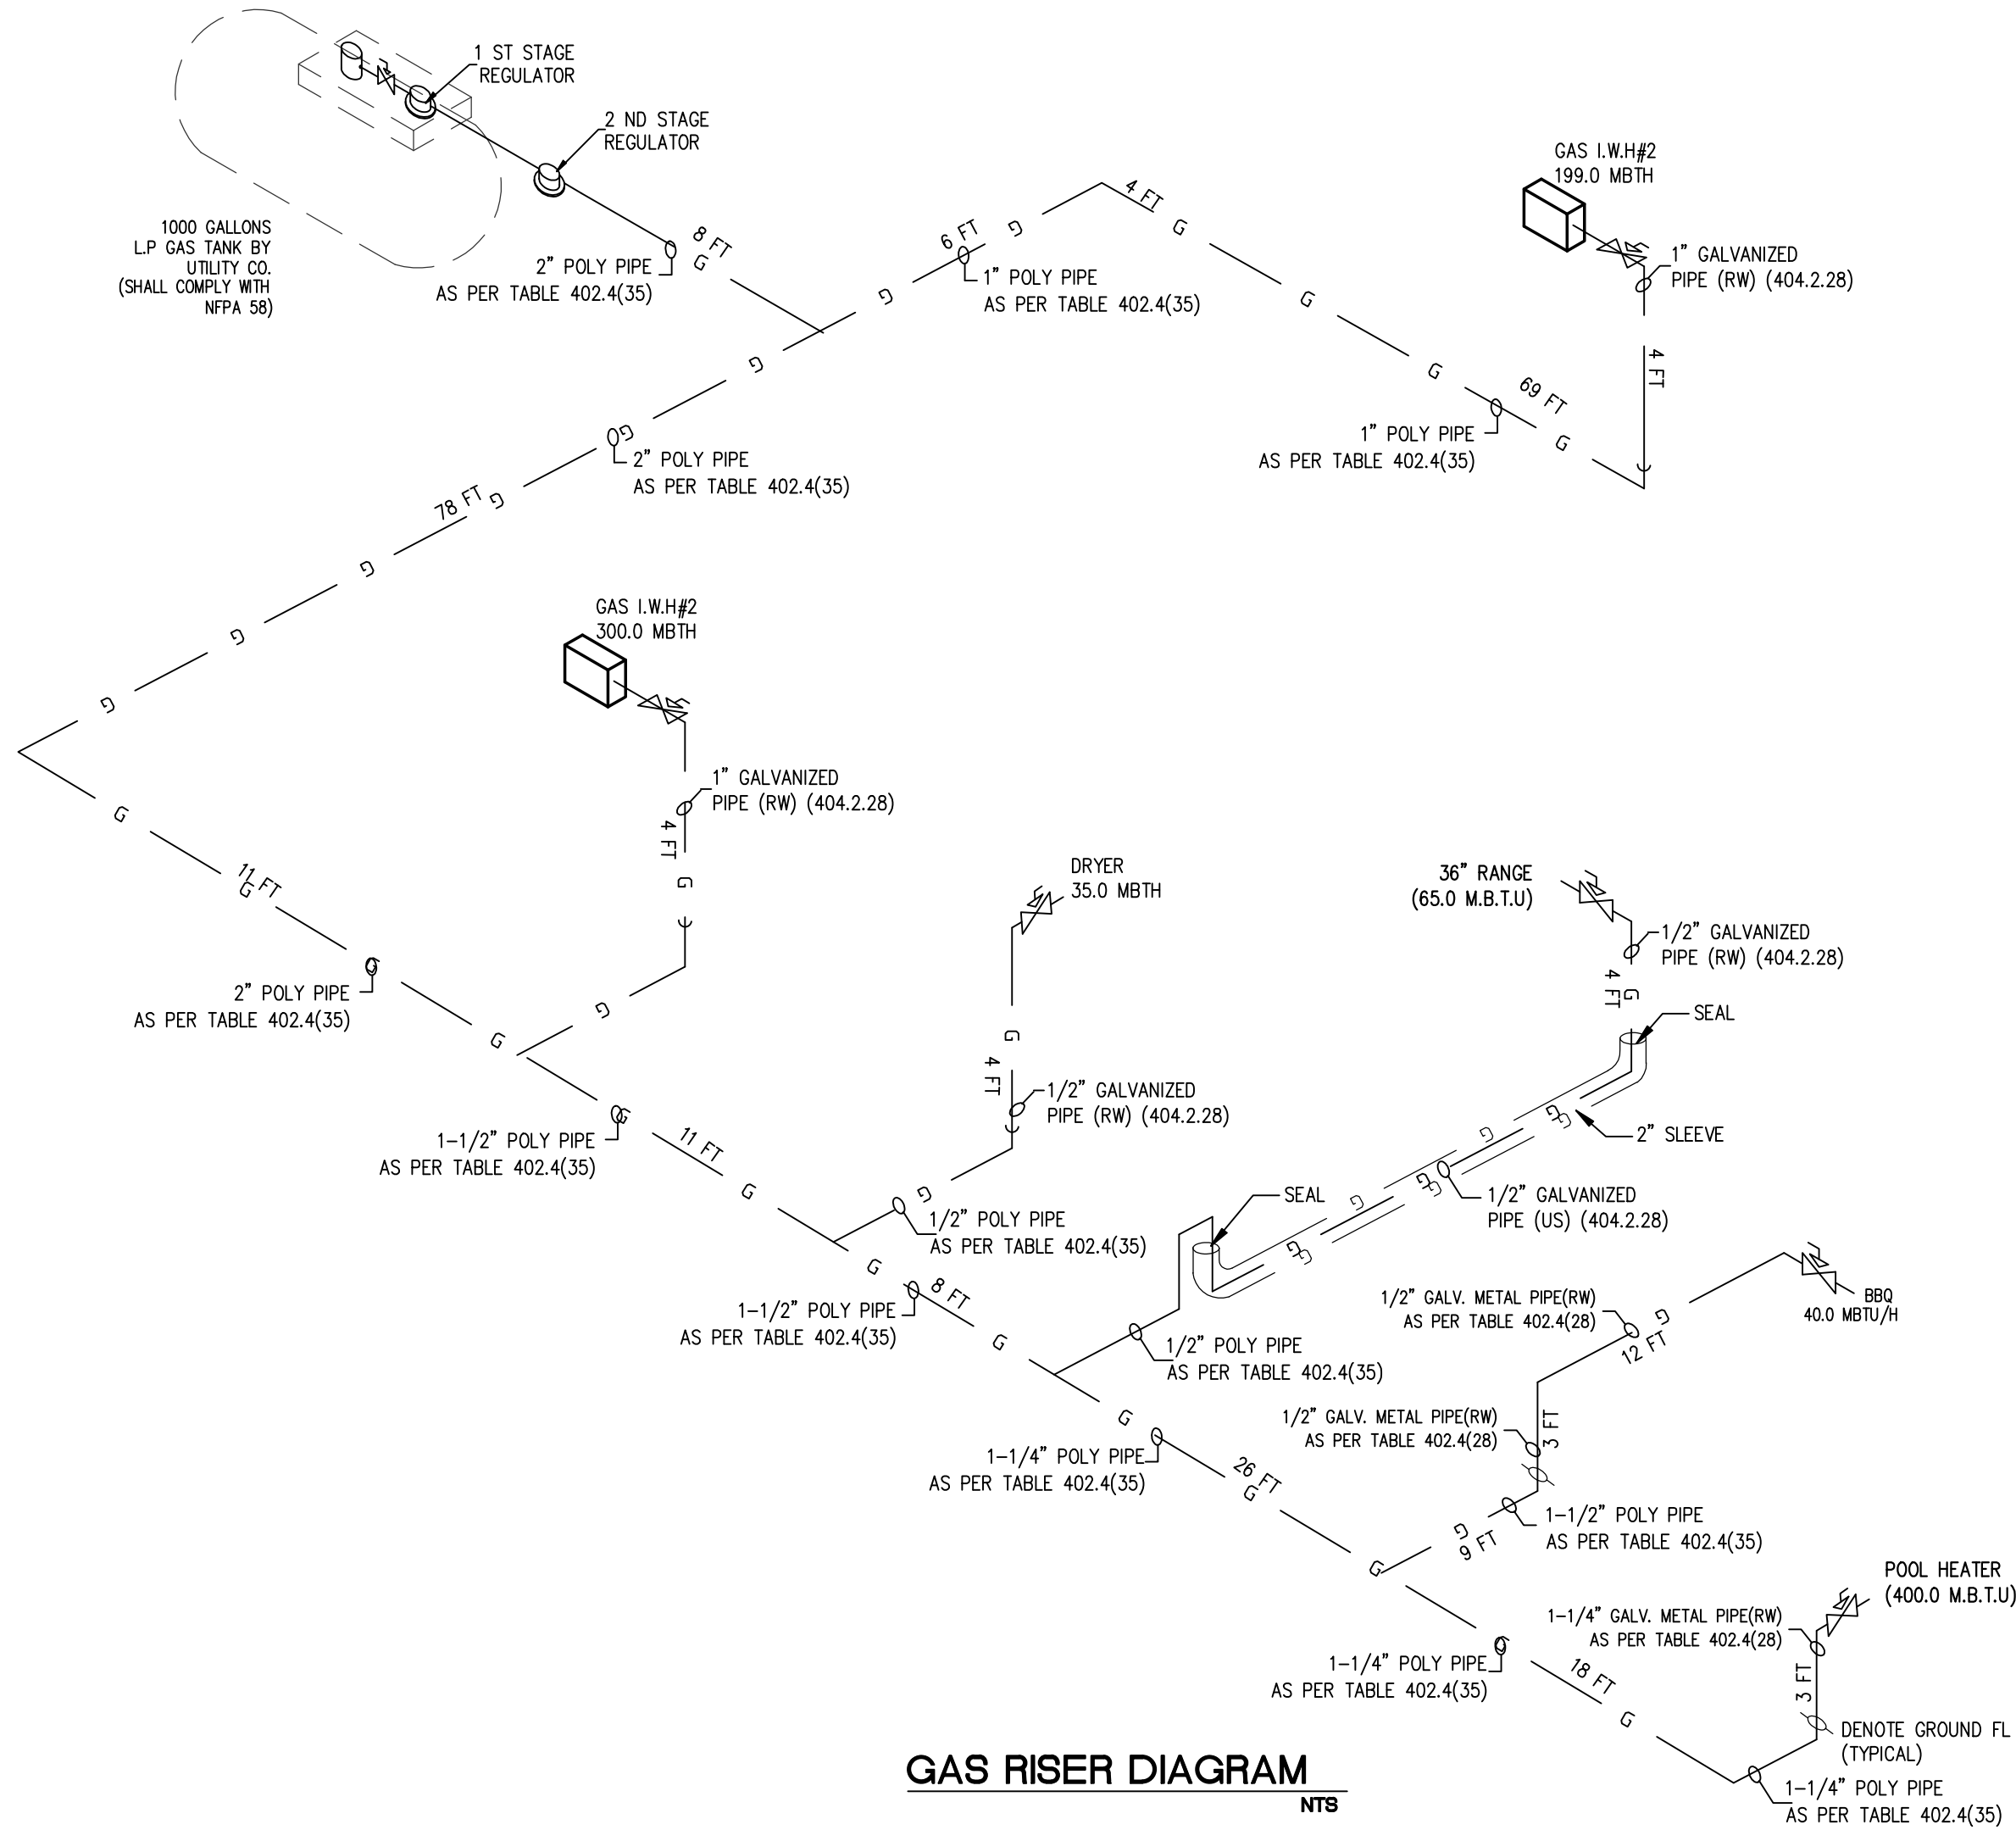


GAS RISER DIAGRAM
NTS

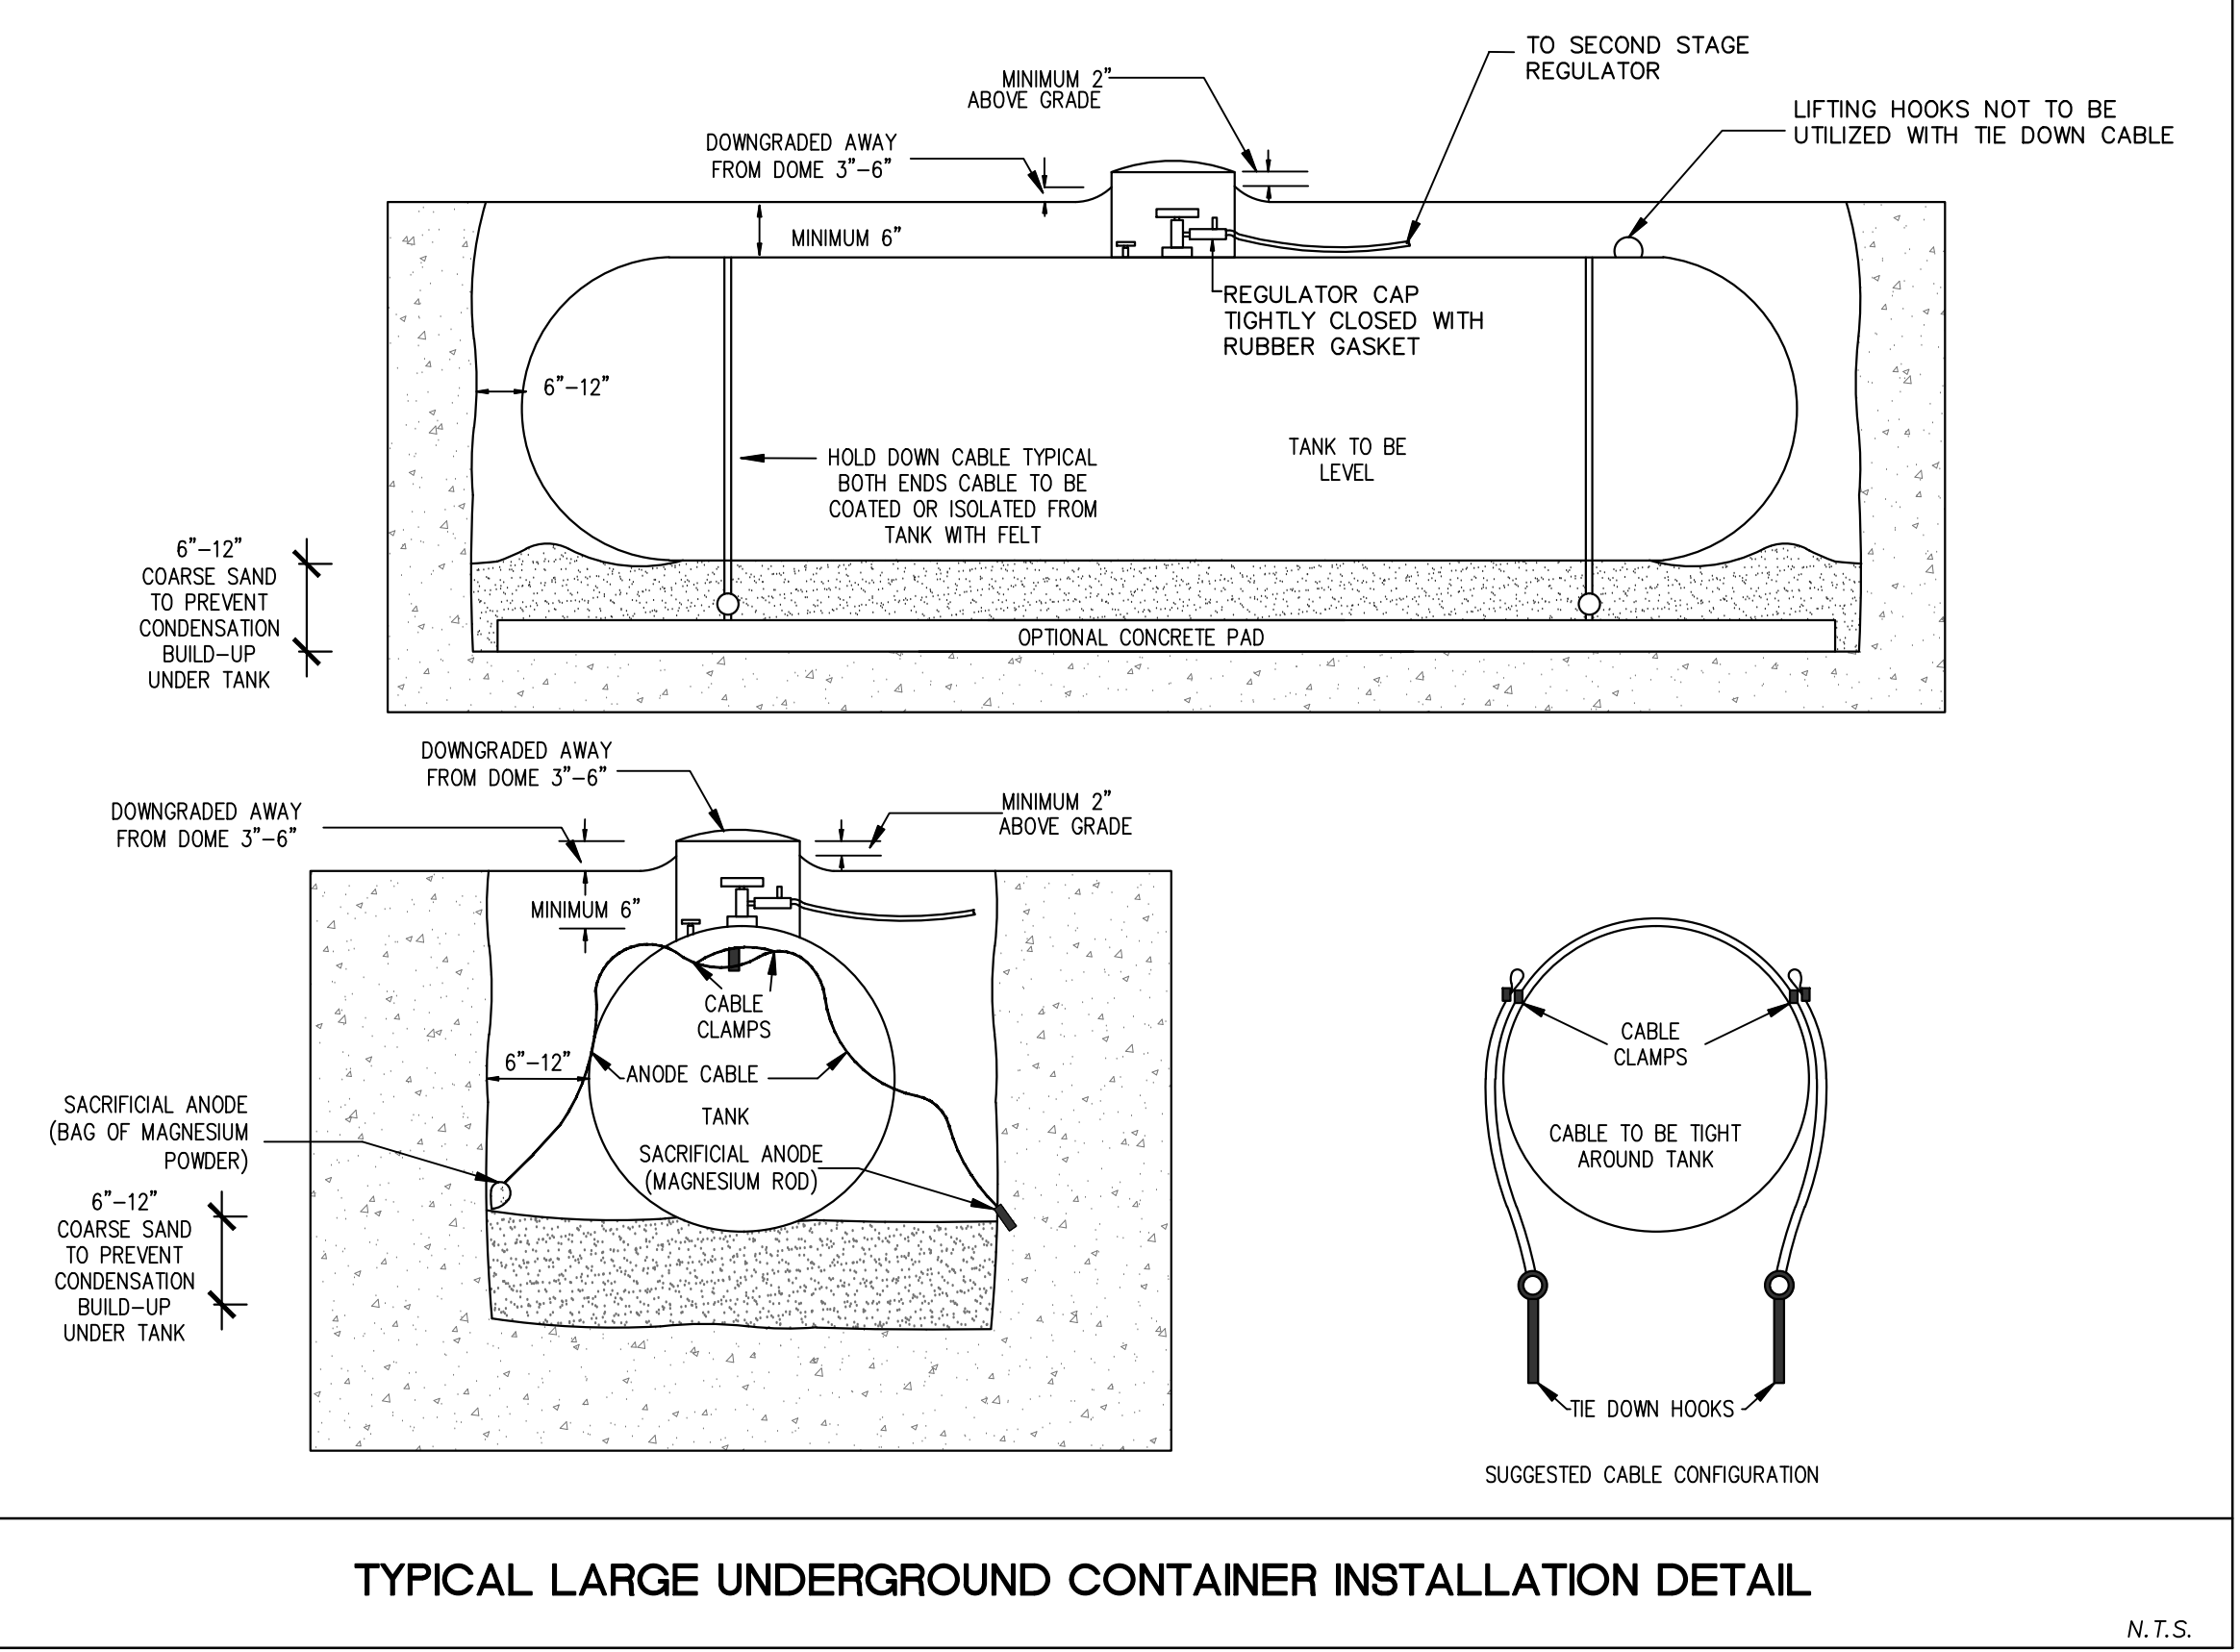


TYPICAL LARGE UNDERGROUND CONTAINER INSTALLATION DETAIL

N.T.S.

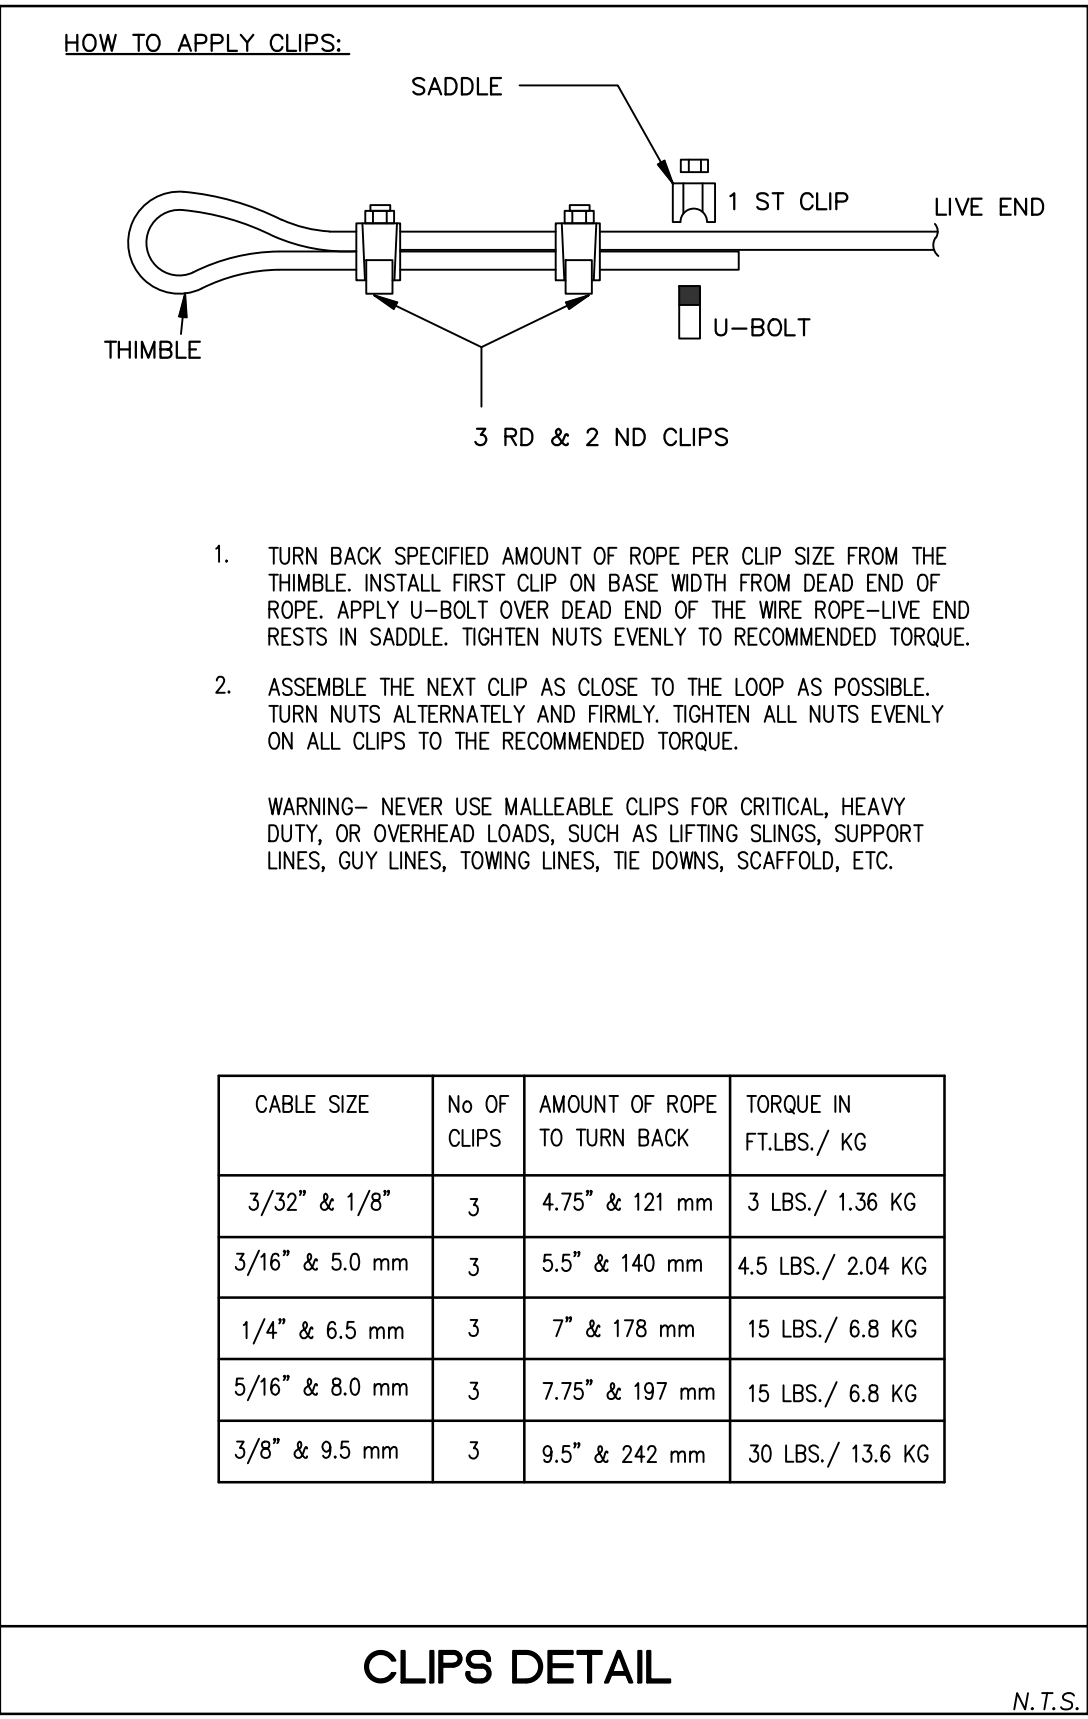

CLIPS DETAIL

N.T.S.

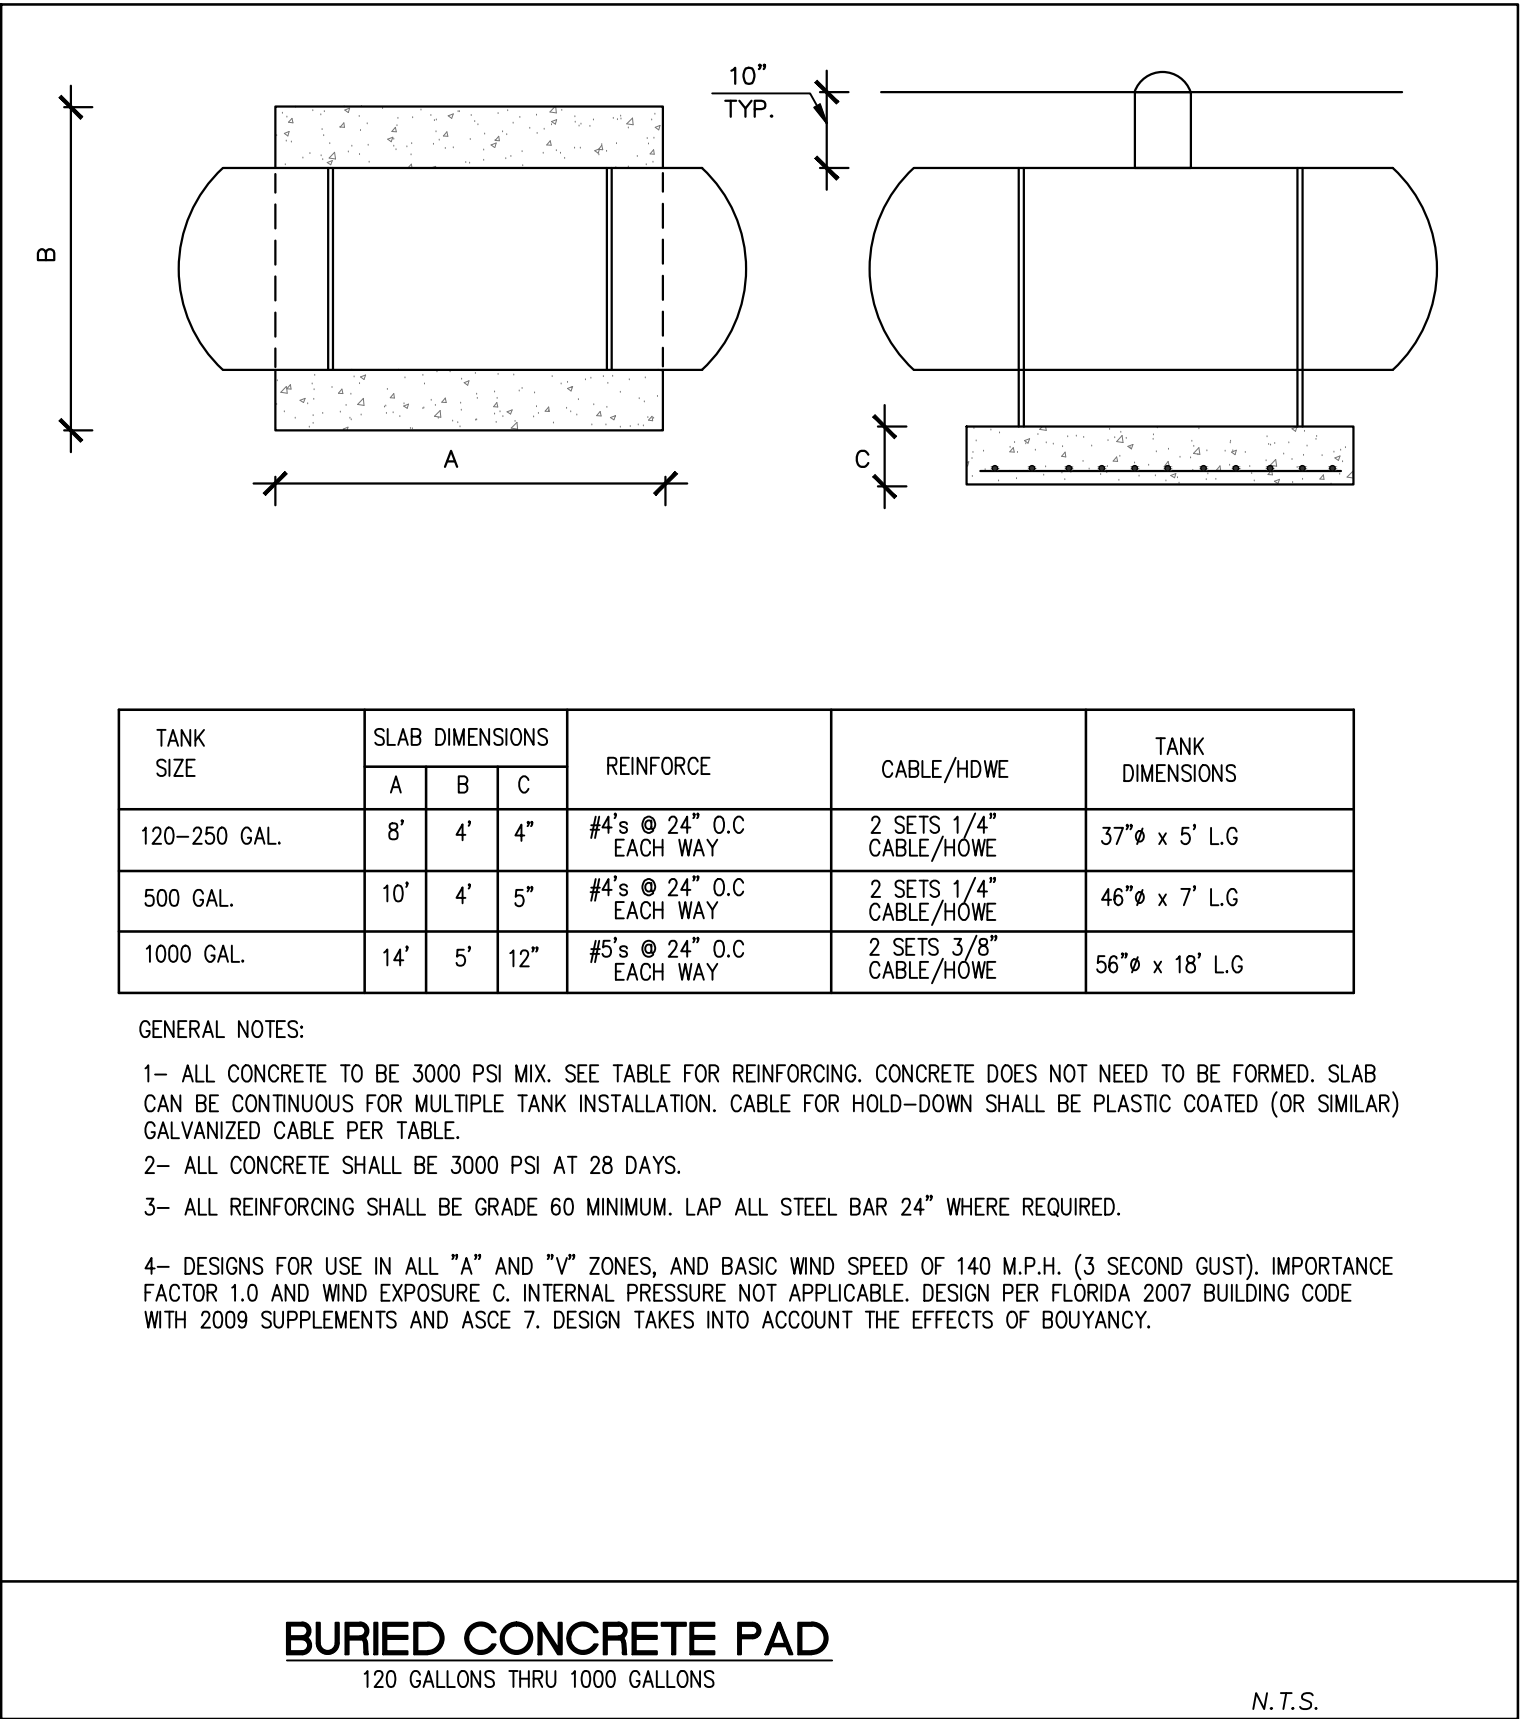

BURIED CONCRETE PAD

120 GALLONS THRU 1000 GALLONS

N.T.S.

RAMOSMARTINEZarchitects

MIAMI
655 W. FLAGLER ST.
SUITE 205
MIAMI, FL 33130

REGISTRATION: A.A. 26000528
WEBSITE: www.rmarq.com
TELEPHONE: 305-548-3006

NEW YORK
11 ERIE STREET
2nd FLOOR
JERSEY CITY, NJ 07302

NEW RESIDENCE
FOR
ELIGES INVESTORS CONSTRUCTION
AT
9841 SW 73rd COURT
PINECREST, FLORIDA 33156

STRUCTURAL ENGINEER: _____ SEAL: _____
EASTERN ENGINEERING
3401 NW 86th AVE. SUITE 370
MIAMI, FLORIDA 33122 305-599-8133

MECHANICAL ENGINEER: _____

CIVIL ENGINEER: _____

LANDSCAPE ARCHITECT: _____

ARCHITECT:
HUMBERTO RAMOS
AIA 00778933

COPYRIGHT - 2021 - RAMOSMARTINEZarchitects, inc.
THE DESIGNS, IDEAS AND DETAIL INDICATED OR REPRESENTED BY THIS DRAWING,
CREATED AND DEVELOPED FOR USE ON THIS PROJECT, ARE OWNED BY AND THE LEGAL
PROPERTY OF RAMOSMARTINEZ architects, inc. USE, REPRODUCTION, DISTRIBUTION OR
ALTERATION IS PROHIBITED WITHOUT WRITTEN AUTHORIZATION BY THE ARCHITECT.

KEY PLAN: _____



COMM. NO.: 17-117 NO: REVISION: DATE:

DATE: JANUARY, 2022

DRAWN BY: _____

CONTENT: _____

SHEET NUMBER: _____