

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590, F (786) 315-2599
www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

Roofing Experts Services, Inc.
15240 SW 169 Lane
Miami, FL 33187

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami-Dade County and other areas, where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Englert Series 1300 - 0.032 in Aluminum Panel over Wood Deck

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of pages 1 through 9.

The submitted documentation was reviewed by Sifang Zhao, P.E.



NOA No.: 21-0603.28
Expiration Date: August 05, 2026
Approval Date: August 05, 2021
Page 1 of 9

ROOFING ASSEMBLY APPROVAL

Category:	Roofing
Sub-Category:	Metal, Panels (Non-Structural)
Material:	Aluminum
Deck Type:	Wood
Maximum Design Pressure	See Table A Below

TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT:

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>
Series 1300	l = various w = 16" or 20" Thickness = 0.032" Min. Yield Strength: 24 ksi	TAS 110 TAS 125	Aluminum, preformed, standing seam, coated panels.
Series 1300 6" Clip	l = 6-1/4" w = 1-1/2" h = 1-11/16" Thickness Min. = 0.024"	TAS 114	Corrosion resistant, formed, steel clips for metal panel installation.
Series 1300 Two Piece Floating Clip	l = 3" w = 3/4" h = 1- 1/2" Thickness Min. = Top: 0.015" Base: 0.030"	TAS 114	Corrosion resistant, two piece floating, stainless steel clips for metal panel installation.
Series 1300 3" Clip	l = 3" w = 1-3/16" h = 1-5/8" Thickness Min. = 0.024"		Corrosion resistant, formed, steel clips for metal panel installation
Trim Pieces	l = varies w = varies Thickness = 0.032"	TAS 110	Standard flashing and trim pieces. Manufactured for each panel width.

TRADE NAMES OF PRODUCTS MANUFACTURED BY OTHERS:

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>	<u>Manufacturer</u>
Bostik 70 0-5A	N/A	TAS 110	Heavy duty construction adhesive.	Bostik, Inc.



EVIDENCE SUBMITTED

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
Architectural Testing, Inc.	01-32797.01	TAS 100	11/05/98
	46064.01-122-18	TAS 125	07/21/11
	B8192.01-109-18 R2	TAS 125	02/01/13
Hurricane Test Laboratory, Inc.	0155 0404-04	TAS 125	05/21/04
BASF		ASTM G23 ASTM B117	11/15/04
ATI/Intertek	F1488.01-109-18	TAS 125	05/05/16
Intertek	G5733.01-106-18	TAS 114 App G	01/05/17



APPROVED ASSEMBLIES:

System A-1:	Series 1300 Metal Roof Panels 16" wide
Deck Type:	Wood, Non-Insulated
Deck Description:	New Construction $1\frac{9}{32}$ " or greater plywood or wood plank.
Slope Range:	2": 12" or greater (1":12" effective w/ 2020 FBC 7 th Edition)
Maximum Uplift Pressure:	See Table A below

N/A

Deck Attachment:	Deck shall be attached in accordance with applicable Building Code, but in no case shall it be less than 8d x 2-1/2" galvanized ring shank roofing nails spaced 6" o.c. at roof perimeter and field. In reroofing, where the deck is less than $1\frac{9}{32}$ " thick (Minimum $1\frac{5}{32}$ ") the above attachment method must be in addition to existing attachment.
Underlayment:	Minimum underlayment shall be an ASTM D 226 Type II installed with a minimum 4" side-lap and 6" end-laps. Underlayment shall be fastened with corrosion resistant 32 gauge tin-caps and 12 gauge 1-1/4" annular galvanized ring-shank roofing nails, spaced 6" o.c. at all laps and two staggered rows 12" o.c. in the field of the roll. Or, any approved underlayment having a current NOA.
Fire Barrier Board:	Any approved fire barrier having a current NOA. Refer to a current fire directory listing for fire ratings of this roofing system assembly as well as the location of the fire barrier within the assembly. See Limitation # 1.
Valleys:	Valley construction shall be in compliance with Roofing Application Standard RAS 133 and with Engler's current published installation instructions.
Metal Panels and Accessories:	Install the "Series 1300 Panel" and accessories in compliance with the current published installation instructions and details in Engler's Installation Manual. Flashings, penetrations, valley construction and other details shall be constructed in compliance with Roofing Application Standard RAS 133. Each roof panel is attached to the plywood substrate along its male rib using the approved Series 1300 6" Clip (6-1/4" long x 1-1/2" wide x $1\frac{11}{16}$" tall) located 3" from each panel end and at a spacing as listed in Table A below. Each clip is attached to substrate with four (4) corrosion resistant #10 self tapping pan head screws of sufficient length to penetrate through the sheathing a minimum of 3/16". Attach adjacent panel by placing the female rib over the male rib and clip. Standing seams shall be mechanically seamed to a full 180 degree seam, (double lock)

TABLE A
MAXIMUM DESIGN PRESSURES

Roof Areas	Field	Perimeter and Corner ¹
Maximum Design Pressures	-55.00 psf	-123.50 psf
Maximum Clip Spacing	24" o.c.	8" o.c.

1. Extrapolation shall not be allowed



NOA No.: 21-0603.28
Expiration Date: August 05, 2026
Approval Date: August 05, 2021
Page 4 of 9

System B: Series 1300 Metal Roof Panels 16" or 20" wide
Deck Type: Wood, Non-Insulated
Deck Description: New Construction ¹⁹/₃₂" or greater plywood or wood plank.
Slope Range: 2": 12" or greater
Maximum Uplift Pressure: See Table B below

Deck Attachment: Deck shall be attached in accordance with applicable Building Code, but in no case shall it be less than 8d x 2-1/2" galvanized ring shank roofing nails spaced 6" o.c. at roof perimeter and field. In reroofing, where the deck is less than ¹⁹/₃₂" thick (Minimum ¹⁵/₃₂") the above attachment method must be in addition to existing attachment.

Underlayment: Minimum underlayment shall be an ASTM D 226 Type II installed with a minimum 4" side-lap and 6" end-laps. Underlayment shall be fastened with corrosion resistant 32 gauge tin-caps and 12 gauge 1-1/4" annular galvanized ring-shank roofing nails, spaced 6" o.c. at all laps and two staggered rows 12" o.c. in the field of the roll. Or, any approved underlayment having a current NOA.

Fire Barrier Board: Any approved fire barrier having a current NOA. Refer to a current fire directory listing for fire ratings of this roofing system assembly as well as the location of the fire barrier within the assembly. See Limitation # 1.

Valleys: Valley construction shall be in compliance with Roofing Application Standard RAS 133 and with Englert's current published installation instructions.

Metal Panels and Accessories: Install the "Series 1300 Panel" and accessories in compliance with the current published installation instructions and details in Englert's Installation Manual. Flashings, penetrations, valley construction and other details shall be constructed in compliance with Roofing Application Standard RAS 133.

Each roof panel is attached to the plywood substrate along its male rib using the approved Series 1300 Two Piece Floating Clip (3" long x 3/4" wide x 1-1/2" tall) located 3" from each panel end and at a spacing as listed in **Table B** below. Each clip is attached to substrate with two (2) corrosion resistant #10 self tapping pan head screws of sufficient length to penetrate through the sheathing a minimum of 3/16".

Attach adjacent panel by placing the female rib over the male rib and clip. Standing seams shall be hand crimped to a 90 degree single lock, then mechanically seamed to a full 180 degree seam, (double lock).

TABLE B MAXIMUM DESIGN PRESSURES			
Roof Areas	Field	Perimeter and Corner ¹	Perimeter and Corner ¹
Maximum Design Pressures	-101.25 psf	-142.50 psf	-180.00 psf
Maximum Clip Spacing	16" o.c.	8" o.c.	8" o.c.
Bostik 70-05A Adhesive	None	None	(2) 1/8" beads in seam
1. Extrapolation shall not be allowed			



System C: Series 1300 Metal Roof Panels 16" or 20" wide
Deck Type: Wood, Non-Insulated
Deck Description: New Construction ¹⁹/₃₂" or greater plywood or wood plank.
Slope Range: 2": 12" or greater
Maximum Uplift Pressure: See Table C below

N/A

Deck Attachment: Deck shall be attached in accordance with applicable Building Code, but in no case shall it be less than 8d x 2-1/2" galvanized ring shank roofing nails spaced 6" o.c. at roof perimeter and field. In reroofing, where the deck is less than ¹⁹/₃₂" thick (Minimum ¹⁵/₃₂") the above attachment method must be in addition to existing attachment.

Underlayment: Minimum underlayment shall be an ASTM D 226 Type II installed with a minimum 4" side-lap and 6" end-laps. Underlayment shall be fastened with corrosion resistant 32 gauge tin-caps and 12 gauge 1-1/4" annular galvanized ring-shank roofing nails, spaced 6" o.c. at all laps and two staggered rows 12" o.c. in the field of the roll. Or, any approved underlayment having a current NOA.

Fire Barrier Board: Any approved fire barrier having a current NOA. Refer to a current fire directory listing for fire ratings of this roofing system assembly as well as the location of the fire barrier within the assembly. See Limitation # 1.

Valleys: Valley construction shall be in compliance with Roofing Application Standard RAS 133 and with Englert's current published installation instructions.

Metal Panels and Accessories: Install the "Series 1300 Panel" and accessories in compliance with the current published installation instructions and details in Englert's Installation Manual. Flashings, penetrations, valley construction and other details shall be constructed in compliance with Roofing Application Standard RAS 133.

- Each roof panel is attached to the plywood substrate along it's male rib using the approved clips located 3" from each panel end and at a spacing as listed in **Table C** below. Clips are attached using #10 self-tapping pan head screws of sufficient length to penetrate through the sheathing a minimum of 3/16".
- Attach adjacent panel by placing the female rib over the male rib and clip. Standing seams shall be mechanically seamed to a full 90 degree seam, (single lock)

TABLE C
MAXIMUM DESIGN PRESSURES

Roof Areas	Field	Perimeter and Corner ¹
Maximum Design Pressures	-86.00 psf	-97.50 psf
Panel Clip	Series 1300 – 3" Clip (2 screws per clip)	Series 1300 – 6" Clip (4 screws per clip)
Maximum Clip Spacing	12" o.c.	8" o.c.
Bostik 70-05A Adhesive	1/8" beads in seam	1/8" beads in seam

1. Extrapolation shall not be allowed



NOA No.: 21-0603.28
 Expiration Date: August 05, 2026
 Approval Date: August 05, 2021
 Page 6 of 9

SYSTEM LIMITATIONS


1. Fire classification is not part of this acceptance; refer to a current Approved Roofing Materials Directory for fire ratings of this product.
2. The maximum designed pressure listed herein shall be applicable to all roof pressure zones (i.e., field, perimeters, and corners). Neither rational analysis, nor extrapolation shall be permitted for enhanced fastening at enhanced pressure zones (i.e., perimeters, extended corners and corners).
3. Panels may be rolls formed in continuous lengths from eave to ridge. Maximum lengths shall be as described in Roofing Application Standard RAS 133
4. All panels shall be permanently labeled with the manufacturer's name and/or logo, and the following statement: "Miami-Dade County Product Control Approved" **or** with the Miami-Dade County Product Control Seal as seen below. All clips shall be permanently labeled with the manufacturer's name and/or logo, and/or model.




5. All products listed herein shall have a quality assurance audit in accordance with the Florida Building Code and Rule **61G20-3** of the Florida Administrative Code.
6. Panels may be jobsite roll formed with machine model #(s) **05.18.03** from Englert Rollformed Products Association.




PROFILE DRAWINGS

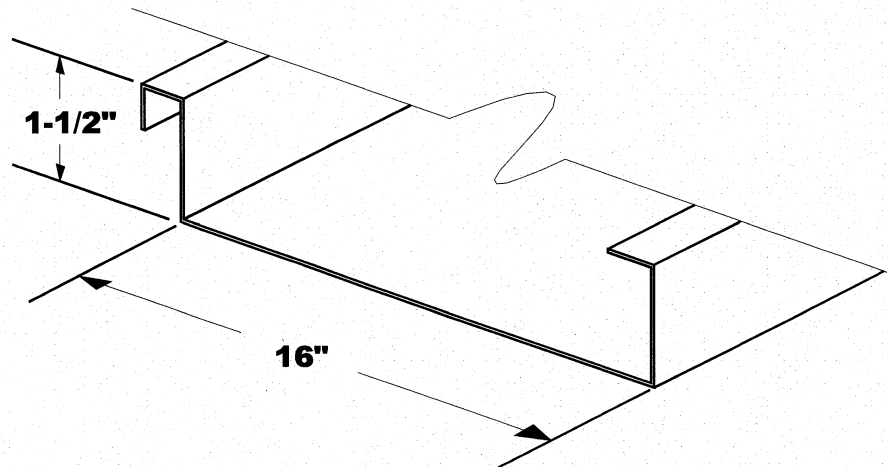


SERIES 1300 METAL PANEL

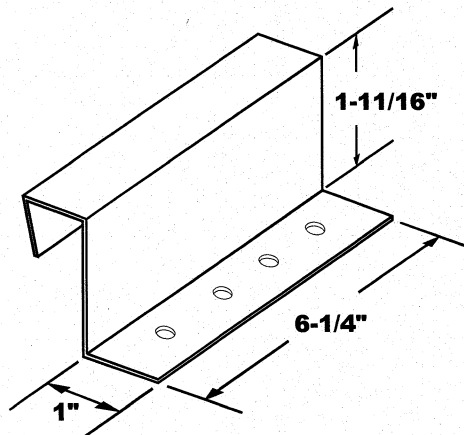


SERIES 1300 6" CLIP

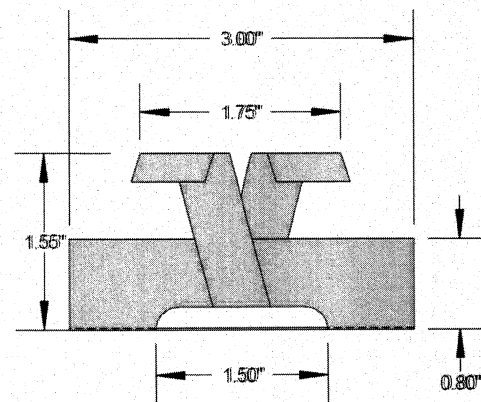


SERIES 1300 TWO-PIECE FLOATING CLIP

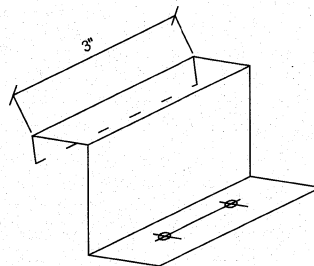


SERIES 1300 3" CLIP




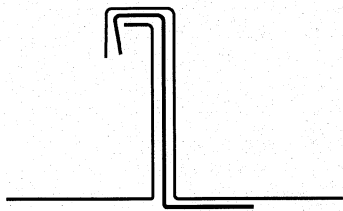

Before Seaming

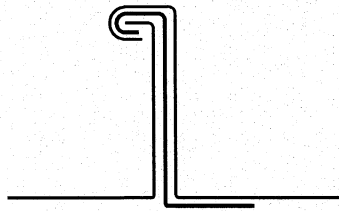


**90 degree
Seam**

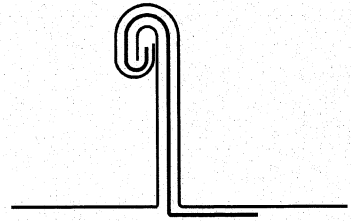


**180 degree
Seam**

Bostik Sealant

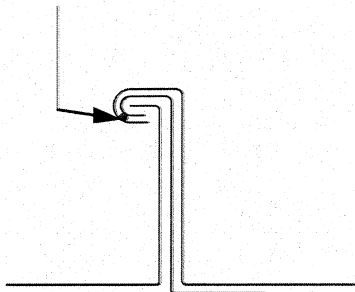

**90 degree
Seam w/Bostik
Sealant**

Bostik Sealant

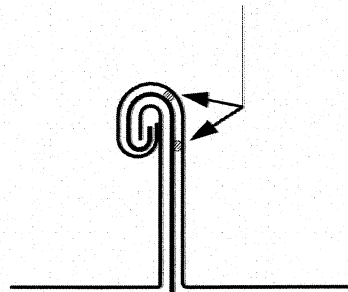

**180 degree
Seam w/ (2) beads
of Bostik Sealant**

END OF THIS ACCEPTANCE

TGFU.R18970 - Roofing Systems

Note: We are enhancing our systems and you may notice duplicate entries/missing/outdated data. During this interim period, please contact our Customer Service at <https://www.ul.com/about/locations>.

Roofing Systems

ENGLERT INC

1200 Amboy Ave

Perth Amboy, NJ 08861-1920 United States

R18970

OTHER SYSTEMS

Class A

1. **Deck:** C-15/32 or spaced sheathing

Incline: Unlimited

Impact: 4

Underlayment: — One layer GAF "VersaShield Underlayment", mechanically fastened.

Ply Sheet: — One layer Type 30 base sheet or GAF "VersaShield", mechanically fastened.

Panels: — Steel, zinc or copper roofing panels, designated "Series 1000", "Series 1100", "Series 1120", "Series 1300", "Series 1300(TCSII)", "Series 1500", "Series 2000", "Series 2400", "Series 2500", "Series 1301" or "Metalman 900HS" mechanically fastened.

2. **Deck:** C-15/32 or spaced sheathing

Incline: Unlimited

Impact: 4

Underlayment: — One or more plies GAF "VersaShield Underlayment" mechanically fastened.

Panels: — Steel, zinc or copper roofing panels, designated "Series 1000", "Series 1100", "Series 1120", "Series 1300", "Series 1300(TCSII)", "Series 1500", "Series 2000", "Series 2400", "Series 2500", "Series 1301" or "Metalman 900HS" mechanically fastened.

3. **Deck:** C-15/32

Incline: Unlimited

Impact: 4

Barrier Board: — Minimum 1/4 in. thick. Georgia-Pacific Gypsum LLC "DensDeck® Roofboard" or "DensDeck Prime® Roofboard" or "DensDeck DuraGuard™ Roofboard" with all butt joints staggered a minimum of 6-in. from the plywood roof deck butt joints.

Insulation (Optional): — Fiberglass, polyisocyanurate, perlite or wood fiber, any thickness.

Membrane: — Any UL Classified modified bitumen system, BUR system or CPE, CSM, CSPE, EPDM, NBP, PIB, PVC, TPO or TRE membrane system suitable for use with any roof insulation.

Panels: — Steel, zinc or copper roofing panels, designated "Series 1000", "Series 1100", "Series 1120", "Series 1300", "Series 1300(TCSII)", "Series 1500", "Series 2000", "Series 2400", "Series 2500", "Series 1301" or "Metalman 900HS" mechanically fastened.

4. **Deck:** C-15/32

Incline: Unlimited

Underlayment: — Two or more plies GAF "VersaShield® Fire-Resistant Roof Deck Protection" or GAF "VersaShield® Underlayment" mechanically fastened.

Panels: — Steel or aluminum roofing panels, designated "Series 1000", "Series 1100", "Series 1120", "Series 1300", "Series 1300(TCSII)", "Series 1500", "Series 2000", "Series 2400", "Series 2500", "Series 1301" or "Metalman 900HS" mechanically fastened.

5. **Deck:** C-15/32

Incline: Unlimited

Underlayment: — One or more plies GAF "VersaShield® Solo™ Fire Resistant Slip Sheet", mechanically fastened.

Panels: — Steel or aluminum roofing panels, designated "Series 1000", "Series 1100", "Series 1120", "Series 1300", "Series 1300(TCSII)", "Series 1500", "Series 2000", "Series 2400", "Series 2500", "Series 1301", or "Metalman 900HS" mechanically fastened.

Class B

1. Deck: C-15/32

Incline: Unlimited

Underlayment: — One or more plies GAF "VersaShield® Fire-Resistant Roof Deck Protection" or GAF "VersaShield® Underlayment", mechanically fastened.

Panels: — Steel or aluminum roofing panels, designated "Series 1000", "Series 1100", "Series 1120", "Series 1300", "Series 1300(TCSII)", "Series 1500", "Series 2000", "Series 2400", "Series 2500", "Series 1301" or "Metalman 900HS" mechanically fastened.






The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL Solutions' Follow - Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL Solutions' Follow - Up Service. Always look for the Mark on the product.

UL Solutions permits the reproduction of the material contained in Product iQ subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from Product iQ with permission from UL Solutions" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "©2022 UL LLC."

IMPORTANT! CONSULT ENGLERT TECHNICAL DEPARTMENT WHEN SLOPE IS LESS THAN 3:12 FOR REQUIRED VALLEY FLASHING WIDTH.

IMPORTANT! ENGLERT H/T UNDERLAYMENT REQUIRED ON SOLID SUBSTRATES & RIGID INSULATION. SEE DETAIL# R14 FOR INSTALLATION INSTRUCTIONS.

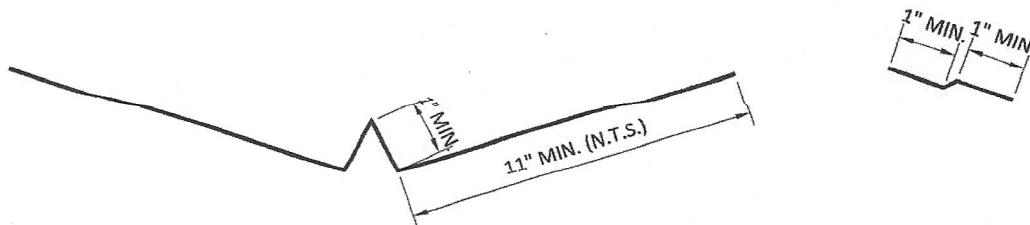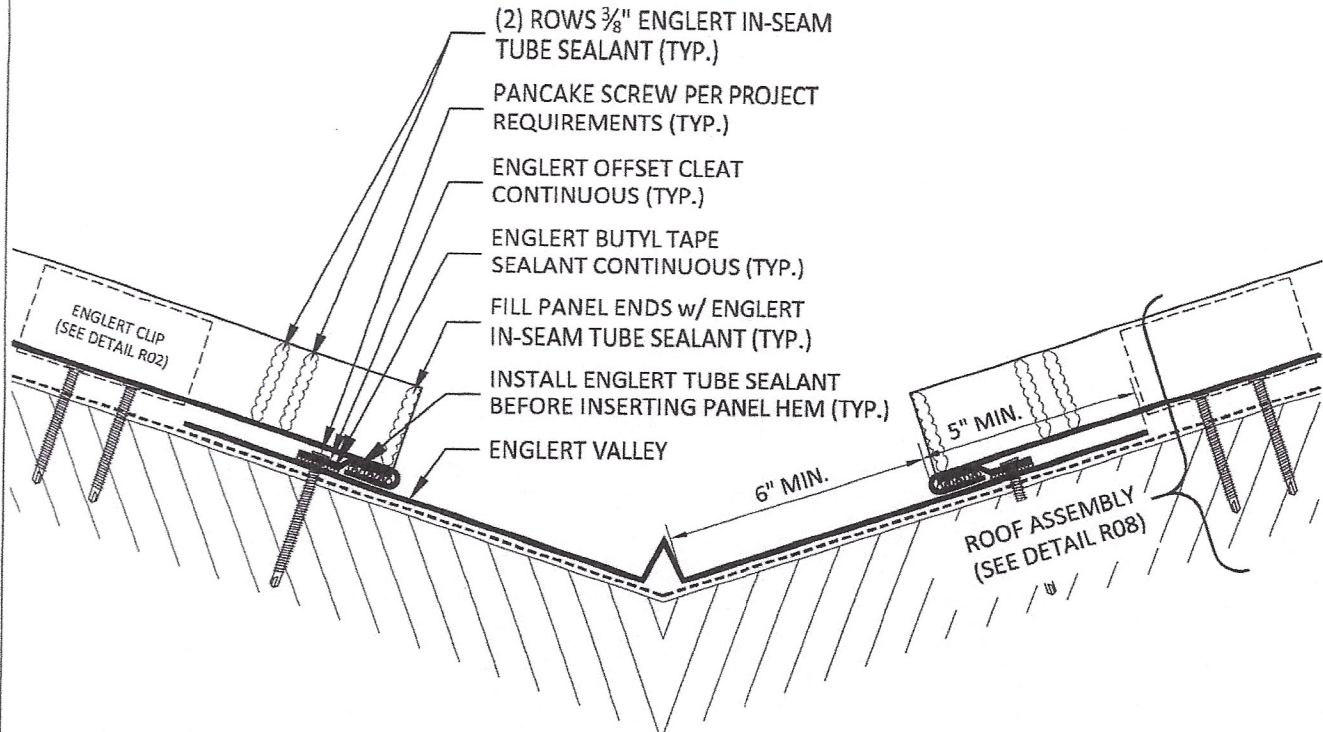




ENGLERT
www.englertinc.com
 800-364-5378

GENERIC BEST PRACTICE ASSEMBLY SHOWN. WATERTIGHTNESS WARRANTY NOT IMPLIED. WHEN SITE CONDITION DIFFERS, SPECIFIC ENGINEERING NECESSARY.

ROOF VALLEY	
OFFSET CLEAT	

DETAIL SUBJECT TO CHANGE WITHOUT NOTICE.
Detail #
R14.1




1300 SERIES - PLYWOOD DECK

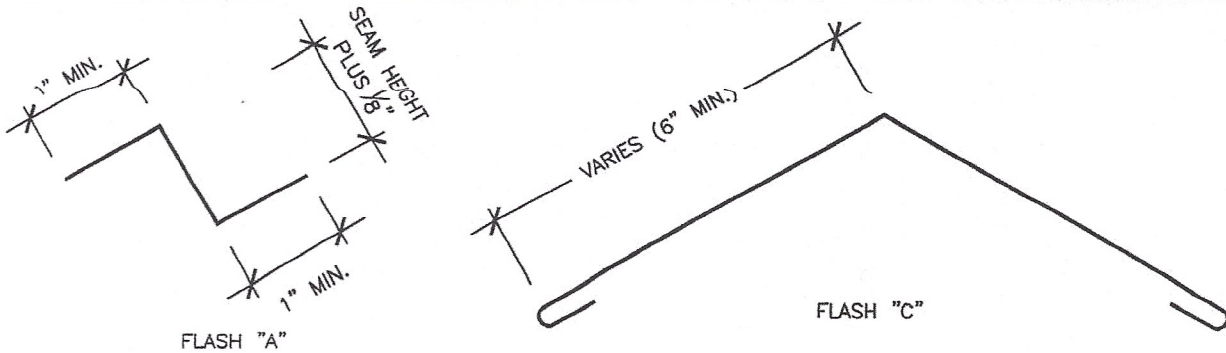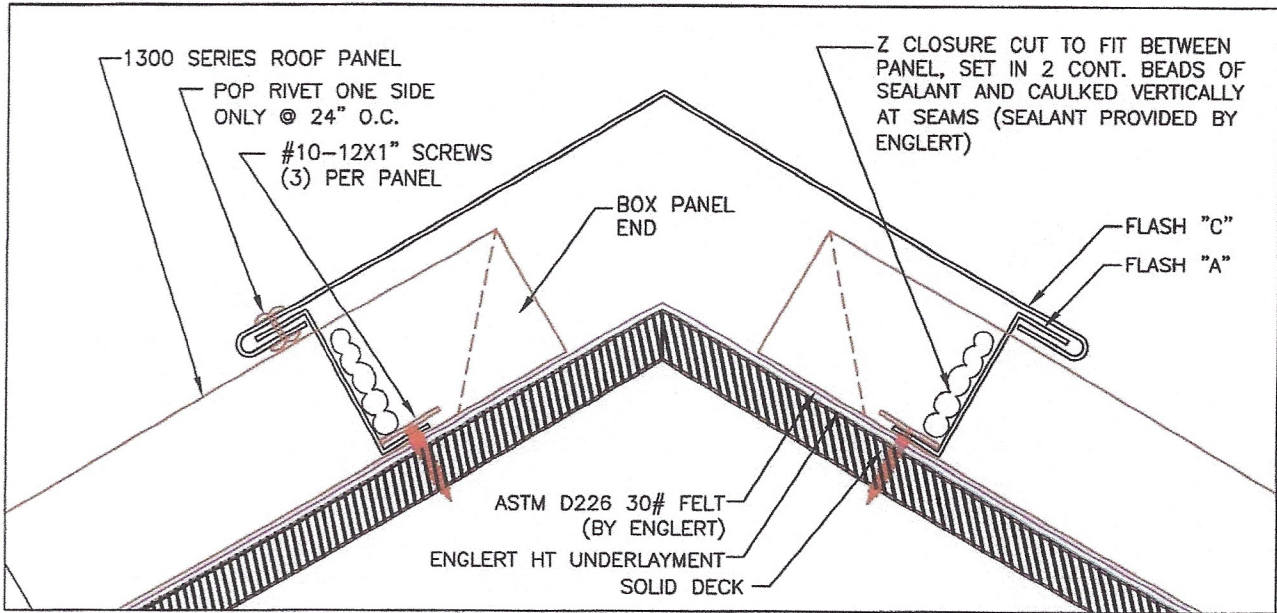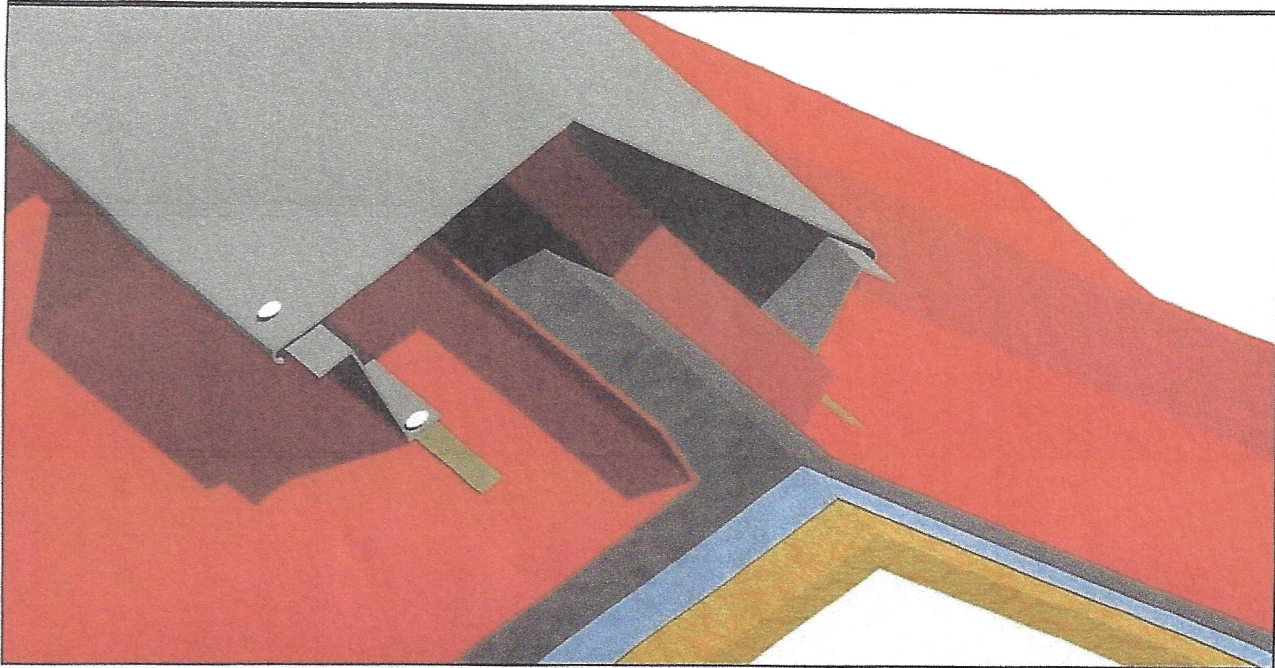

RIDGE DETAIL



13P-011

1300 SERIES - PLYWOOD DECK

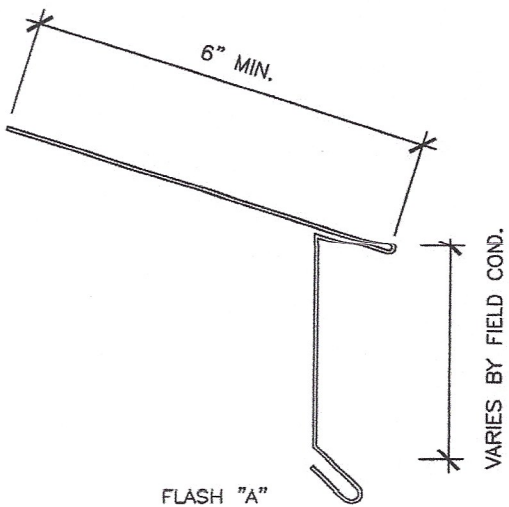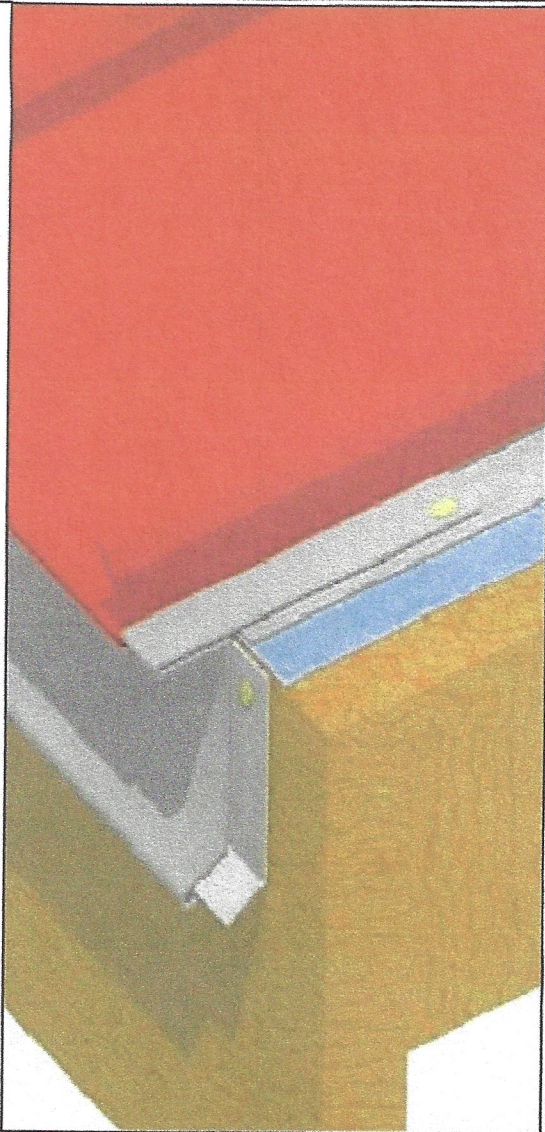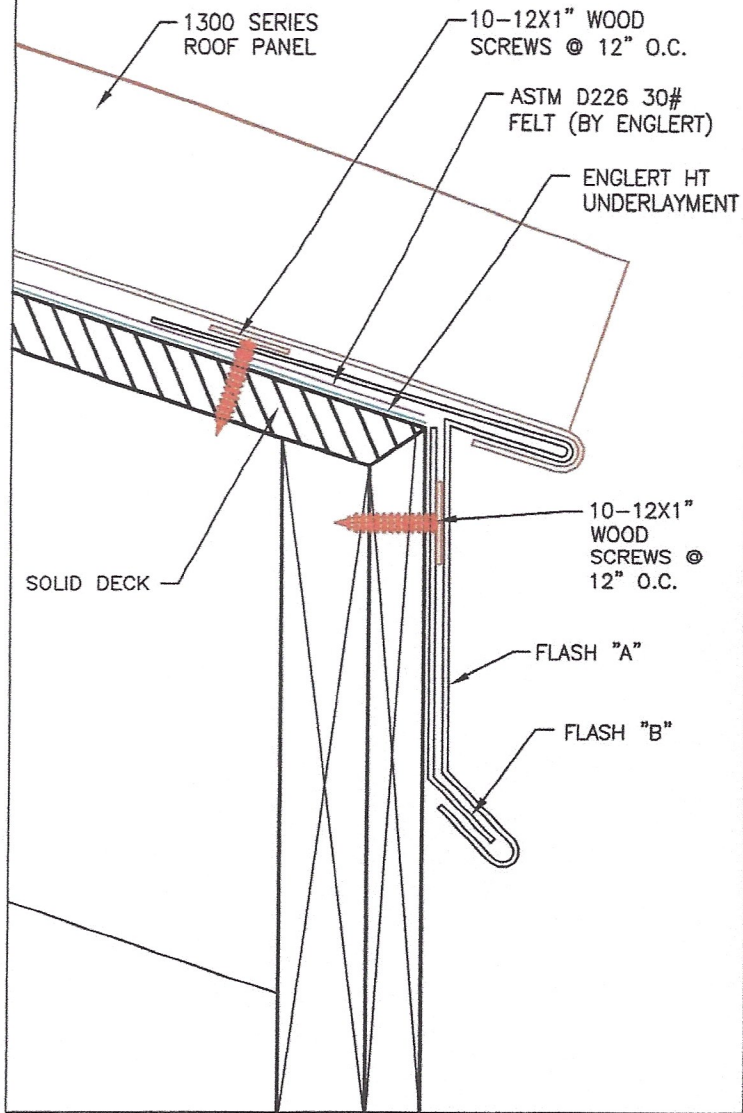

EAVE DETAIL

13P-050

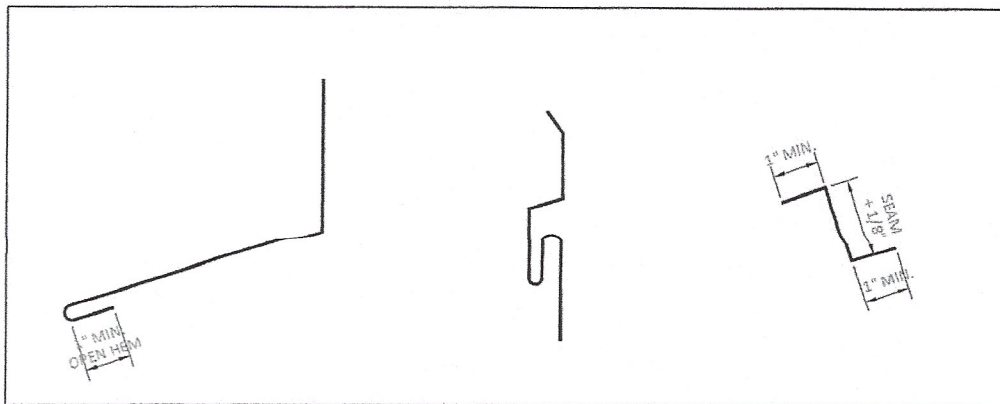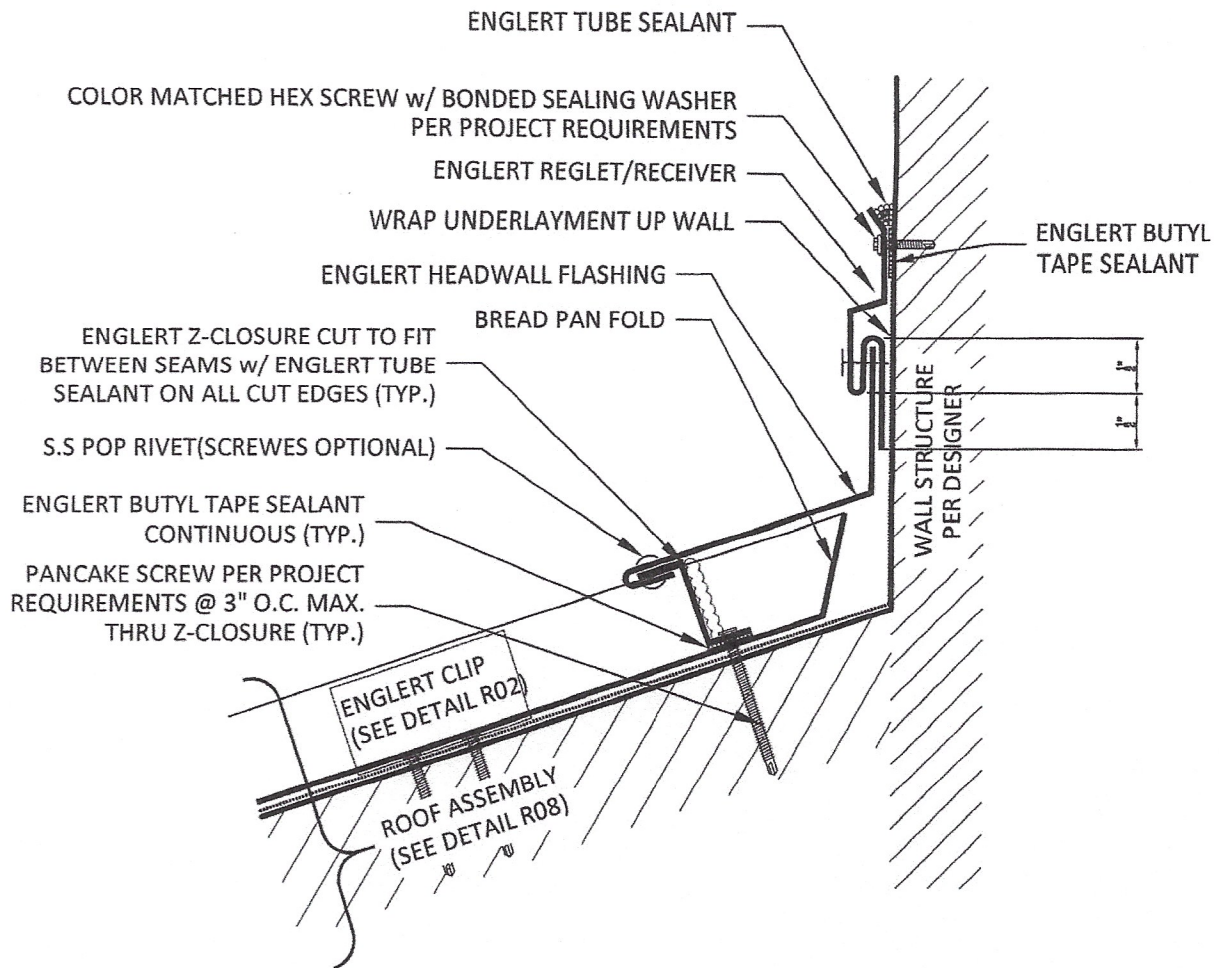

ENGLERT

www.englertinc.com
800-384-5378

GENERIC BEST PRACTICE ASSEMBLY
SHOWN, WATERIGHTNESS
WARRANTY NOT IMPLIED
WHEN SITE CONDITION DIFFERS,
SPECIFIC ENGINEERING NECESSARY




ROOF HEADWALL

COUNTER FLASHING W/SEALANT

WITHOUT NOTICE

DETAIL #

R18.1

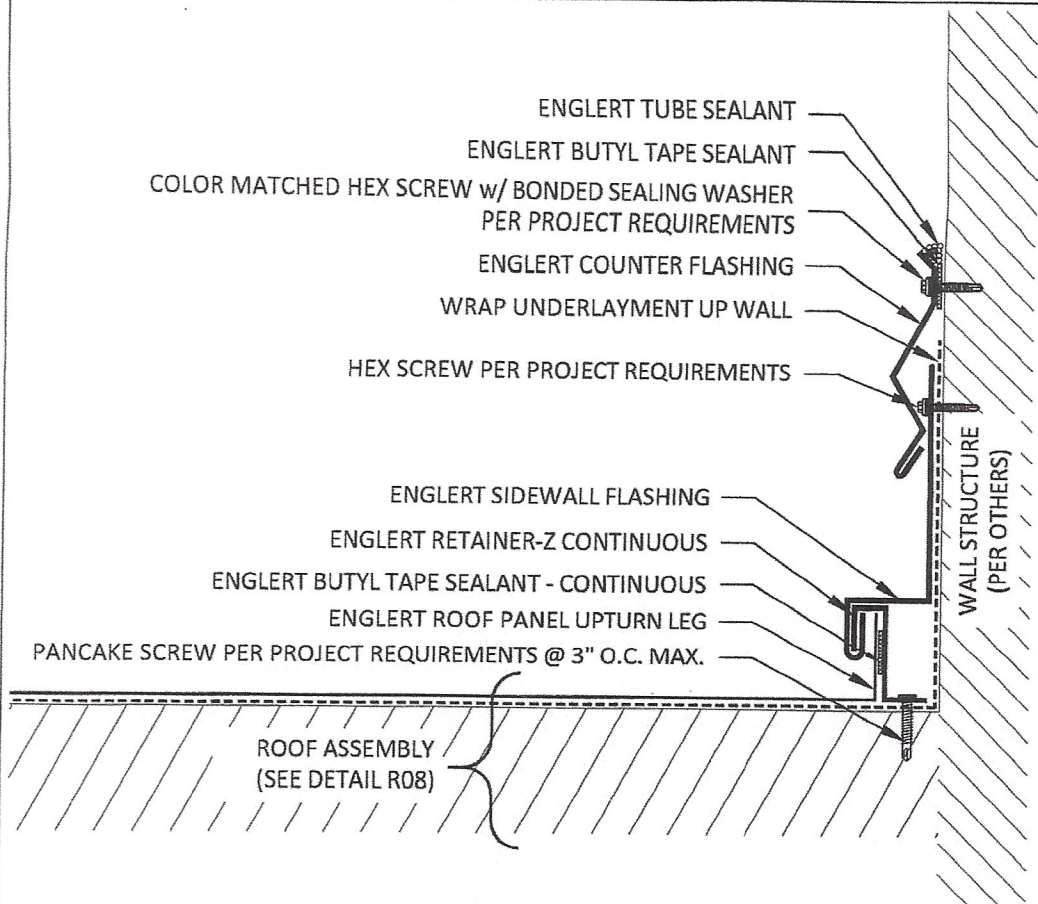

ENGLERT
www.englertinc.com
 800-364-5378



GENERIC BEST PRACTICE ASSEMBLY SHOWN. WATERTIGHTNESS WARRANTY NOT IMPLIED. WHEN SITE CONDITION DIFFERS, SPECIFIC ENGINEERING NECESSARY.

ROOF SIDEWALL

COUNTER FLASHING w/ SEALANT


DETAIL SUBJECT TO CHANGE WITHOUT NOTICE.

Detail # **R22.1**

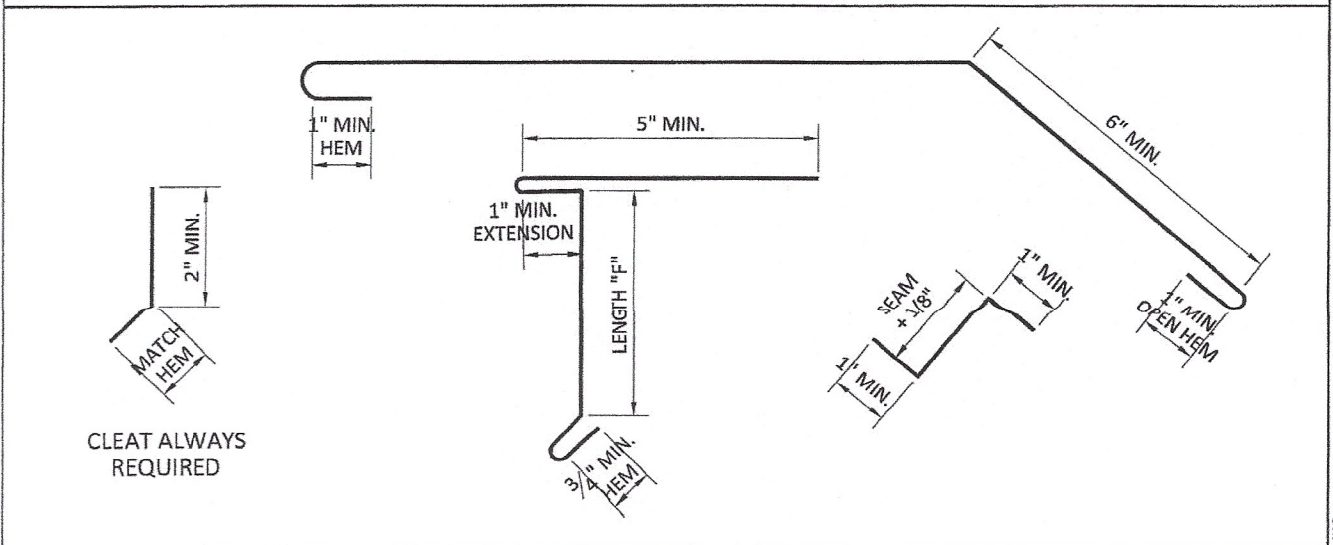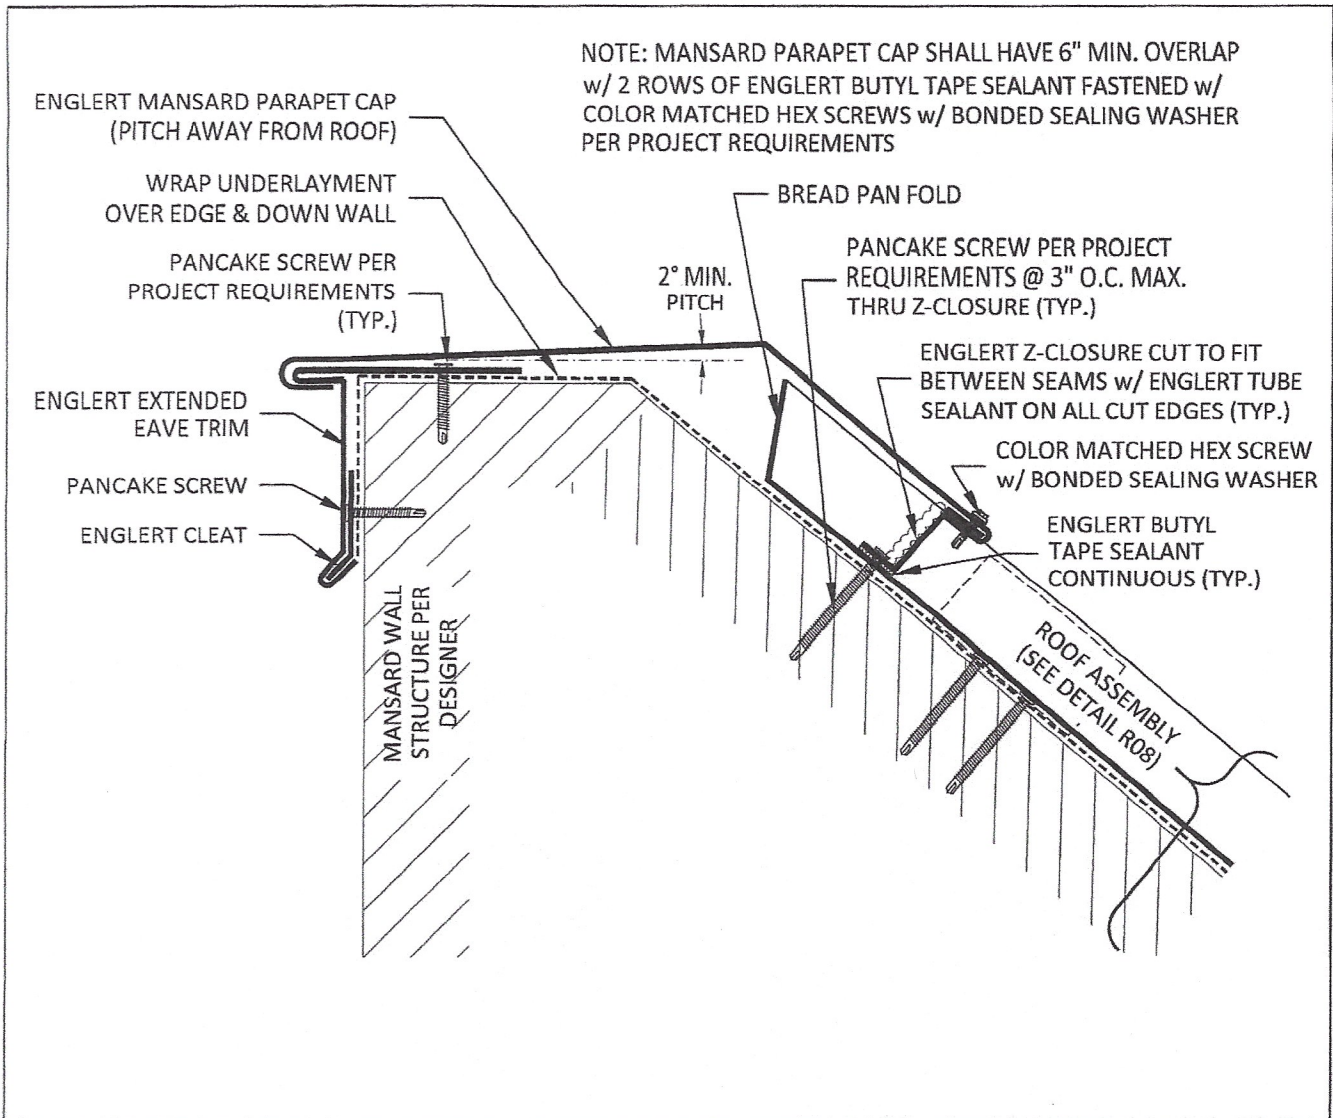

 ENGLERT™ www.englertinc.com 800-364-5378 GENERIC BEST PRACTICE ASSEMBLY SHOWN. WATER TIGHTNESS WARRANTY NOT IMPLIED. WHEN SITE CONDITION DIFFERS, SPECIFIC ENGINEERING NECESSARY.	ROOF PEAK MANSARD	DETAIL SUBJECT TO CHANGE WITHOUT NOTICE. Detail # R12.3
--	------------------------------------	--

**CAUTION - THIS DETAIL MAY
PIN PANELS AT THIS POINT!**

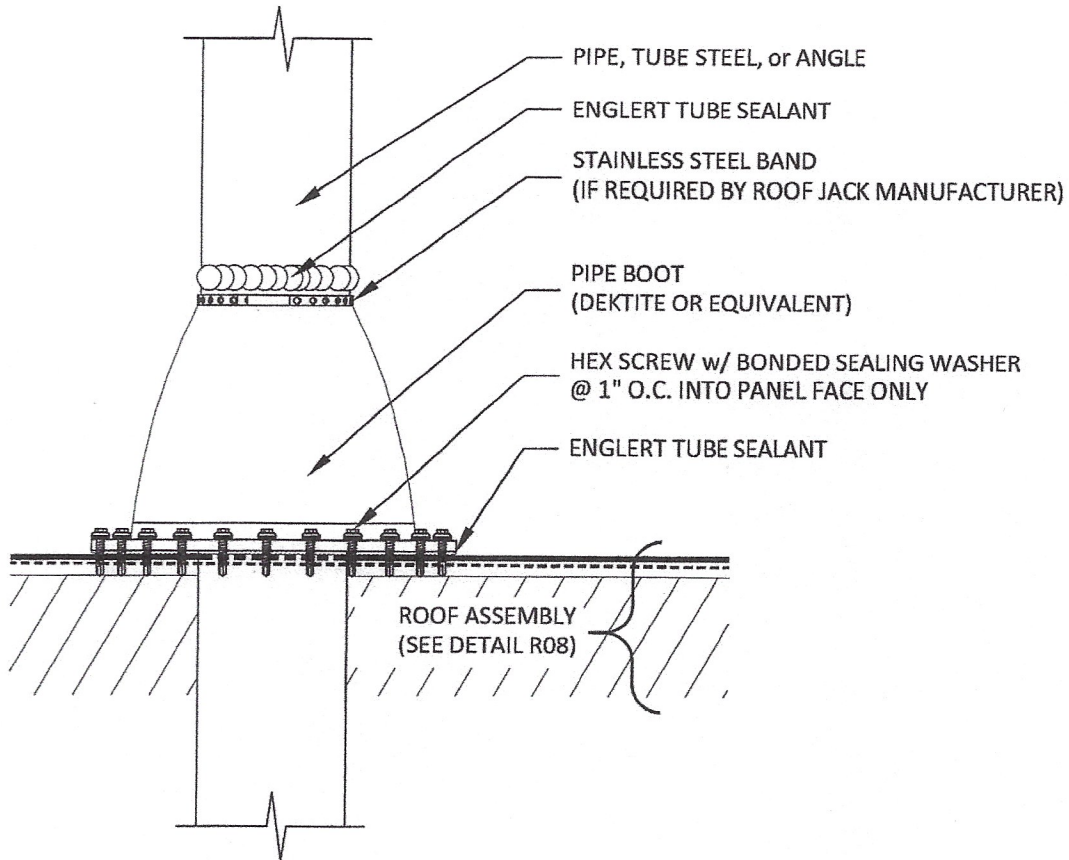

ENGLERT™
www.englertinc.com
800-364-5378


GENERIC BEST PRACTICE ASSEMBLY
SHOWN. WATERTIGHTNESS
WARRANTY NOT IMPLIED.
WHEN SITE CONDITION DIFFERS,
SPECIFIC ENGINEERING NECESSARY.

ROOF PENETRATION

PIPE BOOT


DETAIL SUBJECT TO CHANGE
WITHOUT NOTICE.

Detail #
R26.1

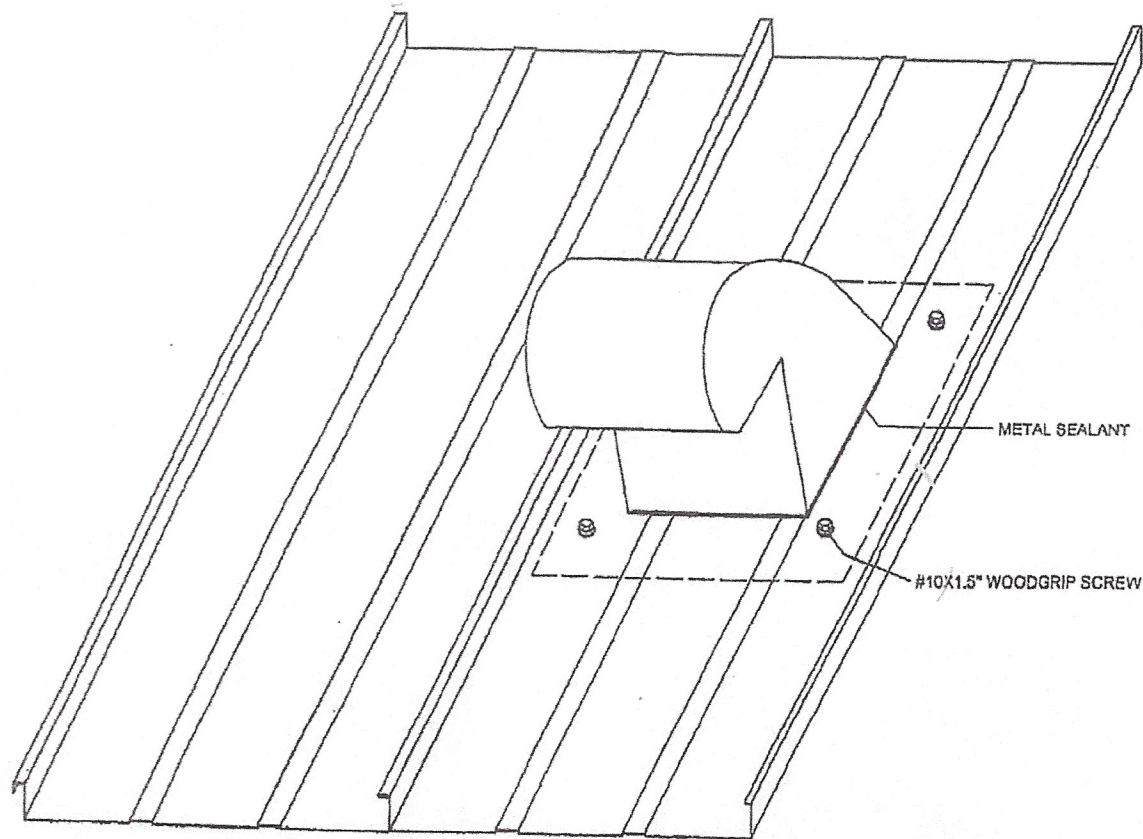

METAL SEALANT

#10X1.5" WOODGRIP SCREW

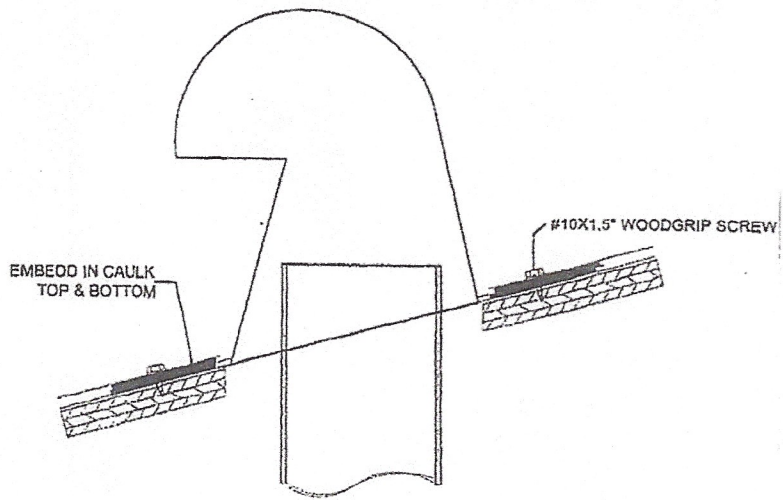


EMBED IN CAULK
TOP & BOTTOM

#10X1.5" WOODGRIP SCREW

 ENGLERT™ www.englertinc.com 800-364-5378	ROOF PENETRATION		DETAIL SUBJECT TO CHANGE WITHOUT NOTICE.
GENERIC BEST PRACTICE ASSEMBLY SHOWN. WATERTIGHTNESS WARRANTY NOT IMPLIED. WHEN SITE CONDITION DIFFERS, SPECIFIC ENGINEERING NECESSARY.	GOOSE NECK DETAIL		Detail # R26.

CCT 2012 © ENGLERT, INC.

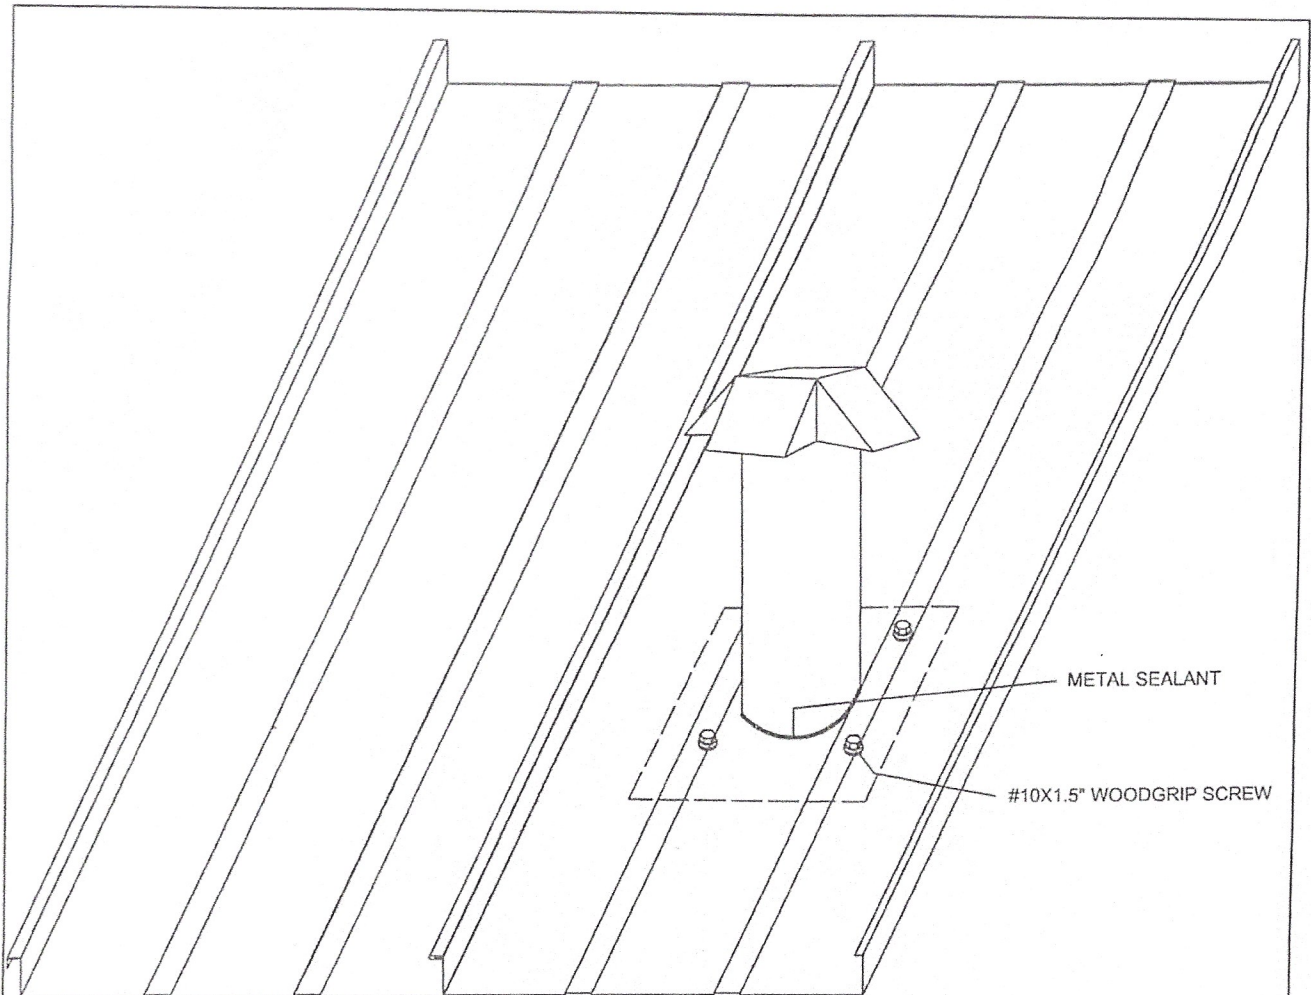


METAL SEALANT

#10X1.5" WOODGRIP SCREW

CAP ATTACHED WITH #10X1.5"
TRUEGRIP REMOVABLE SCREWS

EMBEDD IN CAULK
TOP & BOTTOM

#10X1.5" WOODGRIP SCREW

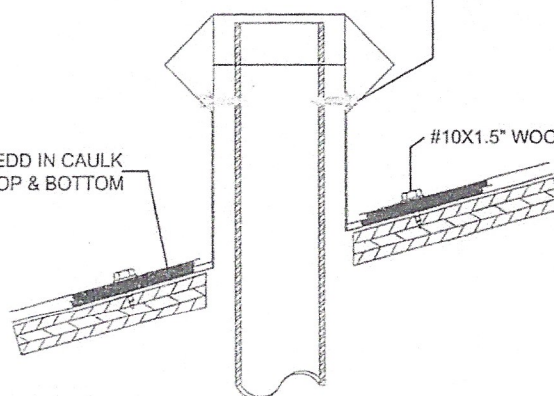

www.englertinc.com
800-364-5378

GENERIC BEST PRACTICE ASSEMBLY
SHOWN. WATER-TIGHTNESS
WARRANTY NOT IMPLIED.
WHEN SITE CONDITION DIFFERS,
SPECIFIC ENGINEERING NECESSARY.

ROOF PENETRATION ROOF JACK DETAIL

DETAIL SUBJECT TO CHANGE
WITHOUT NOTICE.

Detail #
R26.1

OCT 2012 © ENGLERT, INC.