

SHUT OFF VALVE

CHECK VALVE

3-0"

CW SUPPLY

VENTILATION LOUVER

UNION (TYP.)

RVD IF REQUIRED BY EQUIPMENT MANUFACTURER

MAINTAIN MIN. OF 3-0" OF COPPER PIPE AT BOTH SIZES CW SUPPLY @ HW SUPPLY

HW SUPPLY





SHUT OFF VALVE

GAS INLET

RHEEM MODEL:
V65e
I.G.W.H. # #2

GAS INSTANT WATER HEATER EXTERIOR MOUNTING

PROPANE (NO RECIRC. PUMP)

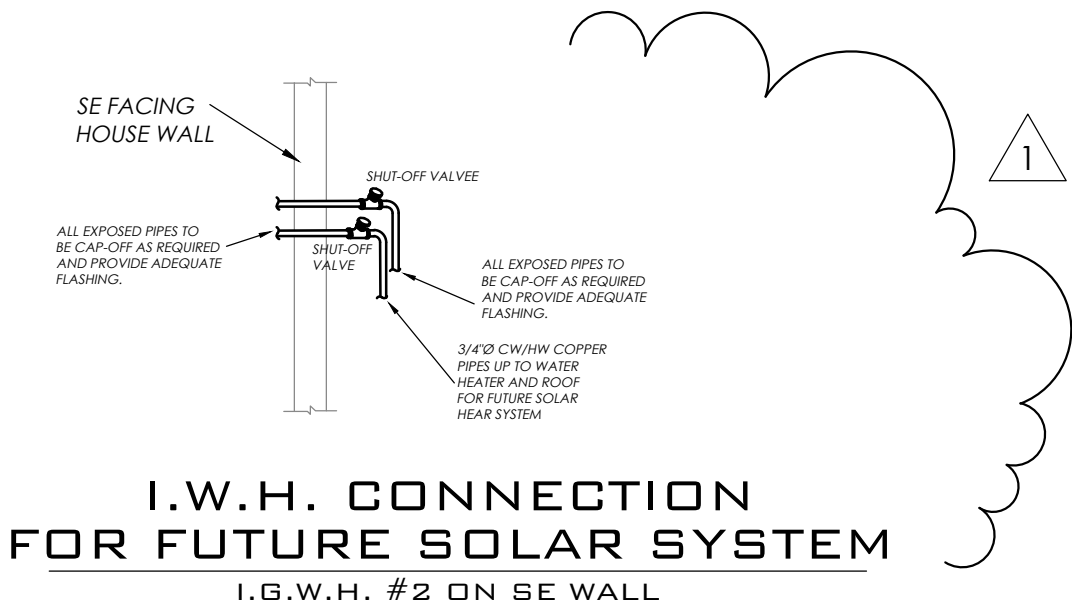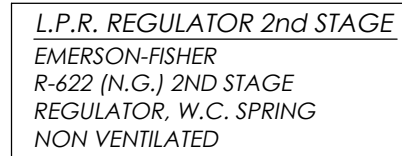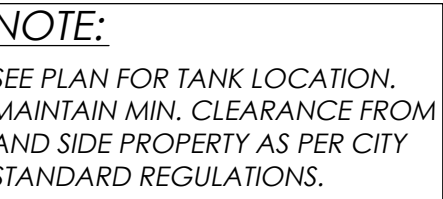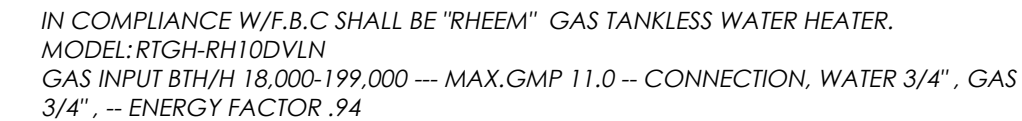

LONGEST RUN IN LINEAL FEET=220'
TOTAL MBTUH = 757

GAS RISER DIAGRAM

GAS PIPE NOTES:
ALL GAS PIPING SHALL COMPLY W/ FBC 2020 7TH EDITION
UNDILUTED PROPANE
TABLES USED:

**PROVIDE ELECTRICAL BONDING
COORDINATE W/ ELEC. CONTRACTOR**

CMBeng
Consulting • Design

CMB eng llc.
14850 SW 26 St. #215 • Miami, Florida 33187
O. 786.375.5348 • CMB@CMBeng.com

THIS ITEM HAS BEEN DIGITALLY SIGNED AND SEALED
BY EDMUNDO LARGAESPADA, P.E. ON THE DATE ADJACENT
TO THE SEAL. PRINTED COPIES OF THIS DOCUMENT ARE
NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE
MUST BE VERIFIED ON ANY ELECTRONIC COPIES.

L.C. NO. 35097
www.CMBeng.com
Edmundo Largaespada, P.E.
Professional Engineer
P.E. No. 0056915

Project No. : 23-0012