


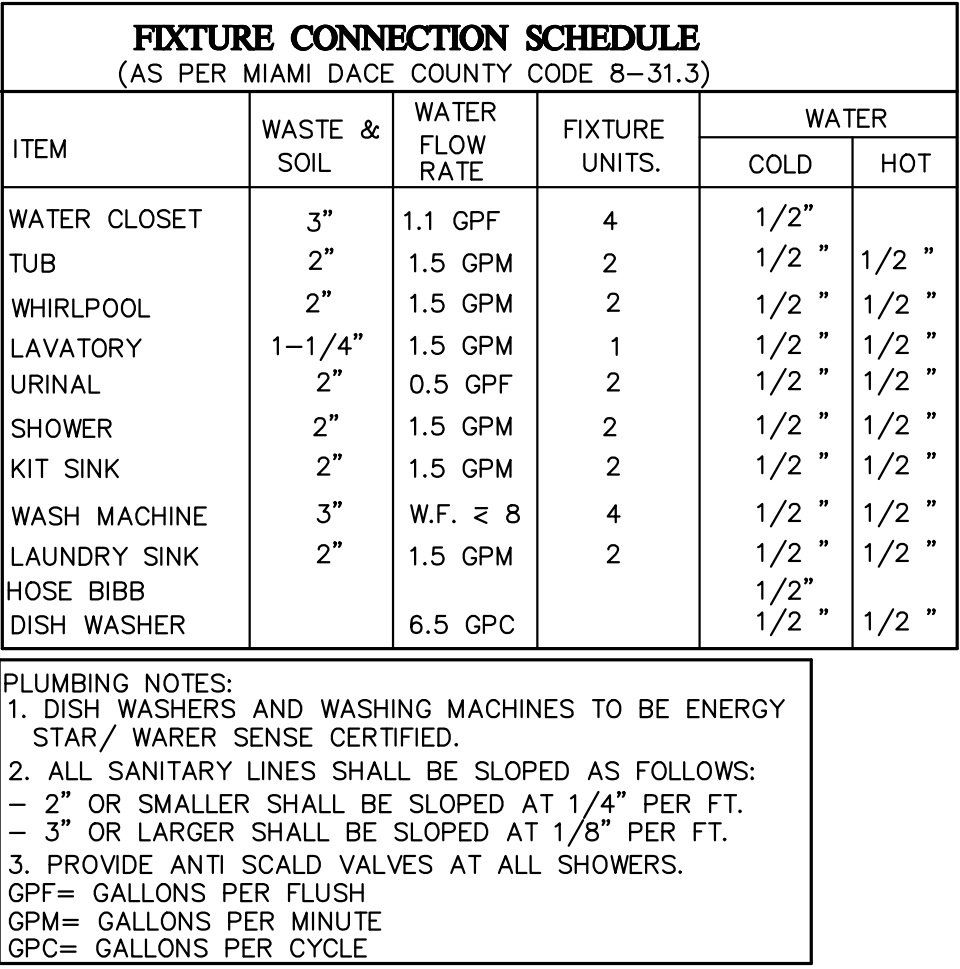

FIXTURE CONNECTION SCHEDULE						
(AS PER MIAMI DADE COUNTY CODE 8-31.3)						
ITEM	WASTE & SOIL	WATER FLOW RATE	FIXTURE UNITS.	WATER		
				COLD	HOT	
WATER CLOSET	3"	1.1 GPF	4	1/2"		
TUB	2"	1.5 GPM	2	1/2"	1/2"	
WHIRLPOOL	2"	1.5 GPM	2	1/2"	1/2"	
LAVATORY	1.5-1/4"	1.5 GPM	1	1/2"	1/2"	
SHOWER	2"	0.5 GPM	2	1/2"	1/2"	
URINAL	2"	1.5 GPM	2	1/2"	1/2"	
WASH SINK	2"	1.5 GPM	2	1/2"	1/2"	
WASH MACHINE	3"	W.F. $\leq$ 8	4	1/2"	1/2"	
LAUNDRY SINK	2"	1.5 GPM	2	1/2"	1/2"	
HOSE BIBB				1/2"		
DISH WASHER		6.5 GPC		1/2"	1/2"	

PLUMBING NOTES:

1. DISH WASHERS AND WASHING MACHINES TO BE ENERGY STAR/ WARE SENSE CERTIFIED.

2. ALL SANITARY LINES SHALL BE SLOPED AS FOLLOWS:

— 2" OR SMALLER SHALL BE SLOPED AT 1/4" PER FT.

— 3" OR LARGER SHALL BE SLOPED AT 1/8" PER FT.

3. PROVIDE ANTI SCALD VALVES AT ALL SHOWERS.

GPF= GALLONS PER FLUSH

GPM= GALLONS PER MINUTE

GPC= GALLONS PER CYCLE

REVISION BY


**MARK
REARDON^{R.A.}
architect**
UCL# A60017521
mark@reardonarchitect.com
phone: 786-355-6910

15790 SW 88TH AVE
MIAMI, FL 33157
AR 0017521
786-355-6910



NOTE: ALL DRAWINGS FOR THIS PROJECT ARE TO BE READ IN CONJUNCTION WITH EACH OTHER. THESE INCLUDE, BUT ARE NOT LIMITED TO: ARCHI- TECTURAL, SURVEYING, STRUCTURAL, CIVIL, MECHANICAL, ELECTRICAL, SPECIALTY DRAWINGS, & WRITTEN SPECIFICATIONS

THE G.C. IS TO VERIFY ALL EXISTING SITE CONDITIONS AND THOROUGHLY CHECK ELEVATIONS & DIMENSIONS BEFORE COMMENCING WORK. REPORT TO THE ARCHITECT OR ENGINEER ANY DISCREPANCIES, ERRORS OR CONDITIONS THAT WILL ALTER CONSTRUCTION AS INTENDED BY THESE DRAWINGS. ARCHITECT IS NOT RESPONSIBLE FOR ANY WORK AND/OR MATERIALS FURNISHED ON THE JOB.

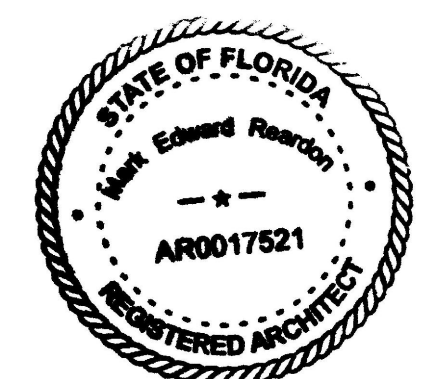

NEW HOUSE FOR:
5900 LLC
5900 SW 114 TER
PINECREST, FL

DRAWN BY:

DATE: 5/15/23

SCALE:
AS NOTED

SHEET NO.:

P-1

P-1