



Jax Apex Technology, Inc.
9000 Regency Square Boulevard, Suite 100
Jacksonville, FL 32211

Evaluation reports are the opinion of the engineer who prepared the report, based on the findings, and in no way constitute or imply approval by a local building authority. The engineer, in review of the data submitted, finds that, in his opinion, the product, material, system, or method of construction specifically identified in this report conforms with or is a suitable alternate to that specified in the Florida Building Code, **SUBJECT TO THE LIMITATIONS IN THIS REPORT**

Jeffrey P. Arneson, P.E., a licensed Florida professional engineer and employee of Jax Apex Technology, Inc. (Apex Technology) has reviewed the data submitted for compliance with the Florida Building Code. Neither Jeffrey P. Arneson, nor Apex Technology, are responsible for any errors or omissions to any documents, calculations, drawings, specifications, tests, or summaries prepared and submitted by the design professional or preparer of record who are listed in the Substantiating Data section of this report.

REPORT NO: SIM202001

CATEGORY: Structural Components

SUBCATEGORY: Wood Connectors

SUBMITTED BY:

SIMPSON STRONG-TIE COMPANY, INC.
5956 W. LAS POSITAS BOULEVARD
PLEASANTON, CA 94588

1. CERTIFICATION OF INDEPENDENCE:

Jeffrey P. Arneson, the Florida engineer who prepared this report, and Apex Technology have no financial interest in the manufacturing, sales, or distribution of the products included in this report. Jeffrey P. Arneson and Apex Technology comply with all criteria as stated in Florida Administrative Code Chapter 61G20-3.

2. PRODUCT NAMES:

Truss to Wall Connectors

MTSM16, MTSM20, HTSM16, HTSM20, HM9, HGAM10, H16, H16S, H16-2, H16-2S

Embedded Truss Anchors

META12, META16, META18, META20, META24, META40, HETA12, HETA16, HETA20, HETA24, HETA40, HHETA16, HHETA20, HHETA24, HHETA40, HETAL12, HETAL16, HETAL20, LTA2, DETAL20

Wood to Masonry Straps

MSTAM24, MSTAM36, MSTCM40, MSTCM60

Girder Tiedowns

LGT2, LGT3, LGT4, FGTR, FGTRHL, FGTRHR

3. SCOPE OF EVALUATION:

Load evaluation as a structural component using the requirements of the 7th Edition (2020) Florida Building Code, Building and 7th Edition (2020) Florida Building Code, Residential.

4. DESCRIPTION:

- 4.1 MTSM and HTSM Twist Straps.** The MTSM and HTSM twist straps are used to anchor wood trusses, rafters, or beams to masonry or concrete walls. They fasten to the wood member with 0.148"×3" or 0.148"×1½" nails, and fasten to masonry with ¼"×2¼" Titen Turbo™ or Titen® 2 screw anchors, or to concrete with ¼"×1¾" Titen Turbo or Titen 2 screw anchors. MTSM twist straps are manufactured from 16 gauge steel meeting ASTM A653 SS Grade 33 with a G90 galvanized finish. HTSM twist straps are manufactured from 14 gauge steel meeting ASTM A653 SS Grade 40 with a G90 galvanized finish. Twist strap fastener schedules, dimensions, and allowable loads are shown in Table 1. See Figures 1 and 2 for additional details.
- 4.2 HM9 Hurricane Tie.** The HM9 is used to anchor wood trusses, rafters, or joists to masonry or concrete. The HM9 fastens to the wood member with ¼"×1½" long Strong-Drive® SDS Heavy-Duty Connector screws and fastens to masonry with ¼"×2¼" Titen Turbo™ or Titen® 2 screw anchors, or to concrete with ¼"×1¾" Titen Turbo or Titen 2 screw anchors. The HM9 is manufactured from 18 gauge steel meeting ASTM A653 SS Grade 33 with a G90 galvanized finish. Hurricane tie fastener schedule, dimensions, and allowable loads are shown in Table 1. See Figures 1 and 2 for additional details.
- 4.3 HGAM10 Hurricane Gusset Angle.** The HGAM10 is used to anchor wood trusses, rafters, joists, or beams to masonry or concrete. The HGAM10 fastens to the wood member with ¼"×1½" long Strong-Drive® SDS Heavy-Duty Connector screws and fastens to masonry with ¼"×2¾" Titen Turbo™ or Titen® 2 screw anchors, or to concrete with ¼"×1¾" Titen Turbo or Titen 2 screw anchors. The HGAM10 is manufactured from 14 gauge steel meeting ASTM A653 SS Grade 33 with a G90 galvanized finish. Angle fastener schedule, dimensions, and allowable loads are shown in Table 1. See Figures 1 and 2 for additional details.
- 4.4 LTA2 Lateral Truss Anchor.** The LTA2 is used to anchor wood trusses, rafters, or beams to masonry or concrete. The LTA2 fastens to the wood member with 0.148"×1½" nails and has legs which are embedded into the wall system. The LTA2 is manufactured from 18 gauge steel meeting ASTM A653 SS Grade 40 with a G90 galvanized finish. Lateral truss anchor fastener schedule, dimensions, and allowable loads are shown in Table 1. See Figures 1 and 2 for additional details.
- 4.5 H16, H16S, H16-2, and H16-2S Hurricane Ties.** The H16, H16S, H16-2, and H16-2S are used to anchor wood trusses or rafters to masonry or concrete walls. These connectors wrap over the top of the rafter or truss. The straps are fastened to a masonry wall with ¼"×2¼" Titen Turbo™ or Titen® 2 screw anchors, or to concrete with ¼"×1¾" Titen Turbo or Titen 2 screw anchors. These connectors are manufactured from No. 18 gauge steel meeting ASTM A653 SS Grade 40 with a G90 galvanized finish. Allowable loads and fastener schedule are shown in Table 1. See Figures 1 and 2 for additional details.
- 4.6 META, HETA, HHETA, and HETAL Embedded Truss Anchors.** Embedded truss anchors are used to anchor a wood member (usually a truss) to masonry or concrete. Embedded truss anchors fasten to a single-ply wood truss with 0.148"×1½" nails or

to a multi-ply truss with 0.162"×3½" nails. META, HETA, and HHETA models can be installed in a single application or doubled to achieve additional capacity. They are embedded in the masonry or concrete to a depth indicated on the side of the anchor (4" for META, HETA, and HHETA, and 5½" for HETAL). The strap portion of the anchor is 1½" wide. The anchors are manufactured from steel meeting ASTM A653 SS Grade 50, Class 1, with a G90 galvanized finish, with the exception of the HETAL truss seat which is manufactured from steel meeting ASTM A653 SS Grade 33 with a G90 galvanized finish. Steel thickness is as specified in Table 2. Embedded truss anchor fastener schedule, dimensions, and allowable loads are shown in Table 2 for single installations and Table 3 for double installations. See Figures 3 and 4 for additional details of single and double embedded truss anchors.

4.7 DETAL20 Double Embedded Truss Anchor. The DETAL20 is a high capacity connector used to anchor single-ply wood trusses or rafters to masonry or concrete. The DETAL fastens to the wood member with 0.148"×1½" nails. It is embedded in the masonry or concrete to a depth of 4½". The strap portion of the anchor is 1½" wide and is manufactured from 16 gauge steel meeting ASTM A653 SS Grade 50, Class 1, with a G90 galvanized finish. The truss seat is manufactured from 18 gauge steel meeting ASTM A653 SS Grade 33 with a G90 galvanized finish. Embedded truss anchor fastener schedule, dimensions, and allowable loads are shown in Table 3. See Figure 4 for additional details.

4.8 MSTAM and MSTCM Strap Ties. The MSTAM and MSTCM strap ties are used to provide a tension connection between wood members and a masonry or concrete structure. The MSTAM straps are 1¼" wide for use on single 2× and thicker members. They fasten to the wood member with 0.148"×3" nails and fasten to masonry with ¼"×2¼" Titen Turbo™ or Titen® 2 screw anchors, or to concrete with ¼"×1¾" Titen Turbo or Titen 2 screw anchors. The MSTCM straps are 3" wide for use on double 2× or single 4× and larger members. They fasten to the wood member with 0.148"×3¼" nails and fasten to masonry with ¼"×2¼" Titen Turbo or Titen 2 screw anchors, or to concrete with ¼"×1¾" Titen Turbo or Titen 2 screw anchors. The MSTCM straps have countersunk nail slots for a lower nailing profile and coined edges for safer handling. MSTAM and MSTCM straps are manufactured from steel meeting ASTM A653 SS Grade 50, Class 1, with a G90 galvanized finish. Steel thickness is as specified in Table 4. Masonry strap fastener schedule, dimensions, and allowable loads are shown in Table 4. See Figure 5 for additional details.

4.9 FGTR, FGTRHL, and FGTRHR Face Mount Girder Tiedowns. The FGTR is a non-pitch specific girder tie down that can be used in new construction or retrofit applications to tie down a girder truss or beam to a concrete or masonry. The FGTR can be installed in a single application or doubled to achieve additional uplift capacity. The FGTR plate fastens to the wood member with Strong-Drive® SDS Heavy-Duty Connector screws and the strap fastens to masonry or concrete with ½"×5" Titen HD® Heavy-Duty Screw Anchors. The FGTRHL and FGTRHR are designed with the strap at a 45 degree angle for corner hip applications. The FGTR straps are manufactured from 7 gauge ASTM A1011 Grade 33 steel and the plates are made from 3 gauge ASTM A1011 Grade 33 steel. Both components have a powder coat painted finish. Girder tie down fastener schedule, dimensions, and allowable loads are shown in Table 5. See Figure 6 for additional details.

4.10 LGT2 Light Truss/Girder Tiedown. The LGT2 is used to anchor a 2-ply wood truss or beam (maximum 3" wide) to wood, concrete, or masonry. The LGT2 fastens to the wood truss or beam with 0.148"×3¼" nails or #9×1½" Strong-Drive® SD Connector screws. For wood wall applications, it is fastened with 0.148"×3¼" nails

or #9×1½" Strong-Drive SD Connector screws. For masonry or concrete applications, it fastens to masonry with ¼"×2¼" Titen Turbo™ or Titen® 2 screw anchors, or to concrete with ¼"×1¾" Titen Turbo or Titen 2 screw anchors. The LGT2 is manufactured from 14 gauge steel meeting ASTM A653 SS Grade 40 with a G90 galvanized finish. Allowable loads and fastener schedule are shown in Table 6. See Figure 7 for additional details.

4.11 LGT3-SDS2.5 Light Truss/Girder Tiedown. The LGT3-SDS2.5 is used to anchor a 3-ply wood truss or beam (maximum 5" wide) to wood, concrete, or masonry. The LGT3-SDS2.5 fastens to the wood truss or beam with ¼"×2½" long Strong-Drive® SDS Heavy-Duty Connector screws. For wood wall applications, it is fastened to wood studs and plates with 0.148"×3¼" nails. For masonry or concrete applications, it is fastened with ⅜"×5" Titen HD® Heavy-Duty Screw Anchors. The LGT3-SDS2.5 is manufactured from 12 gauge steel meeting ASTM A653 SS Grade 40 with a G90 galvanized finish. Allowable loads and fastener schedule are shown in Table 6. See Figure 7 for additional details.

4.12 LGT4-SDS3 Light Truss/Girder Tiedown. The LGT4-SDS3 is used to anchor a 4-ply wood truss or beam (maximum 6½" wide) to wood, concrete, or masonry. The LGT4-SDS3 fastens to the wood truss or beam with ¼"×3" long Strong-Drive® SDS Heavy-Duty Connector screws. For wood wall applications, it is fastened to wood studs and plates with 0.148"×3¼" nails. For masonry or concrete applications, it is fastened with ⅜"×5" Titen HD® Heavy-Duty Screw Anchors. The LGT4-SDS3 is manufactured from 12 gauge steel meeting ASTM A653 SS Grade 40 with a G90 galvanized finish. Allowable loads and fastener schedule are shown in Table 6. See Figure 7 for additional details.

5. MATERIALS:

5.1 Steel. Steel specifications for each product listed in this evaluation report shall be as indicated in the previous section. In addition to the standard G90 coating, some models (designated with a model number ending with Z) are available with a G185 zinc coating specification in accordance with ASTM A653. Some models (designated with a model number ending with HDG) are available with a hot-dip galvanization, also known as "batch" galvanization, in accordance with ASTM A123, with a minimum specified coating weight of 2.0 ounces of zinc per square foot of surface area, total for both sides. Some models (designated with a model number ending with SS) are available in Type 316L stainless material manufactured in accordance with ASTM A240 sheet, strip or plate and ASTM A480 (General Requirements) in the following designation: UNS designation S31603, AISI Type 316L. Model numbers in this report may not include the Z, HDG, or SS ending, but the information shown applies.

5.2 Wood. Wood members to which these connectors are fastened shall be solid sawn lumber, glued-laminated lumber, or structural composite lumber having dimensions consistent with the connector dimensions shown in Tables 1 through 6. Unless otherwise noted, lumber shall be Southern Pine (SP) or Douglas Fir-Larch (DF) having a minimum specific gravity of 0.55 or 0.50, respectively. Where indicated by SPF, lumber shall be Spruce-Pine-Fir having a minimum specific gravity of 0.42.

- 5.3 Concrete/Masonry.** Concrete and masonry design specifications shall be the stricter of the specifications by the engineer of record, the Florida Building Code minimum standards, the following, or as noted in the report:

Material	Specification	Minimum Compressive Strength
Concrete, f_c	-	2,500 psi
Masonry, f_m	ASTM C1314	1,500 psi
Masonry Unit	ASTM C90	2,000 psi
Mortar	ASTM C270 Type S	1,800 psi (or by proportions)
Grout	ASTM C476	2,000 psi (or by proportions)

- 5.4 Nails.** Unless noted otherwise, nails shall be common nails. Nails shall comply with ASTM F1667 and shall have the minimum bending yield strengths F_{yb} :

Nail Pennyweight	Nail Shank Diameter (inch)	Nail Length (inch)	F_{yb} (psi)
10d×1½	0.148	1½	90,000
10d Common	0.148	3	90,000
16d sinker	0.148	3¼	90,000
16d Common	0.162	3½	90,000

Fasteners for galvanized connectors in pressure-preservative treated wood shall be hot-dipped zinc coated galvanized steel with coating weights in accordance with ASTM A153 or steel mechanically galvanized in accordance with ASTM B695, Class 55. Fasteners for stainless steel connectors shall be stainless steel except where otherwise permitted by the treatment manufacturer.

The allowable loads of stainless-steel connectors match those of carbon-steel connectors when installed with Simpson Strong-Tie stainless-steel, SCNR ring-shank nails, unless noted otherwise.

- 5.5 Strong-Drive® SDS Heavy-Duty Connector Screws.** Fasteners used with the connectors described in Tables 1, 5, and 6, and shown in Figures 2, 6, 8, and 10 of the report must be Simpson Strong-Tie® Strong-Drive SDS Heavy-Duty Connector wood screws recognized in FL9589. Model numbers shown in this report may not include the full SDS model number after the connector model number (e.g., LGT3-SDS2.5), but the information shown applies. SDS screws used in contact with preservative-treated or fire-retardant-treated lumber must, as a minimum, comply with FL9589. The lumber treater or Simpson Strong-Tie Company should be contacted for recommendations on minimum corrosion resistance and connection capacities of fasteners used with the specific proprietary preservative-treated or fire retardant-treated lumber.
- 5.6 Strong-Drive® SD Connector Screws.** Certain connectors described in this report may be installed with Simpson Strong-Tie® Strong-Drive SD Connector wood screws recognized in FL9589. Installation shall be as specified in FL9589. The lumber treater or Simpson Strong-Tie Company should be contacted for recommendations on minimum corrosion resistance and connection capacities of fasteners used with the specific proprietary preservative-treated or fire retardant-treated lumber.
- 5.7 Titen Turbo™ and Titen® 2 Concrete and Masonry Screw Anchors.** Titen Turbo™ screw anchors shown in Tables 1, 4, and 6 and Figures 2, 5, and 7 are recognized in FL16230. Alternately, Titen® 2 screw anchors of the same diameter and length may be substituted for Titen Turbo models shown with no change to the

tabulated allowable loads. Titen 2 screw anchors are recognized in FL16230. Installation for both screw anchors shall be as specified in FL16230.

5.8 Titen HD® Heavy-Duty Screw Anchors. Anchors shown in Tables 5 and 6 and Figure 6 shall be Simpson Strong-Tie® Titen HD Heavy-Duty Screw Anchors for masonry or concrete as recognized in FL15730. Installation shall be as specified in FL15730.

6. INSTALLATION:

Installation shall be in accordance with this report and the most recent edition of the Simpson Strong-Tie *Wood Construction Connectors* catalog. Information in this report supersedes any conflicting information between information provided in this report and the catalog.

7. SUBSTANTIATING DATA:

Test data submitted by Testing Engineers Inc., Product Testing, Inc., and Simpson Strong-Tie, and signed and sealed calculations performed by Bryan Wert, P.E., in accordance with the 7th Edition (2020) *Florida Building Code, Building and Residential* codes.

Product	Test Lab	Test Number
MTSM, HTSM	Testing Engineers, Inc.	H756, I841, O555, O564
HM9	Product Testing, Inc.	02-3793
HGAM10	Product Testing, Inc.	L007, L018
	Testing Engineers, Inc.	H046, H141
H16, H16S, H16-2, H16-2S	Testing Engineers, Inc.	H591, I376
META, HETA, HHETA, HETAL	Product Testing, Inc.	K966, K997, L008, L011, L012, L013, L014, L015, L019, L020, L021, L022, L023, P670, Q219, Q220, Q221
	Testing Engineers, Inc.	D792, D793, D844, N218
DETAL	Testing Engineers, Inc.	O795, O796, O797, O798, O799
LTA2	Testing Engineers, Inc.	P966, P967, P968, Q018, Q019, Q020, Q856
MSTCM	Testing Engineers, Inc.	N471
FGTR	Product Testing, Inc.	K930, K931, K987
FGTRHL/R	Product Testing, Inc.	K932
LGT2	Simpson Strong-Tie	23-19086, 23-19111
	Testing Engineers, Inc.	I839, L921, L922
LGT3	Testing Engineers, Inc.	L233, L234, L431, L918
LGT4	Testing Engineers, Inc.	O113, O393, O394, O587

8. FINDINGS:

The connectors listed in this evaluation report comply with the 7th Edition (2020) *Florida Building Code, Building*, and 7th Edition (2020) *Florida Building Code, Residential* when installed in accordance with this report.

9. LIMITATIONS:

1. Maximum allowable loads shall not exceed the allowable loads listed in this report. Allowable loads listed in this report are based on allowable stress design. The loads in this report are not applicable to Load and Resistance Factor Design.
2. Capacity of wood members is not covered by this report. Capacity of wood members must be checked by the building designer.

3. Connectors in this report having a galvanized coating thickness less than G185 shall not be installed in contact with preservative-treated wood products that are exposed to rainfall or ground moisture.
4. Allowable loads for more than one direction for a single connection cannot be added together. A design load that can be divided into components in the directions given must be evaluated as follows:

$$(\text{Design Uplift} / \text{Allowable Uplift}) + (\text{Design Lateral Parallel to Plate} / \text{Allowable Lateral Parallel to Plate}) + (\text{Design Lateral Perpendicular to Plate} / \text{Allowable Lateral Perpendicular to Plate}) < 1.0$$

As an alternate, the embedded truss anchors in Tables 2 and 3 can be evaluated using the following: The design load in each direction shall not exceed the published allowable load in that direction multiplied by 0.75.

10. ALLOWABLE LOADS:

The tables that follow reference the allowable loads for the aforementioned products.

TABLE 1: MTSM, HTSM, HM9, HGAM10, H16, and LTA2 Dimensions, Fasteners, and Allowable Loads											
Model No.	Ga.	L (in.)	Fasteners			Allowable Loads (lb.)					
			Rafter / Truss	GFCMU (Titen Turbo™) ⁶	Concrete (Titen Turbo™) ⁶	DF/SP (160)			SPF/HF (160)		
						Uplift	F ₁	F ₂	Uplift	F ₁	F ₂
MTSM16	16	16	(7) 0.148"×1½"	(4) ¼"×2¼"	(4) ¼"×1¾"	830	120 ³	90 ³	715	120 ³	90 ³
MTSM20	16	20	(7) 0.148"×1½"	(4) ¼"×2¼"	(4) ¼"×1¾"	830			715		
HTSM16	14	16	(8) 0.148"×1½"	(4) ¼"×2¼"	(4) ¼"×1¾"	1,110			955		
HTSM20	14	20	(10) 0.148"×1½"	(4) ¼"×2¼"	(4) ¼"×1¾"	1,110			955		
HM9 ⁹	18	—	(4) ¼"×1½" SDS	(5) ¼"×2¼"	(5) ¼"×1¾"	760	670	190	760	670	190
HGAM10 ⁹	14	—	(4) ¼"×1½" SDS	(4) ¼"×2¾"	(4) ¼"×1¾"	810	875	1,105 ⁵	585	630	795 ⁵
H16 ¹⁰	18	18¾"	(2) 0.148"×1½"	(6) ¼"×2¼"	(6) ¼"×1¾"	1,370	—	—	1,180	—	—
H16S ¹⁰	18	11 ¹¹ / ₁₆ "	(2) 0.148"×1½"	(6) ¼"×2¼"	(6) ¼"×1¾"	1,370			1,180		
H16-2 ¹⁰	18	18¾"	(2) 0.148"×1½"	(6) ¼"×2¼"	(6) ¼"×1¾"	1,370			1,180		
H16-2S ¹⁰	18	11 ¹¹ / ₁₆ "	(2) 0.148"×1½"	(6) ¼"×2¼"	(6) ¼"×1¾"	1,370			1,180		
LTA2 Perp.-to-Wall Installation	18	—	(10) 0.148"×1½"	Embed	Embed	1,180 ⁷	415	875	990	415	735
LTA2 Parallel-to-Wall Installation	18	—	(10) 0.148"×1½"	Embed	Embed	1,180 ⁷	950	220	990	800	220

Notes:

1. Loads have been increased 60% for wind loading as permitted by the code. No further increase permitted. Reduce where other loads govern.
2. MTSM and HTSM do not have to be wrapped over the truss/rafter to achieve tabulated loads.
3. Lateral loads apply for the MTSM and HTSM twist straps when the first seven nail holes near the bend line are filled on the truss/rafter side. Any other fasteners required can be installed in any open hole.
4. Allowable loads for the HGAM10 are for one connector. A minimum truss/rafter thickness of 2½" must be used when framing anchors are installed on each side of the joist or truss.
5. HGAM10 F₂ loads are for forces into the connector. F₂ loads away from the connector are 640 lb. (DF/SP) and 460 lb. (SPF/HF).
6. Hex-head model required. Minimum edge distance for Titen Turbo™ screw anchor is 1½". Titen® 2 screw anchors of the same diameter and length may be substituted for the tabulated Titen Turbo screw anchor size with no change in allowable load.
7. LTA2 allowable uplift on SP is 1,350 lb. for perpendicular-to-wall installation and parallel-to-wall installation.
8. Minimum f_c = 2,500 psi. Minimum f_m = 1,500 psi.
9. The HM9KT and HGAM10KTA are kits with (20) HM9 and (10) HGAM10 connectors packaged with Simpson Strong-Tie® Strong-Drive® SDS Heavy-Duty Connector screws and 2¼" and 2¾" Titen® 2 screw anchors, respectively. (1¾" Titen 2 screw anchors for concrete installations sold separately)
10. H16 models are pre-sloped at a 5:12 pitch and can be used on pitches from 3:12 to 7:12. The minimum heel height for H16 models is 4" and the maximum heel height is 13½" (Use H16 or H16-2).

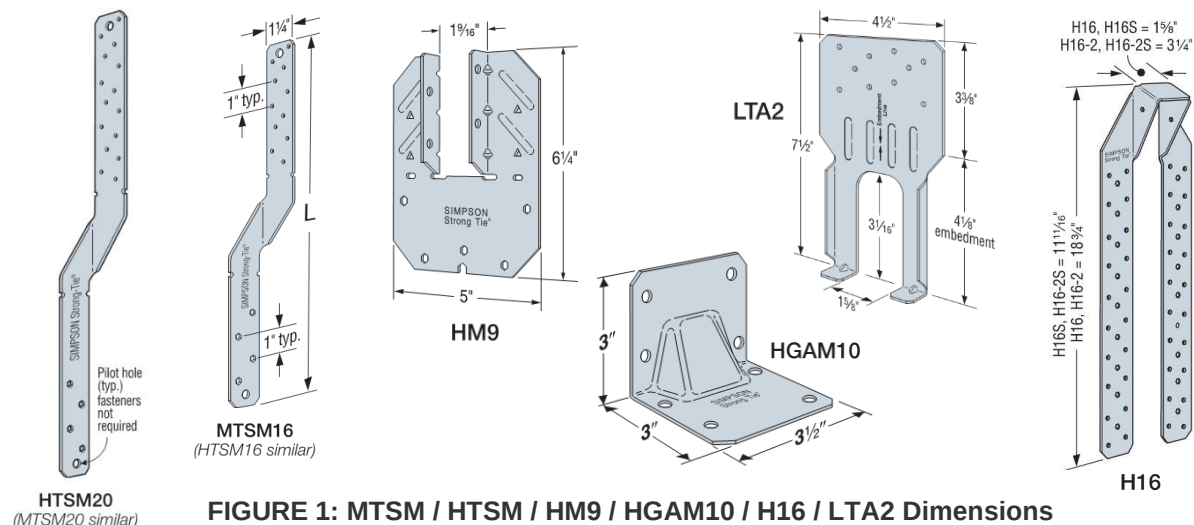


FIGURE 1: MTSM / HTSM / HM9 / HGAM10 / H16 / LTA2 Dimensions

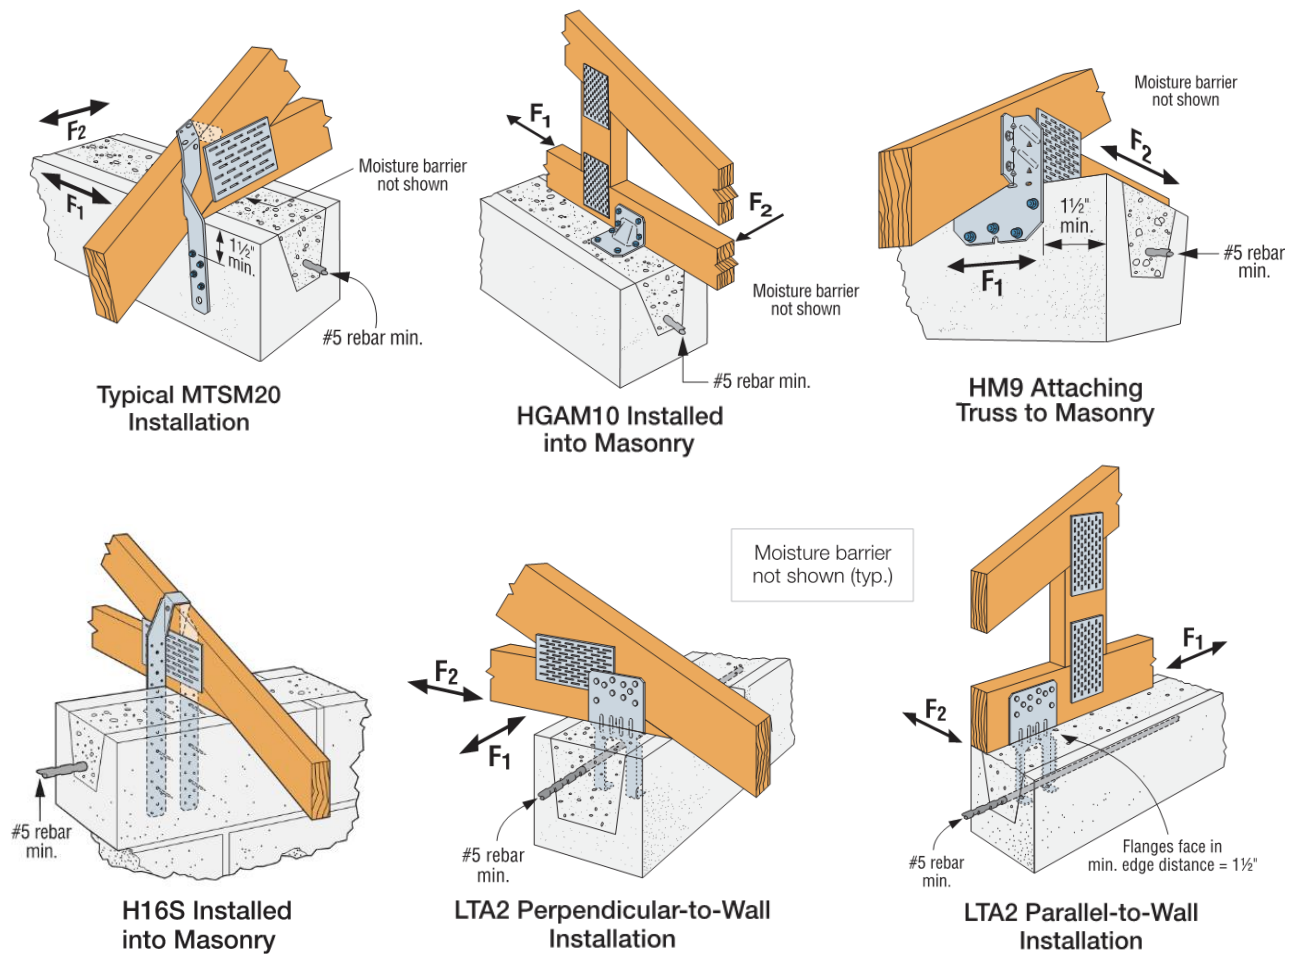


FIGURE 2: MTSM / HTSM / HM9 / HGAM10 / H16 / LTA2 Installation Details

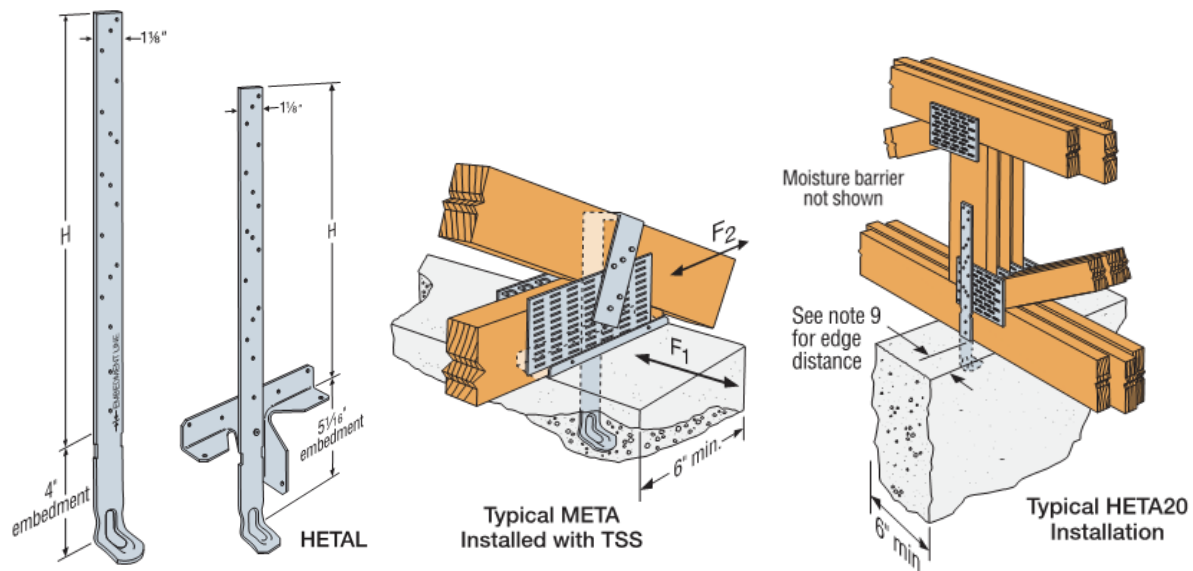


FIGURE 3: META / HETA / HHETA / HETAL Dimensions and Installation Details

TABLE 2: META, HETA, HHETA, and HETAL Dimensions, Fasteners, and Allowable Loads								
Model No.	Ga.	H (in.)	SP Allowable Loads (lb.)					
			1-ply Rafter / Truss (0.148"×1½" Nails)		2- or 3-ply Rafter / Truss (0.162"×3½" Nails)		F ₁ (160)	F ₂ (160)
			Qty. ²	Uplift (160)	Qty. ²	Uplift (160)		
META12	18	8	7	1,420	6	1,450	340	770
META16		12	8	1,450	6	1,450		
META18		14	8	1,450	6	1,450		
META20		16	7	1,420	5	1,210		
			8	1,450	6	1,450		
META24		20	8	1,450	6	1,450		
META40		36	8	1,450	6	1,450		
HETA12	16	8	7	1,455	7	1,730	340	770
HETA16		12	9	1,810	8	1,810		
HETA20		16	8	1,655	7	1,730		
			9	1,810	8	1,810		
HETA24		20	9	1,810	8	1,810		
HETA40		36	9	1,810	8	1,810		
HHETA16	14	12	10	2,120	9	2,120	340 ⁷	770
HHETA20		16	9	1,935	8	2,030		
			10	2,120	9	2,120		
HHETA24		20	10	2,120	9	2,120		
HHETA40		36	10	2,120	9	2,120		
HETAL12	16	7	10 ³	1,040	10 ³	1,235	390 ⁴	1,040
HETAL16		11	14 ³	1,810	13 ³	1,810		
HETAL20		15	14 ³	1,810	13 ³	1,810		

Notes:

1. Loads have been increased 60% for wind loading as permitted by the code. No further increase permitted. Reduce where other loads govern.
2. The META, HETA, and HHETA, require the lowest four nail holes be filled.
3. Five nails must be installed into the truss seat of the HETAL.
4. F₁ load towards face of HETAL is 1,870 lb.
5. Minimum f_c = 2,500 psi. Minimum f_m = 1,500 psi.
6. It is acceptable to use a reduced number of fasteners in any model listed provided that there is a reduction in uplift load capacity. The load per nail can be approximated by dividing the allowable load by the number of nails. There should be a minimum of 4 nails installed in the strap. Lateral loads do not apply when fewer than 7 fasteners are used with the HETA and HHETA anchors or less than (6) 0.162"×3½" or (7) 0.148"×1½" fasteners are used with the META anchor.
7. The HHETA allowable F₁ load can be increased to 435 lb. if the strap is wrapped over the truss and a minimum of 12 nails are installed.
8. Straps do not have to be wrapped over the truss/rafter to achieve tabulated loads unless specifically noted otherwise.
9. Minimum edge distance for META, HETA, and HHETA is 1½" for concrete and 2" for masonry.

TABLE 3: DETAL20 and Double META, HETA, and HHETA Fasteners and Allowable Loads										
Model No.	Qty.	Application	SP Allowable Loads (lb.)							
			1-ply Rafter / Truss				2- or 3-ply Rafter / Truss			
			0.148"x1½" Nail Qty. ⁴	Uplift	F ₁	F ₂	0.162"x3½" Nail Qty. ⁴	Uplift	F ₁	F ₂
DETAL20	1	GFCMU	18	2,480	2,000 ⁵	1,370	—	—	—	—
		Concrete	18	2,480	2,000	1,465	—	—	—	—
META	2	GFCMU	10	1,875	Refer to Table 2 ⁶		14	1,795	1,285 ⁷	1,080
		Concrete	10	1,875			14	2,435	1,285 ⁷	1,080
HETA	2	GFCMU	10	1,920			12	2,365	1,350 ⁷	1,430
		Concrete	10	1,920			12	2,560	1,350 ⁷	1,430
HHETA	2	GFCMU	10	1,920			12	2,365	1,350 ⁷	1,430
		Concrete	10	1,920			14	3,180	1,350 ⁷	1,430

Notes:

1. Loads have been increased 60% for wind loading as permitted by the code. No further increase permitted. Reduce where other loads govern.
2. Minimum $f'_c = 2,500$ psi. Minimum $f'_m = 1,500$ psi.
3. Install with spoons facing outward and spaced no more than $\frac{1}{8}$ " wider than the truss width.
4. The DETAL20 requires (6) 0.148"x1½" nails in the truss seat and (6) 0.148"x1½" nails into each strap. For all other models, install half of the required number of fasteners in each strap.
5. F₁ loads for the DETAL20 in GFCMU may cause an additional $\frac{1}{32}$ " deflection beyond the standard $\frac{1}{8}$ " limit.
6. Lateral loads for double META, HETA, and HHETA apply only to 2- or 3-ply applications with anchors spaced a minimum of 3" apart. For 1-ply applications, use lateral loads in Table 2. DETAL lateral loads apply to 1-ply application.
7. F₁ loads for double META, HETA, and HHETA may cause an additional $\frac{1}{16}$ " deflection beyond the standard $\frac{1}{8}$ " limit when the straps are installed not wrapped over the heel as shown.

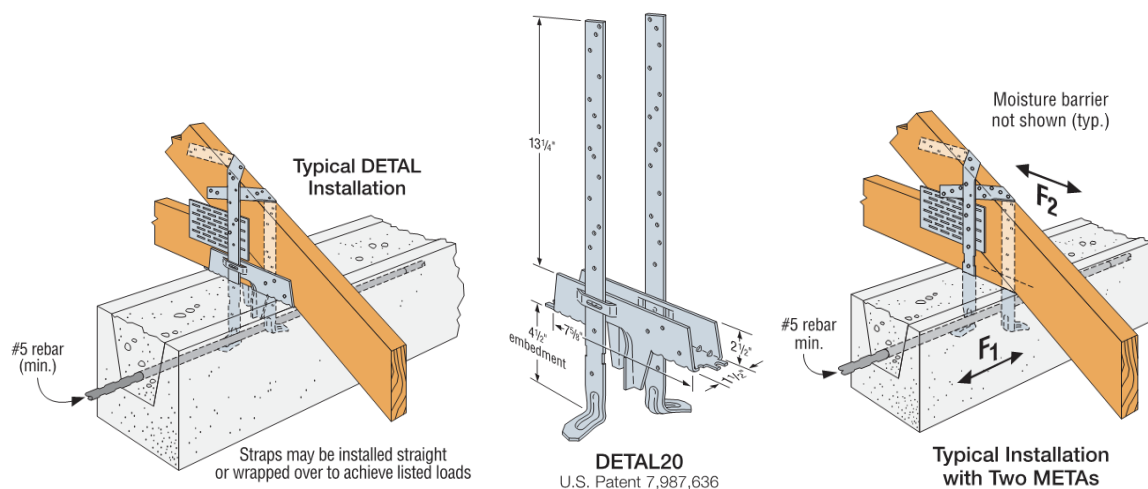


FIGURE 4: DETAL20 Dimensions and Double META / HETA / HHETA Installation Details

TABLE 4: MSTAM and MSTCM Dimensions, Fasteners, and Allowable Loads								
Model No.	Ga.	W (in.)	L (in.)	Fasteners			Allowable Tension / Uplift (lb.)	
				Rafter / Truss	GFCMU (Titen Turbo™) ³	Concrete (Titen Turbo™) ³	DF/SP/SPF/HF (160)	
							GFCMU	Concrete
MSTAM24	18	1¼	24	(9) 0.148"×3"	(5) ¼"×2¼"	(5) ¼"×1¾"	1,425	1,450
MSTAM36	16	1¼	36	(13) 0.148"×3"	(8) ¼"×2¼"	(8) ¼"×1¾"	1,870	1,870
MSTCM40	16	3	40¼	(26) 0.148"×3¼"	(14) ¼"×2¼"	(14) ¼"×1¾"	4,220	4,220
MSTCM60	16	3	59½	(26) 0.148"×3¼"	(14) ¼"×2¼"	(14) ¼"×1¾"	4,220	4,220

Notes:

1. Tension loads have been increased 60% for wind loading as permitted by the code. No further increase permitted. Reduce where other loads govern.
2. Minimum $f'_c = 2,500$ psi. Minimum $f'_m = 1,500$ psi.
3. Hex-head model required. Minimum edge distance for Titen Turbo™ screw anchor is 1½". Titen® 2 screw anchors of the same diameter and length may be substituted for the tabulated Titen Turbo screw anchor size with no change in allowable load.

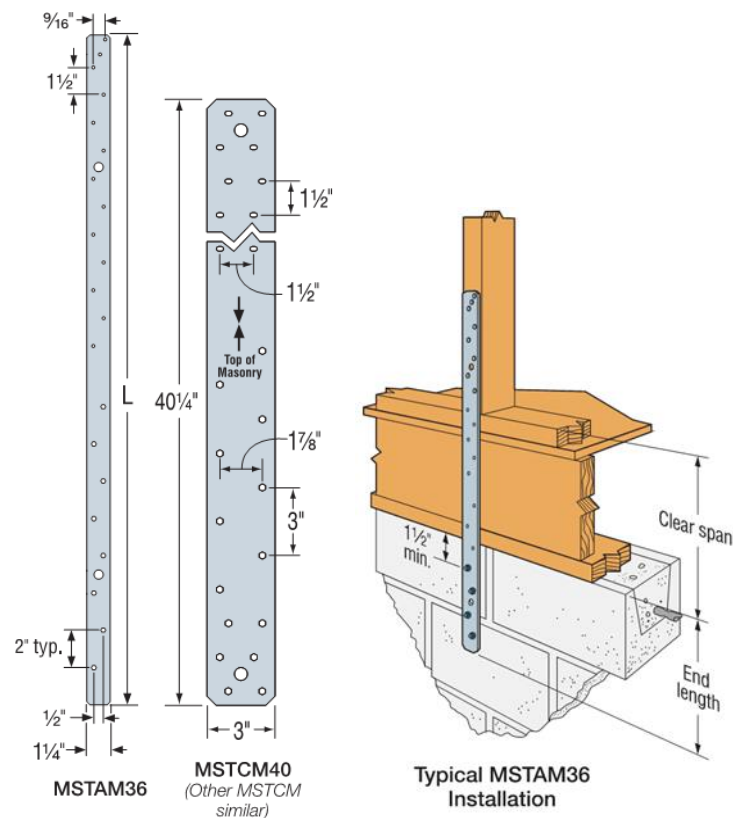


FIGURE 5: MSTAM / MSTCM Dimensions and Installation Details

TABLE 5: FGTR, FGTRHL, and FGTRHR Fasteners and Allowable Loads					
Model No.	Qty.	Fasteners		Allowable Uplift Load (lb.)	
		Rafter / Truss (Strong-Drive® SDS)	GFCMU / Concrete (Titen HD®)	DF/SP (160)	SPF/HF (160)
FGTR	1	(18) ¼"×3"	(2) ½"×5"	4,725 ⁶	3,400
	2	(36) ¼"×3"	(4) ½"×5"	8,885	6,395
FGTRHL/R	1	(18) ¼"×3"	(2) ½"×5"	3,635	2,615

Notes:

1. Uplift loads have been increased 60% for wind loading as permitted by the code. No further increase permitted. Reduce where other loads govern.
2. Products shall be attached to grouted and reinforced CMU walls or reinforced concrete walls that are designed to transfer the uplift loads to the foundation.
3. Minimum edge distance for the Titen HD anchor is 4".
4. Titen HD anchors should be spaced in every other hole on the part.
5. Attached members must be designed to resist the applied loads.
6. Uplift for FGTR corner installations shall be limited to 4,425 lb.
7. Minimum $f'_c = 2,500$ psi. Minimum $f'_m = 1,500$ psi.

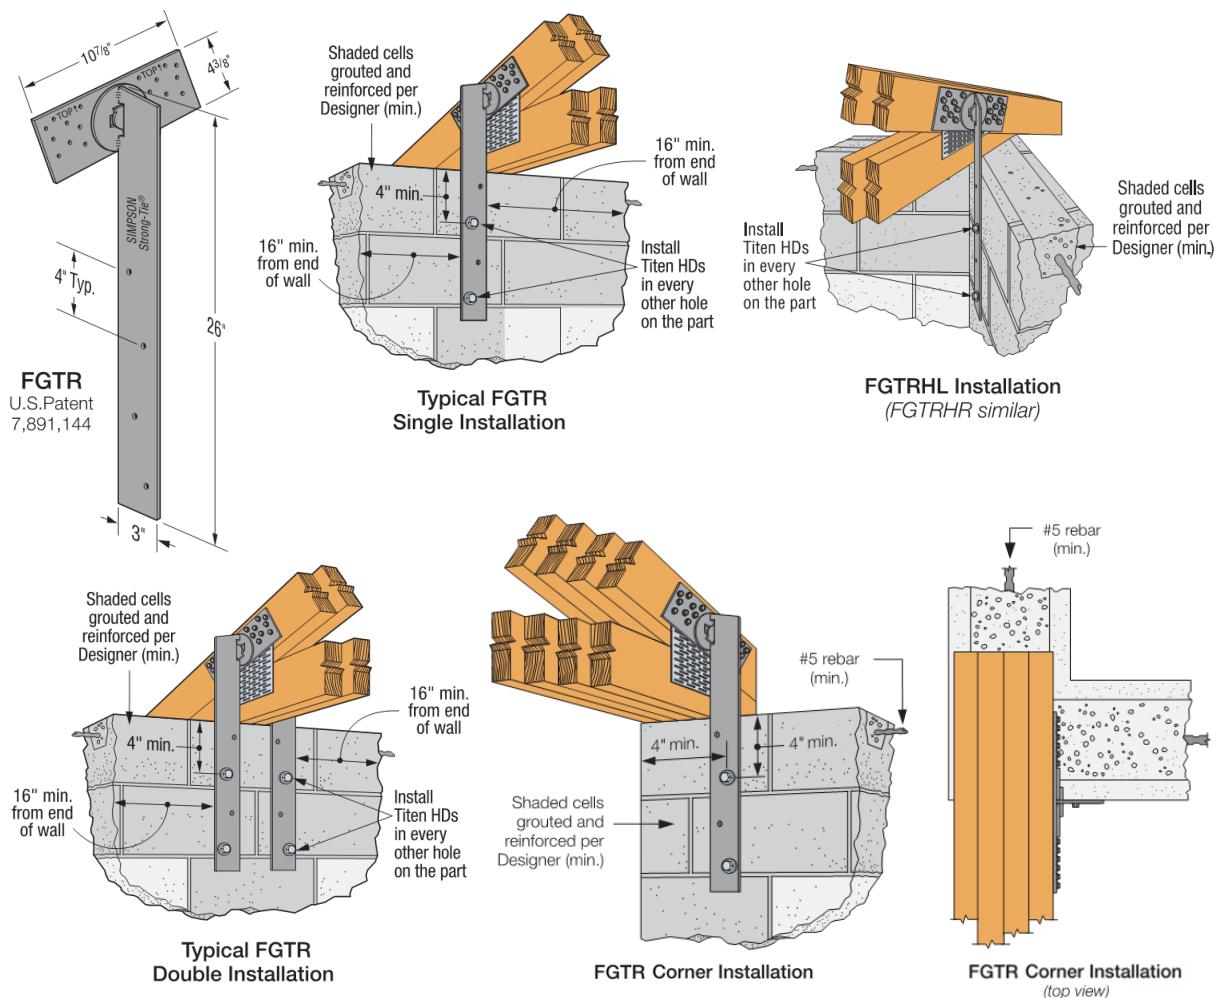


FIGURE 6: FGTR / FGTRHL / FGTRHR Dimensions and Installation Details

TABLE 6: LGT Fasteners and Allowable Loads										
Model No.	Qty.	No. of Plies	Applica- tion	Fasteners			Allowable Loads (lb.)			
				Rafter / Truss	Wood Studs / Framing	GFCMU / Concrete	Uplift (160)		Lateral (160)	
							DF/SP	SPF/HF	DF/SP/SPF/HF	
									F ₁	F ₂
LGT2	1	2	Wood	(16) 0.148"×3¼"	(14) 0.148"×3¼"	—	2,040	1,755	700 ³	170 ³
				(16) #9×1½" SD	(14) #9×1½" SD	—	2,465	2,125		
			GFCMU or Conc.	(16) 0.148"×3¼"	—	(7) ¼"×2¼" Titen Turbo ⁵	2,030	1,750		
LGT3-SDS2.5	1	3	Wood	(12) ¼"×2½" SDS	(21) 0.148"×3¼"	—	3,480	2,505	795	385
			GFCMU or Conc.	(12) ¼"×2½" SDS	—	(4) ⅜"×5" Titen HD	3,285	2,365		
LGT4-SDS3	1	4	Wood	(16) ¼"×3" SDS	(30) 0.148"×3¼"	—	4,060	2,920	2,000 ⁴	675 ⁴
			GFCMU or Conc.	(16) ¼"×3" SDS	—	(4) ⅜"×5" Titen HD	3,285	2,365		

Notes:

1. Loads have been increased 60% for wind loading as permitted by the code. No further increase permitted. Reduce where other loads govern.
2. Tabulated LGT2 uplift with SD screws is for DF lumber. LGT2 uplift using SD screws with SP lumber is 2,670 lb.
3. LGT2 lateral loads require installation of optional (4) 0.148"×3¼" in triangle fastener holes into top plates.
4. LGT4 lateral loads require installation of optional (7) 0.148"×3¼" in triangle fastener holes into top plates.
5. Hex-head model required. For concrete applications, use ¼"×1¾" Titen Turbo™. Minimum edge distance for Titen Turbo screw anchor is 1½". Titen® 2 screw anchors of the same diameter and length may be substituted for the tabulated Titen Turbo screw anchor size with no change in allowable load.
6. Minimum $f'_c = 2,500$ psi. Minimum $f'_m = 1,500$ psi.

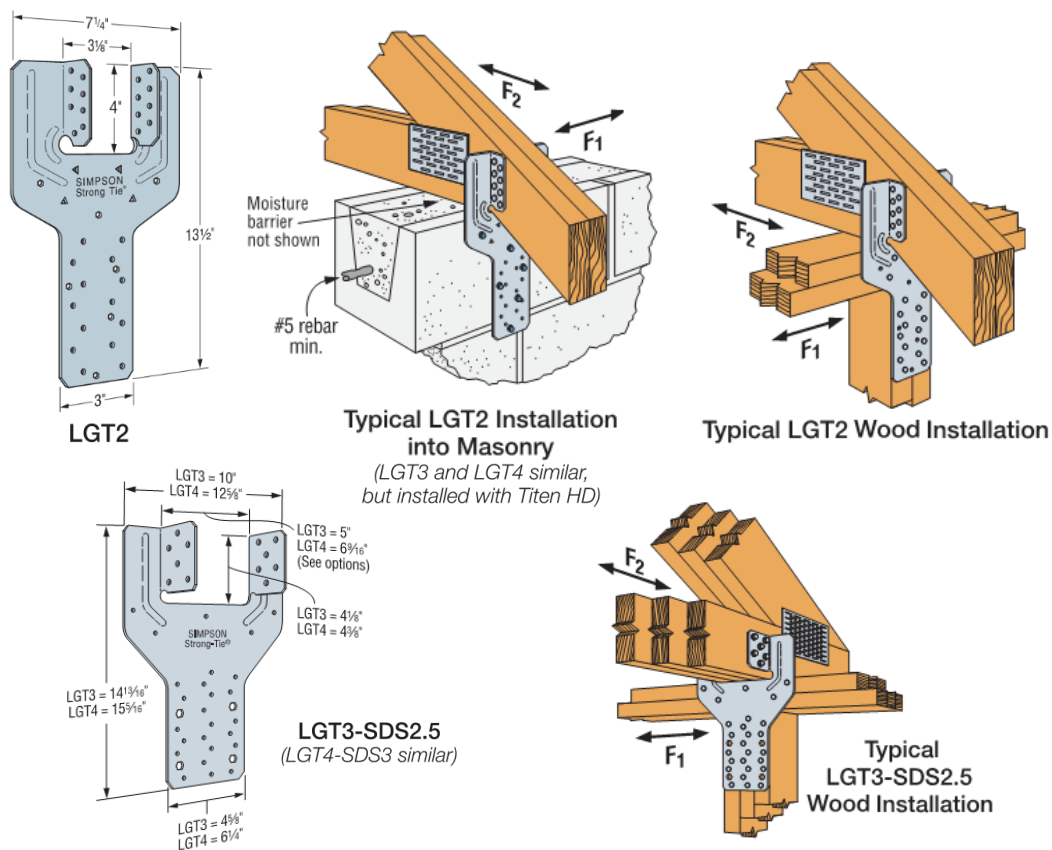


FIGURE 7: LGT2 / LGT3 / LGT4 Dimensions and Installation Details

11. REFERENCES:

Florida Building Code, Building 7th Edition (2020)

Section 104.11	Alternative materials, design, and methods of construction and equipment
Chapter 19	Concrete
Chapter 21	Masonry
Chapter 22	Steel
Chapter 23	Wood

Florida Building Code, Residential 7th Edition (2020)


R101.2.1	Scope
R4405	HVHZ Concrete
R4407	HVHZ Masonry
R4408	HVHZ Steel
R4409	HVHZ Wood

Standards

AISI S100	2016
ANSI/AWC NDS	2018
ASTM D7147	2011

12. IDENTIFICATION:

Each connector covered by this report shall be stamped with the manufacturer's name and/or trademark and the product name.



DocuSigned by:

A red ink signature of Jeffrey P. Arneson, written over a blue line.

079614DB26EB432...

Jax Apex Technology, Inc.
Jeffrey P. Arneson, P.E.
P.E. No. 58544
October 13, 2020