

PLUMBING GAS ISOMETRIC

12715 Rolling Road Drive
Pinecrest, FL 33156

AL


PREPARED BY: sy

CHECKED BY: NAC

SCALE: AS SHOWN

JOB NO.: 22-PRO-0028

SHEET NO.	REV
P-4	0

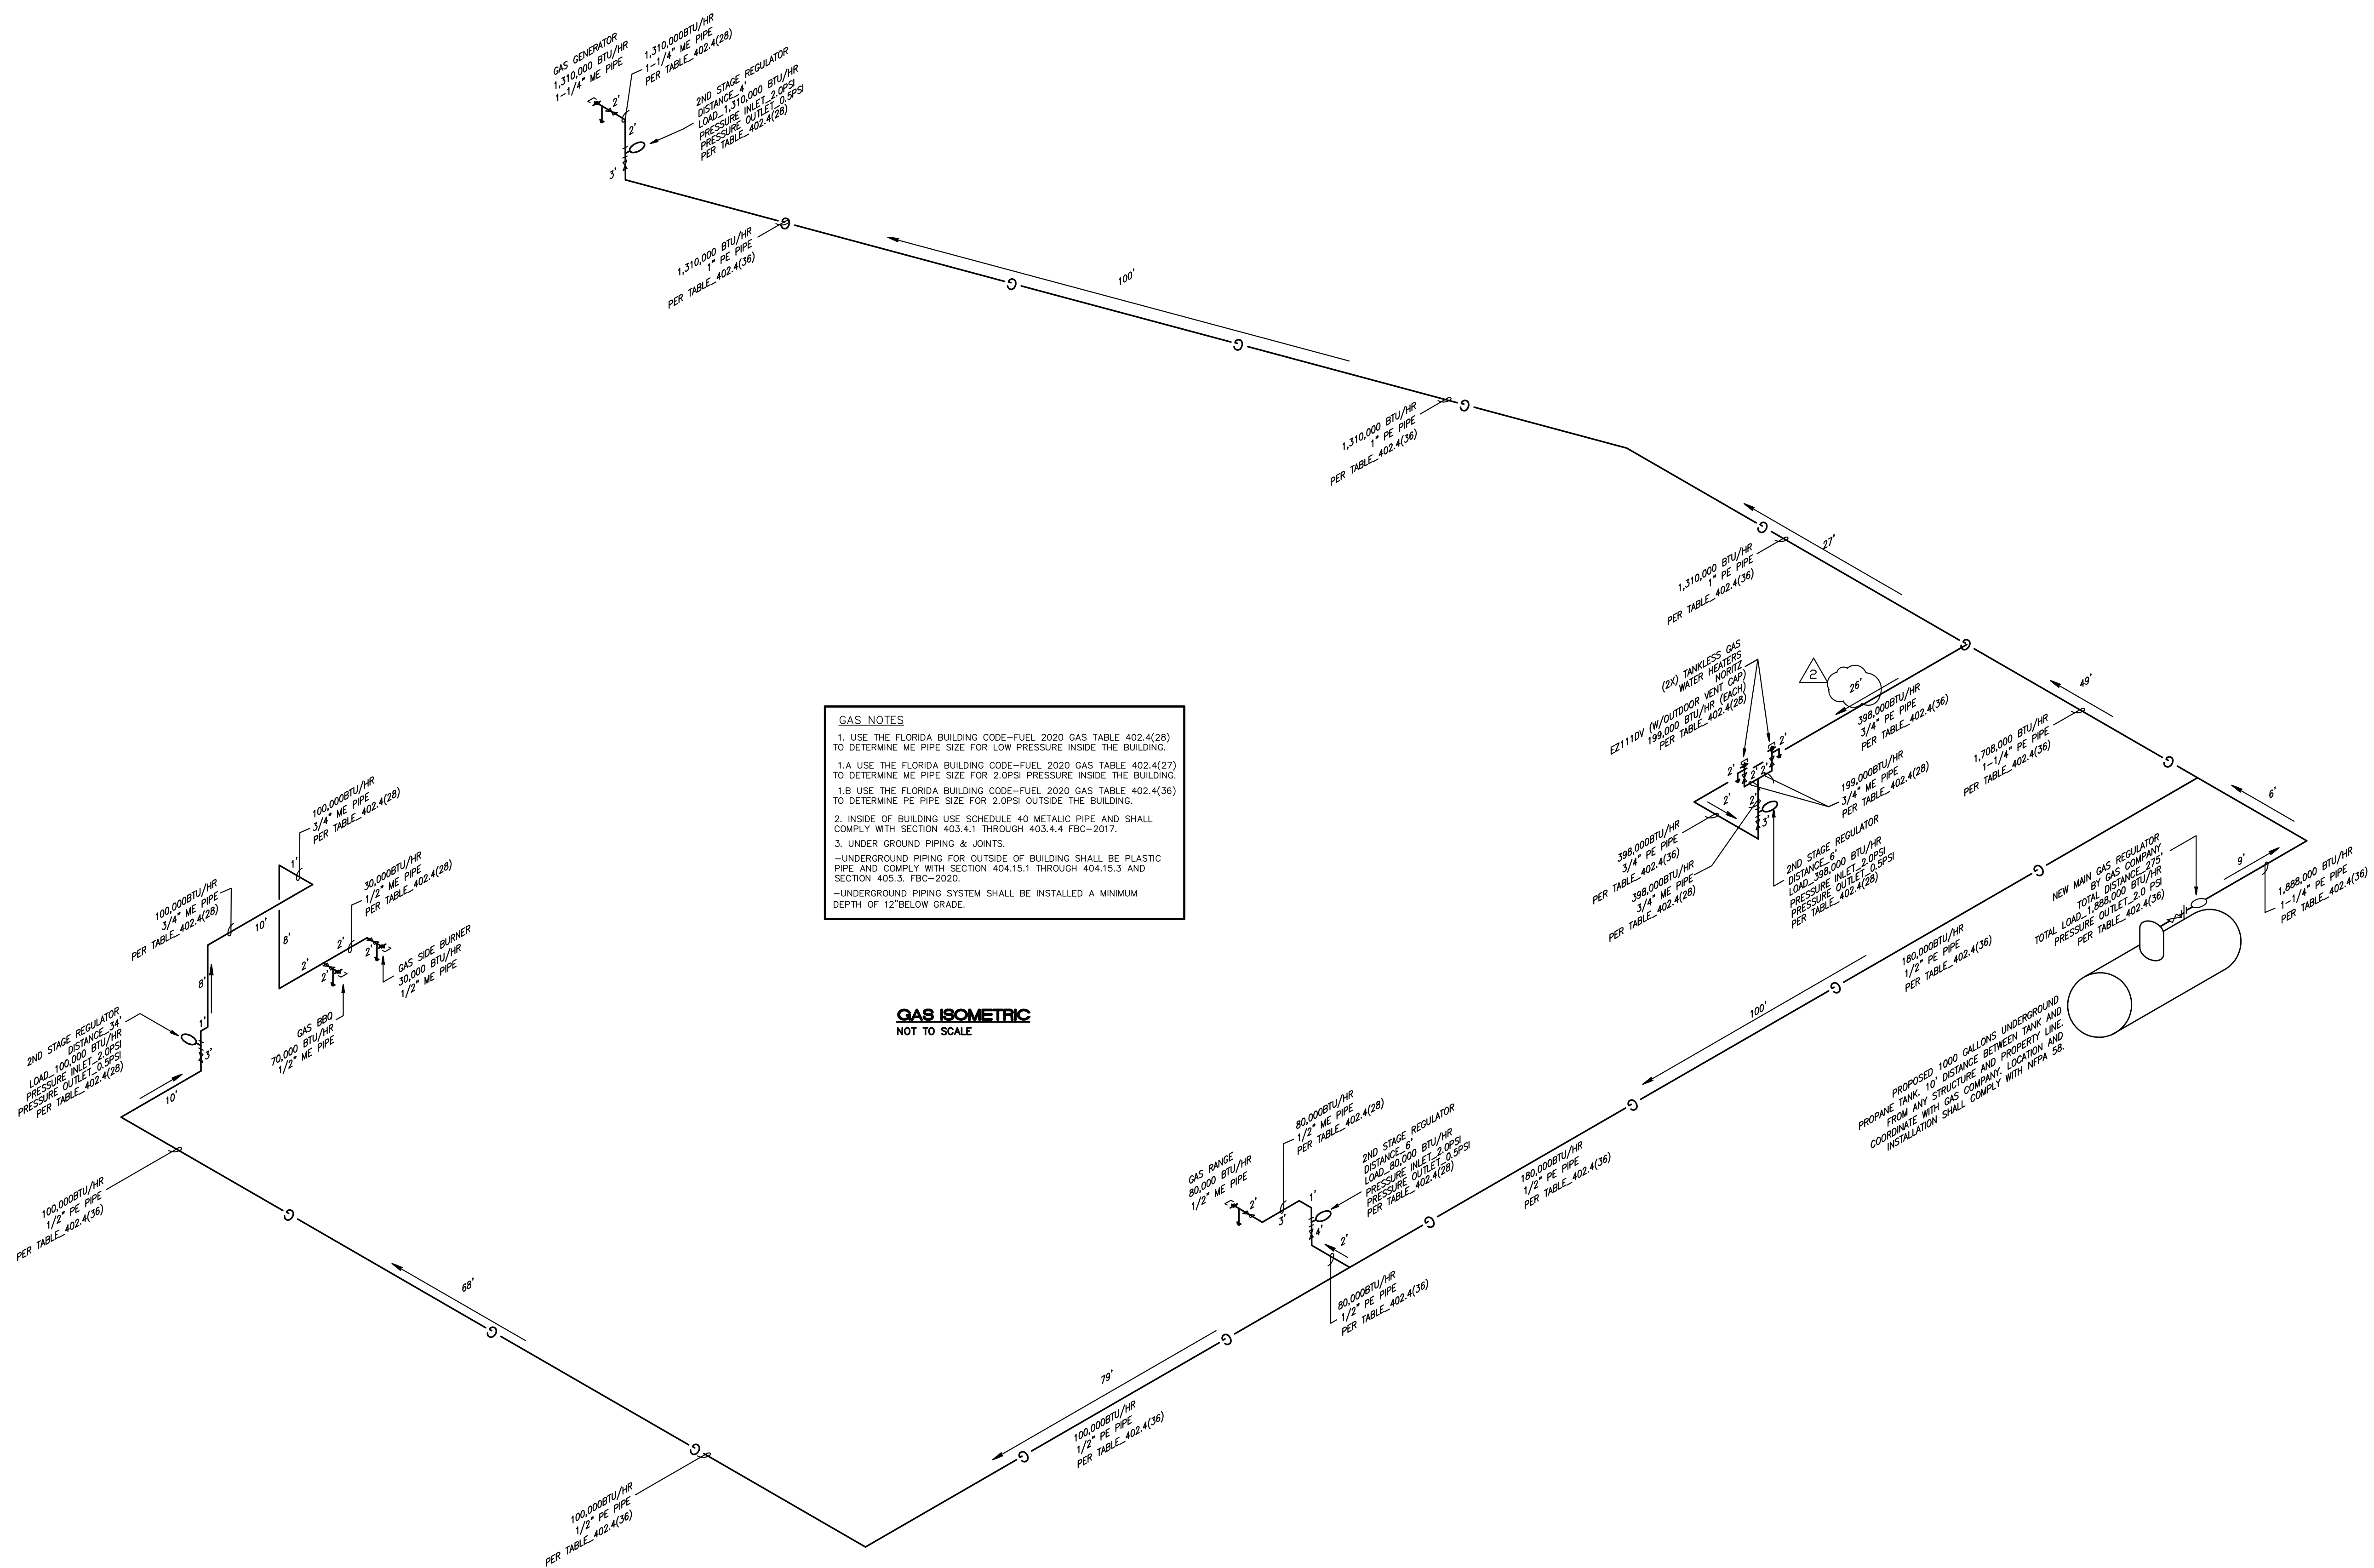

GAS ISOMETRIC
NOT TO SCALE

GAS NOTES

1. USE THE FLORIDA BUILDING CODE—FUEL 2020 GAS TABLE 402.4(28) TO DETERMINE ME PIPE SIZE FOR LOW PRESSURE INSIDE THE BUILDING.

1.A USE THE FLORIDA BUILDING CODE—FUEL 2020 GAS TABLE 402.4(27) TO DETERMINE ME PIPE SIZE FOR 2.0PSI PRESSURE INSIDE THE BUILDING.

1.B USE THE FLORIDA BUILDING CODE—FUEL 2020 GAS TABLE 402.4(36) TO DETERMINE PE PIPE SIZE FOR 2.0PSI OUTSIDE THE BUILDING.

2. INSIDE OF BUILDING USE SCHEDULE 40 METALIC PIPE AND SHALL COMPLY WITH SECTION 403.4.1 THROUGH 403.4.4 FBC—2017.

3. UNDER GROUND PIPING & JOINTS:

—UNDERGROUND PIPING FOR OUTSIDE OF BUILDING SHALL BE PLASTIC PIPE AND COMPLY WITH SECTION 404.15.1 THROUGH 404.15.3 AND SECTION 405.3. FBC—2020.

—UNDERGROUND PIPING SYSTEM SHALL BE INSTALLED A MINIMUM DEPTH OF 12" BELOW GRADE.



2020 Ponce de Leon, Suite 1002
Coral Gables, Florida 33134
Phone > 305 444 9809
Fax > 305 444 9827

Engineering Design:
 > Mechanical > Electrical
 > Plumbing > Fire Protection
www.arpe-eng.com

JOB # 22-1008
Amarilis Rodriguez, P.E.
License Number 60236
C.A. 26359

Signature _____
Date _____

PAPER SIZE: ARCH EXPAND E1 (30" X 42")