


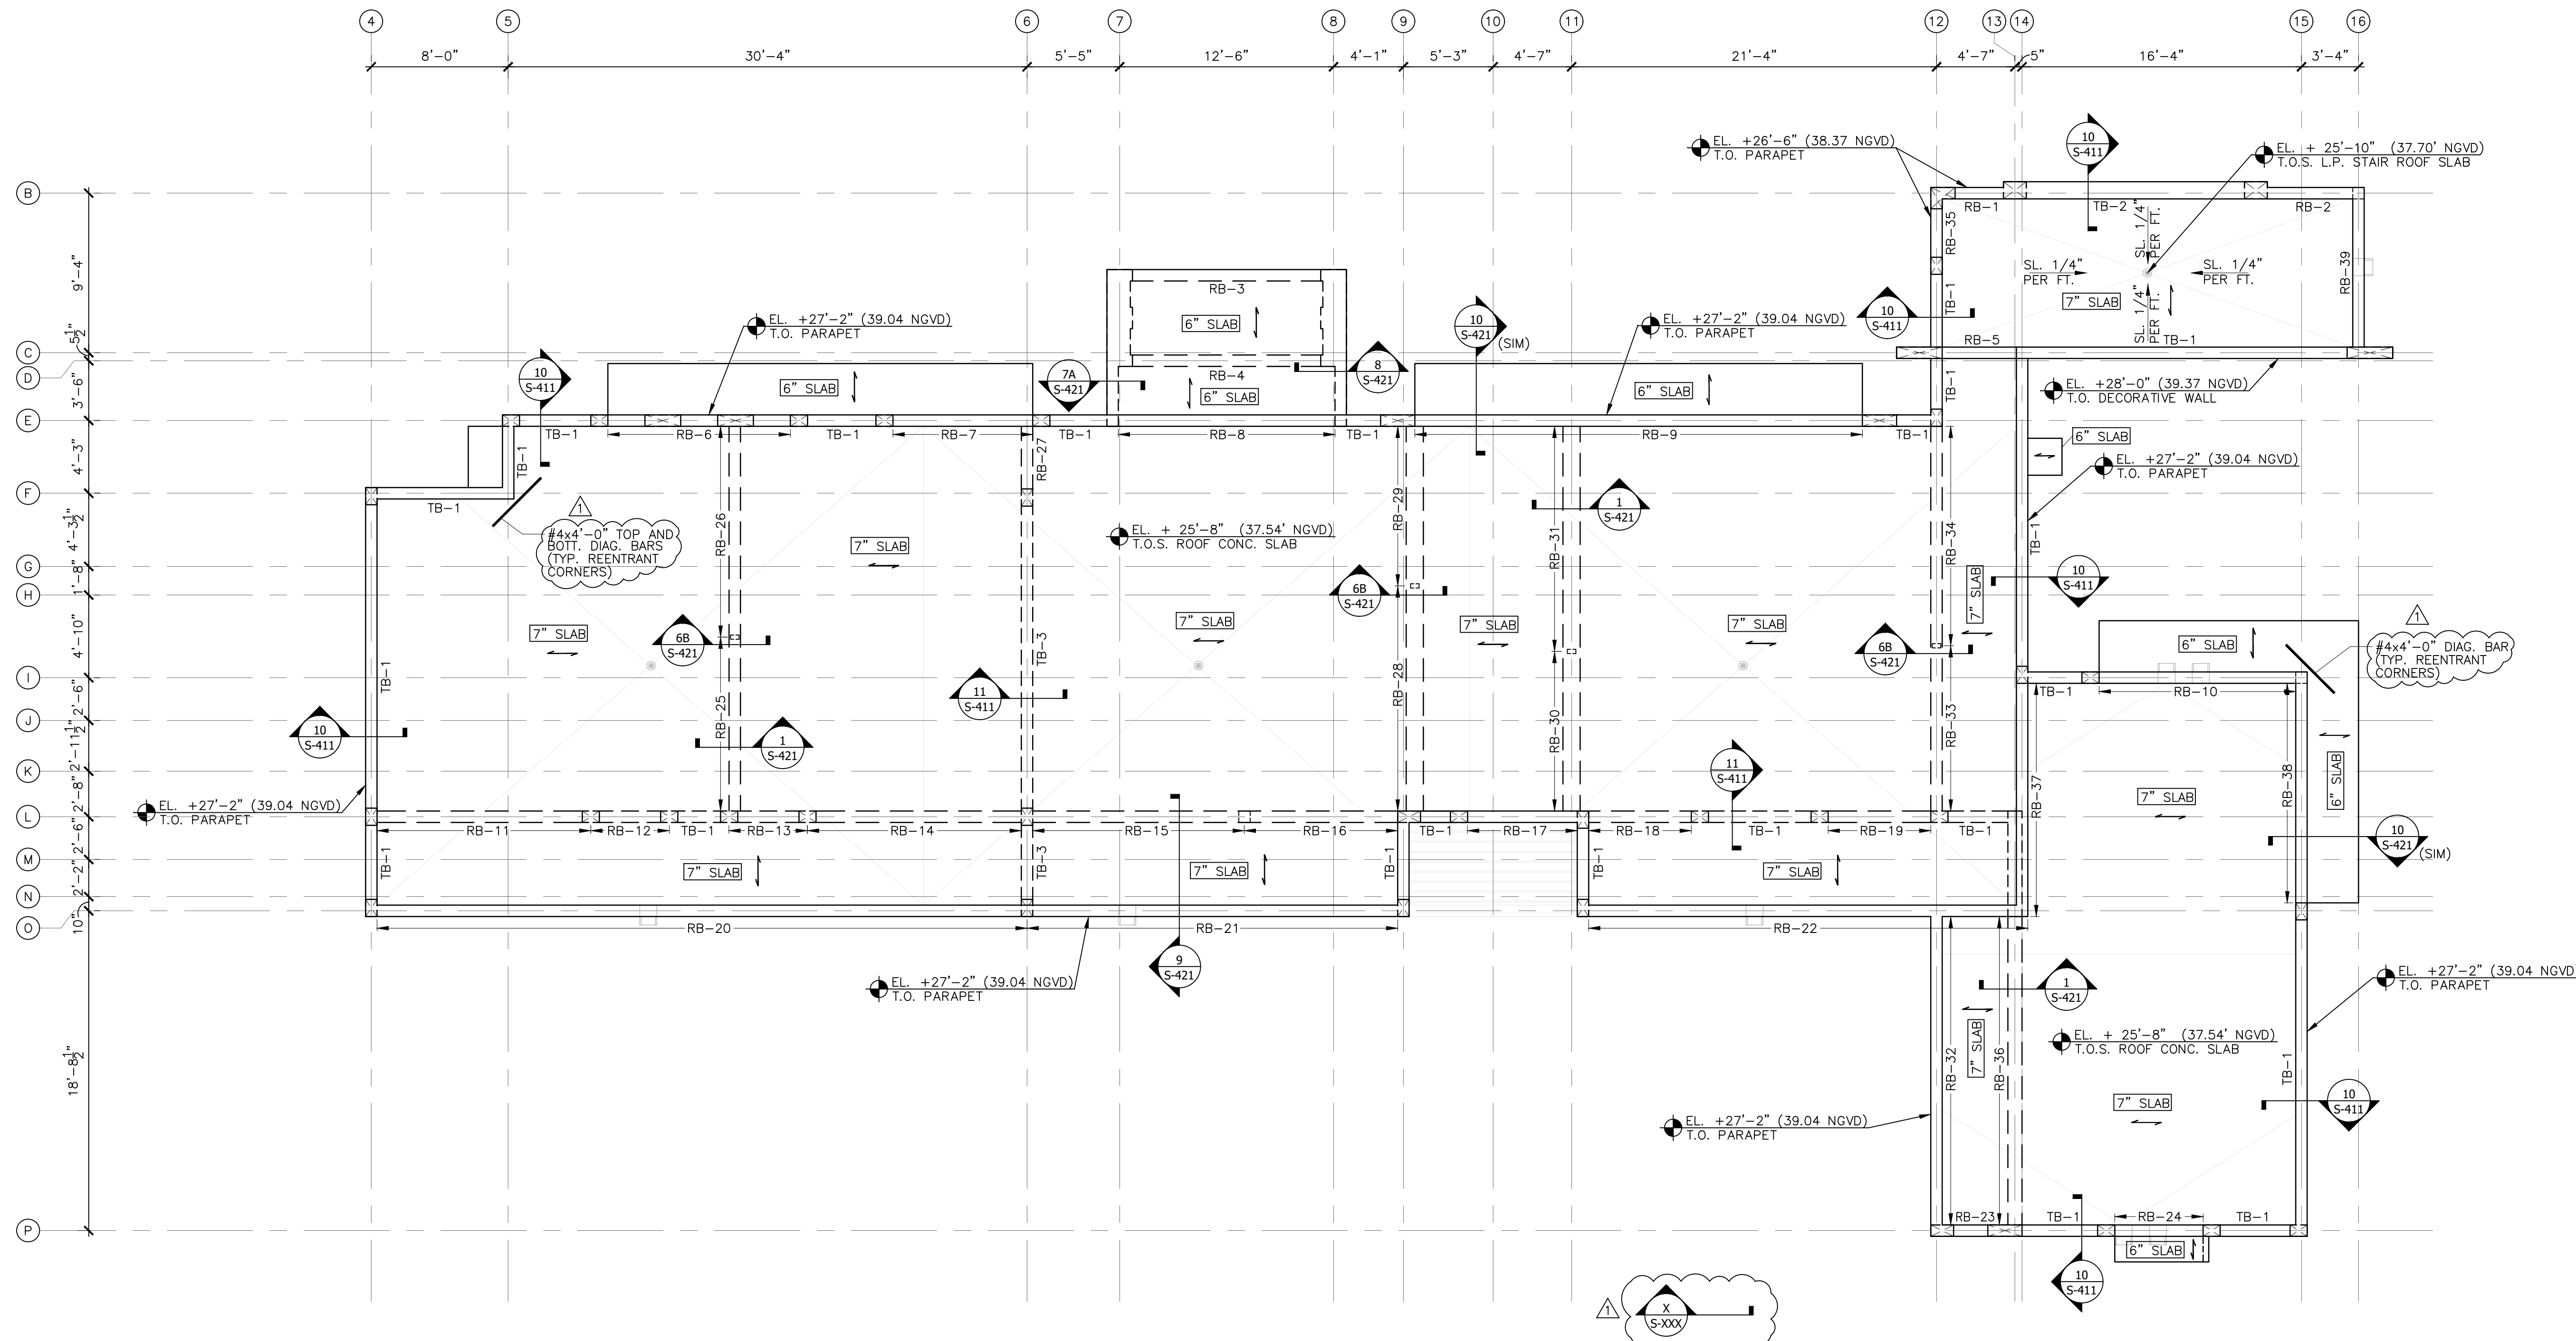


PLAN NOTES:

- ROOF LEVEL SLABS:
ROOF LEVEL SLABS SHALL BE 7" THICK C.I.P. CONCRETE SLABS REINF. WITH #4 @ 6" O.C. TOP & BOTT. (MAIN REINF.) AND #4 @ 6" O.C. TOP & BOTT. (TEMP. REINF.).

ENTRANCE ROOF AND OVERHANG SLABS SHALL BE 6" THICK (MIN) C.I.P. CONCRETE SLABS REINF. WITH #4 @ 6" O.C. TOP & BOTT. (MAIN REINF.) AND #4 @ 6" O.C. TOP & BOTT. (TEMP. REINF.).

DIRECTION OF SLAB MAIN REINFORCING IS SHOWN THUS (→) ON PLAN. TOP AND BOTTOM MAIN REINF. LAYERS SHALL BE PLACED ABOVE AND BELOW TOP AND BOTTOM TEMP. REINF. LAYERS RESPECTIVELY. TOP OF SLAB ELEVATIONS ARE SHOWN ON PLAN AND ARCH. DWGS.
- CONCRETE BEAMS AND TIE BEAMS:
BEAM AND TIE BEAM DESIGNATIONS ARE SHOWN ON PLAN. SEE BEAM SCHEDULE ON SHEET S-502 FOR MEMBER SIZES AND REINFORCING.
- MASONRY PARAPETS:
W6.5.32: 8" CMU WALL REINF. WITH #5 BARS AT 32" O.C. GROUTED IN CELLS.
- REFER TO ARCH. DRAWINGS FOR ADDITIONAL DIMENSIONS, GEOMETRY AND GENERAL BUILDING LAYOUT.
- COORDINATE ALL SLAB OPENINGS, SLAB DEPRESSIONS, SLAB SLOPES, ETC. WITH ARCH. AND MEP DWGS.

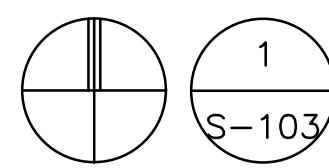

ROOF LEVEL FRAMING PLAN

SCALE: 3/16"=1'-0"