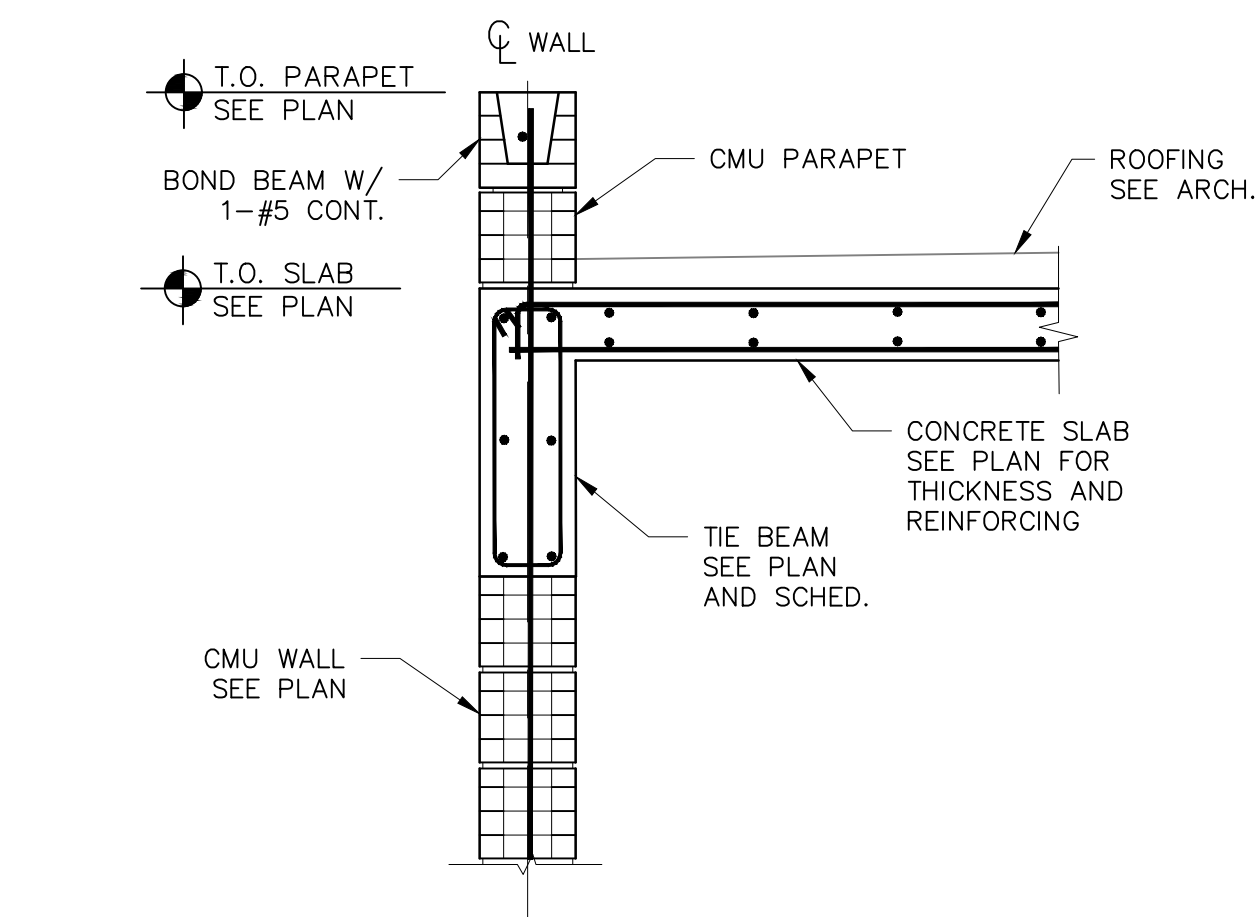
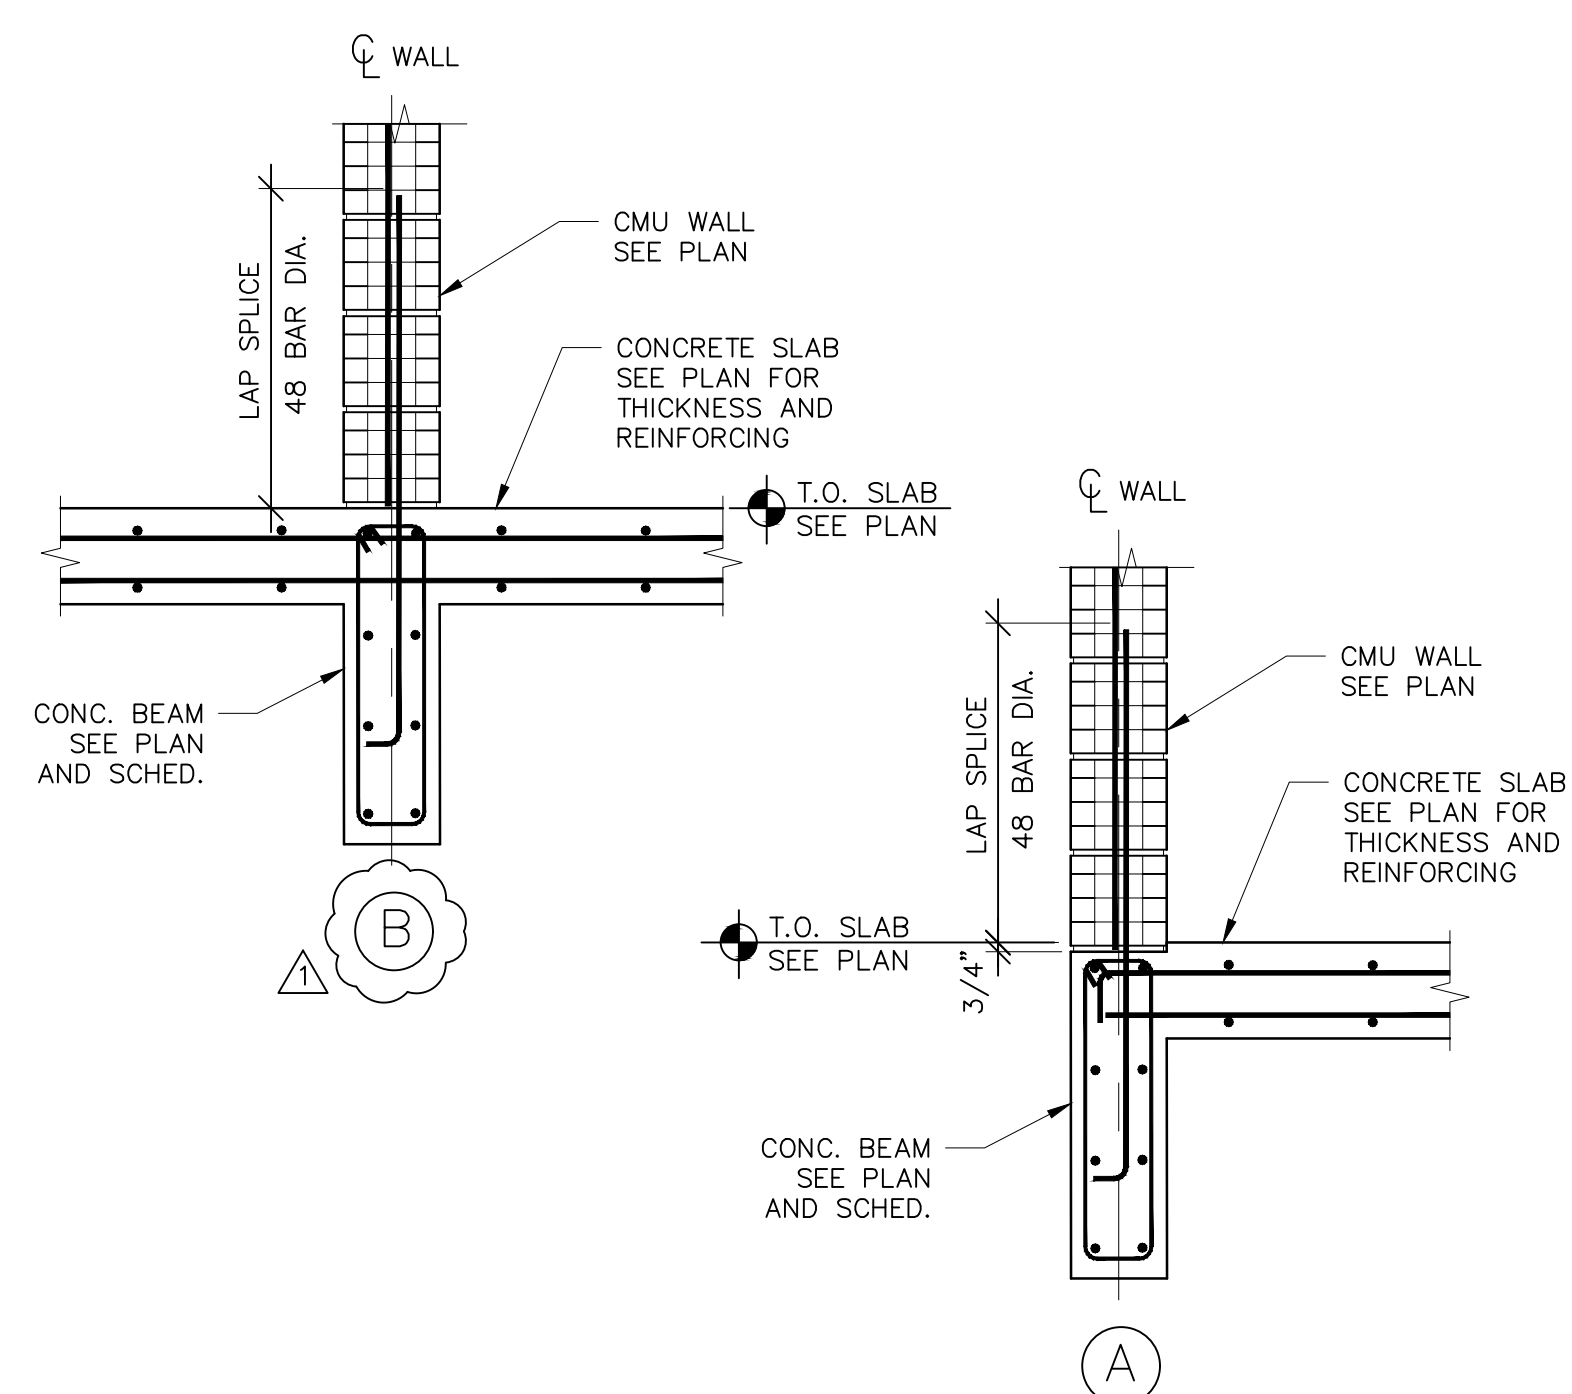
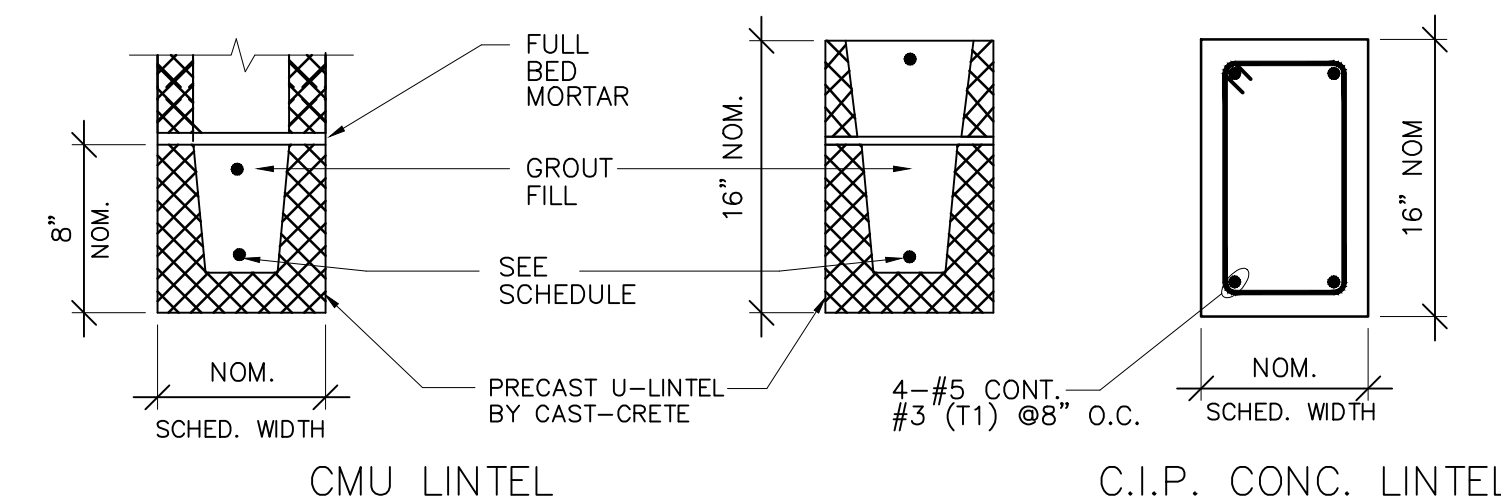


TYPICAL DETAIL
CONCRETE ROOF SLAB TO CMU WALL
CONNECTION

10

TYPICAL DETAIL
CMU WALL TO CONCRETE BEAM
CONNECTION

7



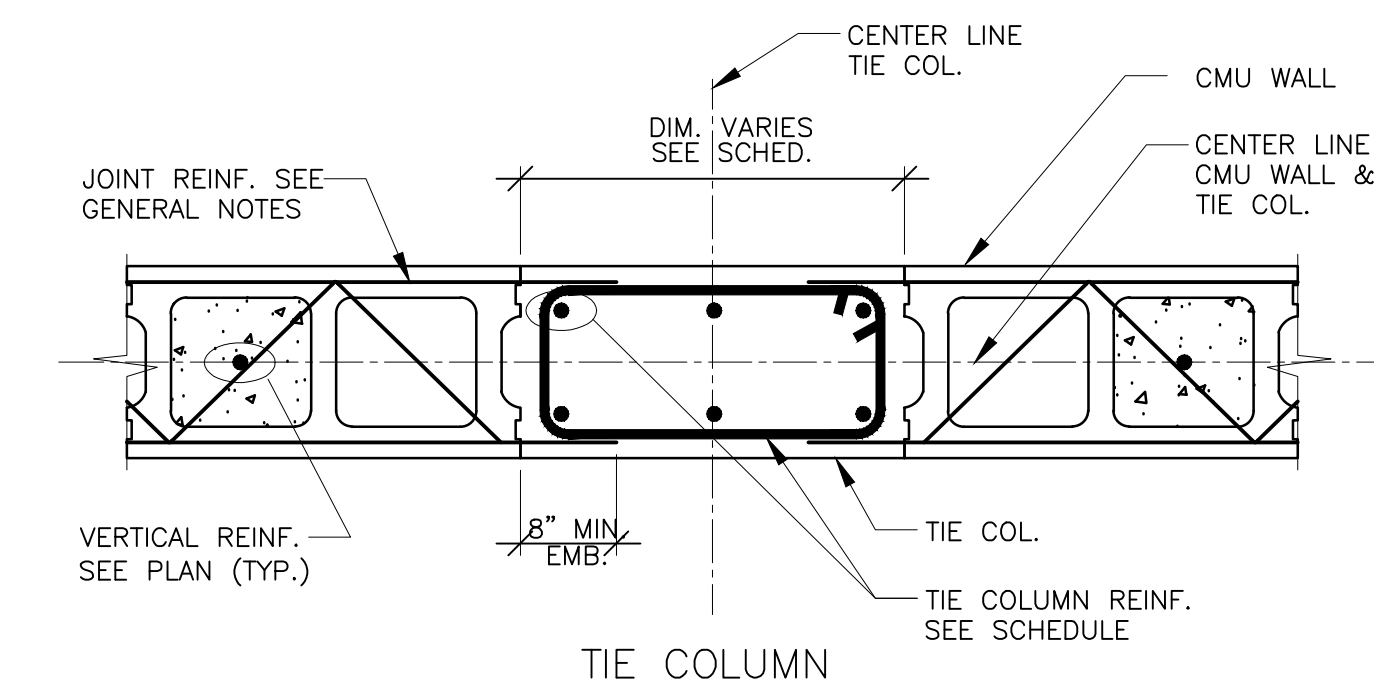
8" CMU LINTEL SCHEDULE

CLEAR SPAN	LINTEL SIZE	REIN. STEEL
3'-4"	8"x8"	1-#3
4'-0"	8"x8"	2-#3
4'-8"	8"x8"	2-#4
5'-4"	8"x8"	2-#4
6'-0"	8"x16"	4-#4
6'-8"	8"x16"	4-#4
7'-4"	8"x16"	4-#4
8'-0"	8"x16"	4-#4

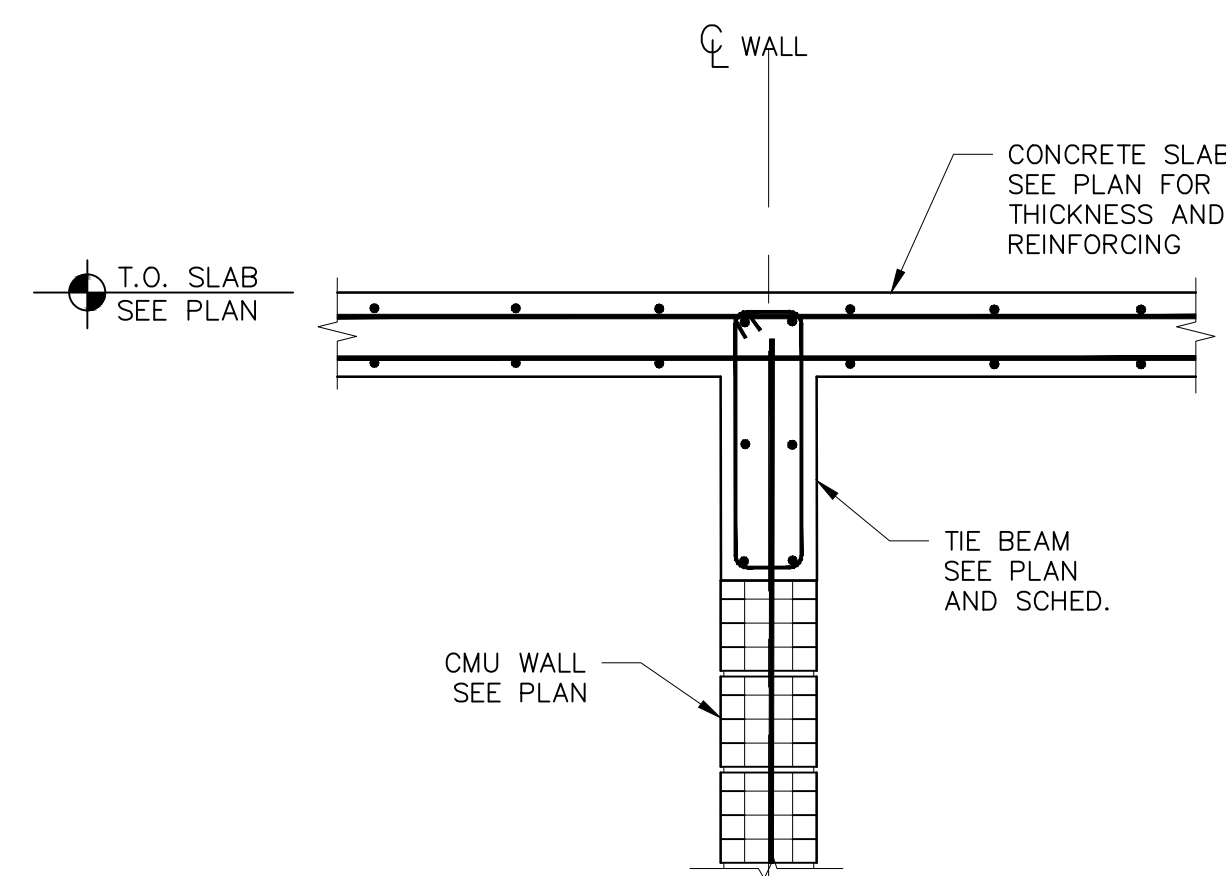
- NOTES:
1. SEE ARCH'L DRAWINGS FOR SIZE AND LOCATION OF OPENINGS.
 2. PROVIDE MINIMUM OF 4" OF BEARING EACH SIDE OF OPENING.
 3. REINFORCING SHALL PROJECT A MINIMUM OF 16" INTO BEARING.
 4. MINIMUM MASONRY COMPRESSIVE STRENGTH, f'_m , SHALL BE 1500 P.S.I.
 5. CAST-IN-PLACE CONCRETE LINTELS SHALL BE PROVIDED AT OPENINGS ADJACENT TO CONCRETE COLUMNS OR TIE COLUMNS

TYPICAL DETAIL
LINTEL SCHEDULE
CMU WALL

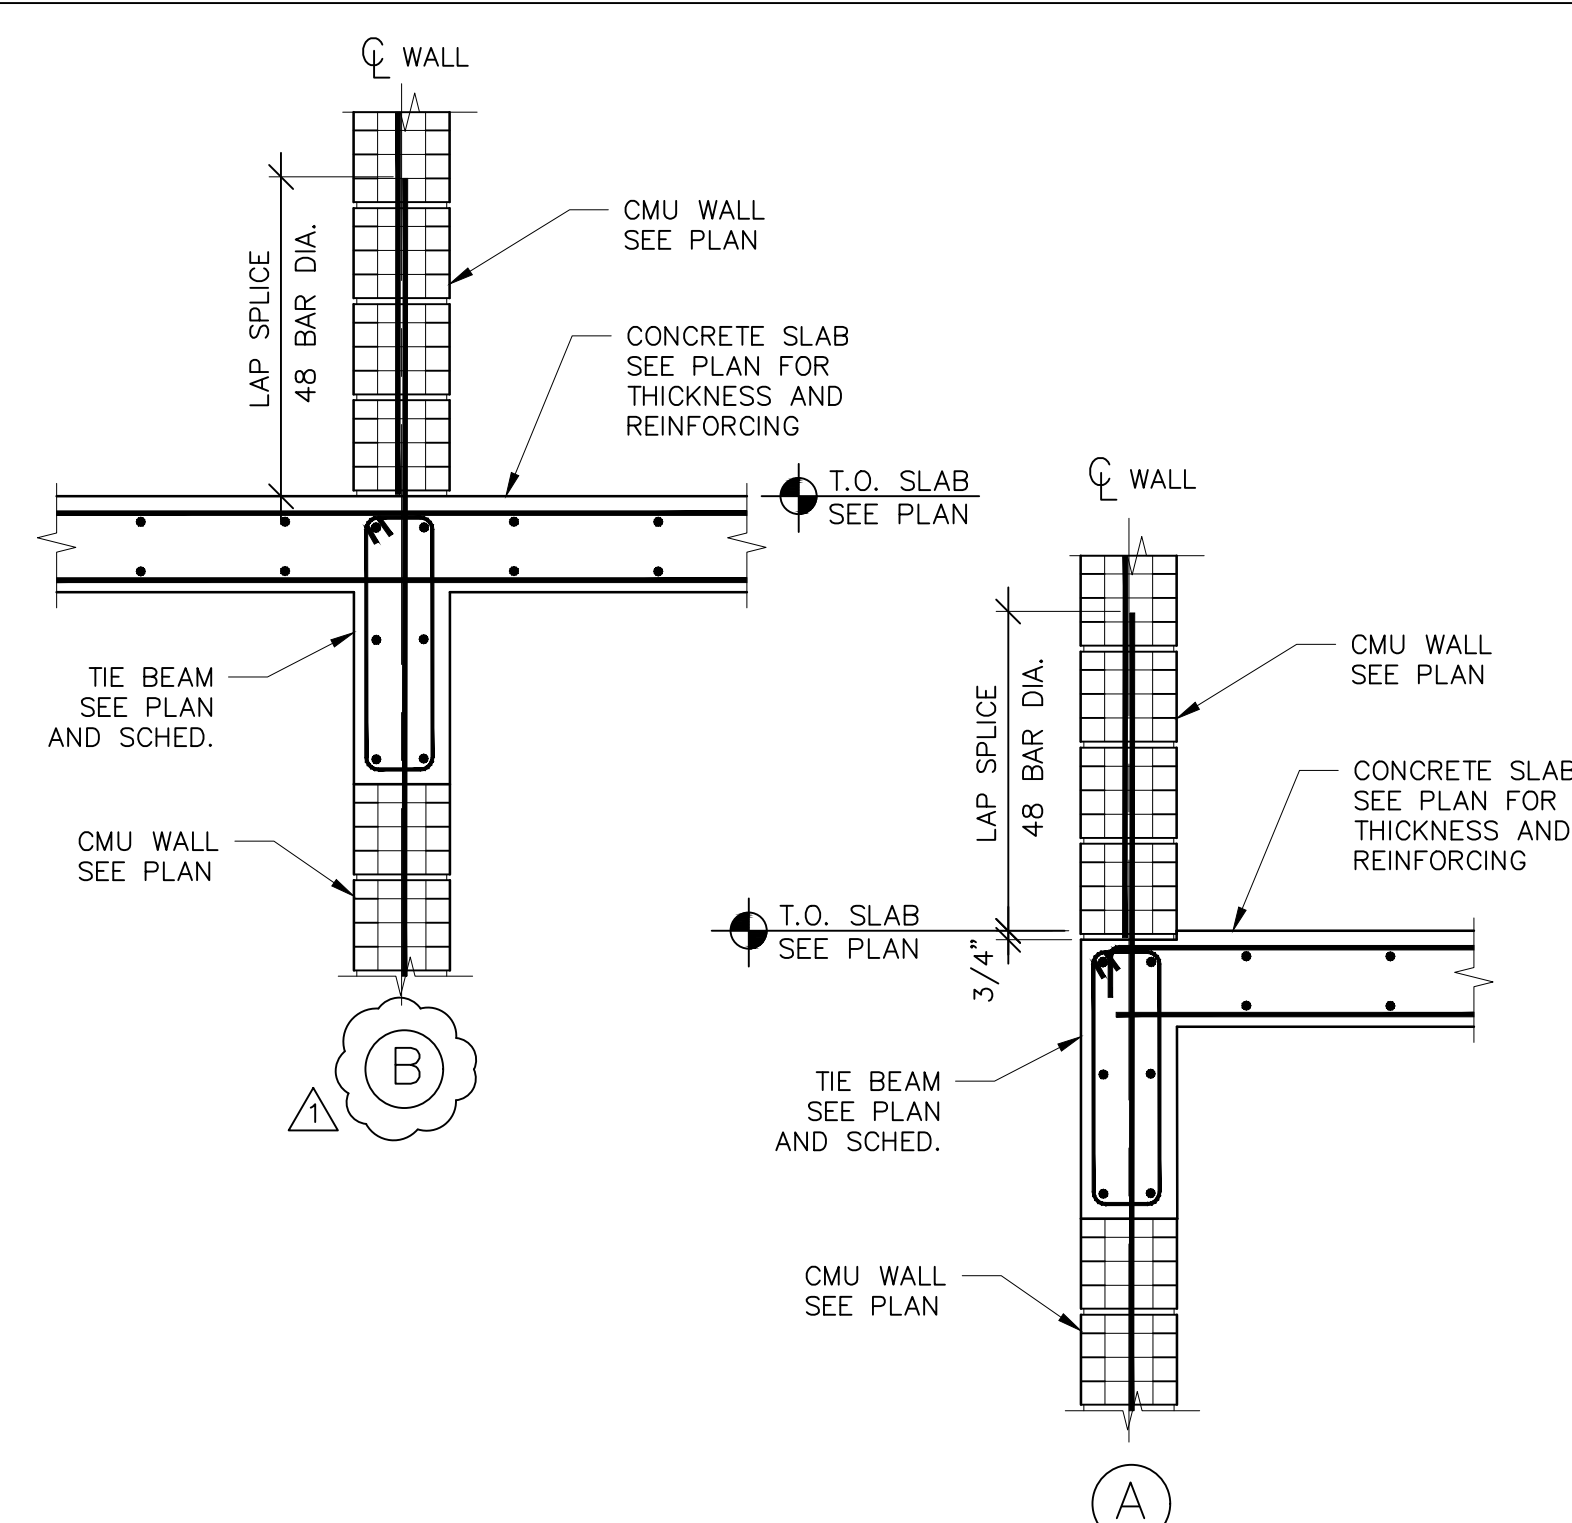
4

TYPICAL DETAIL
TIE COLUMN AT CMU WALL

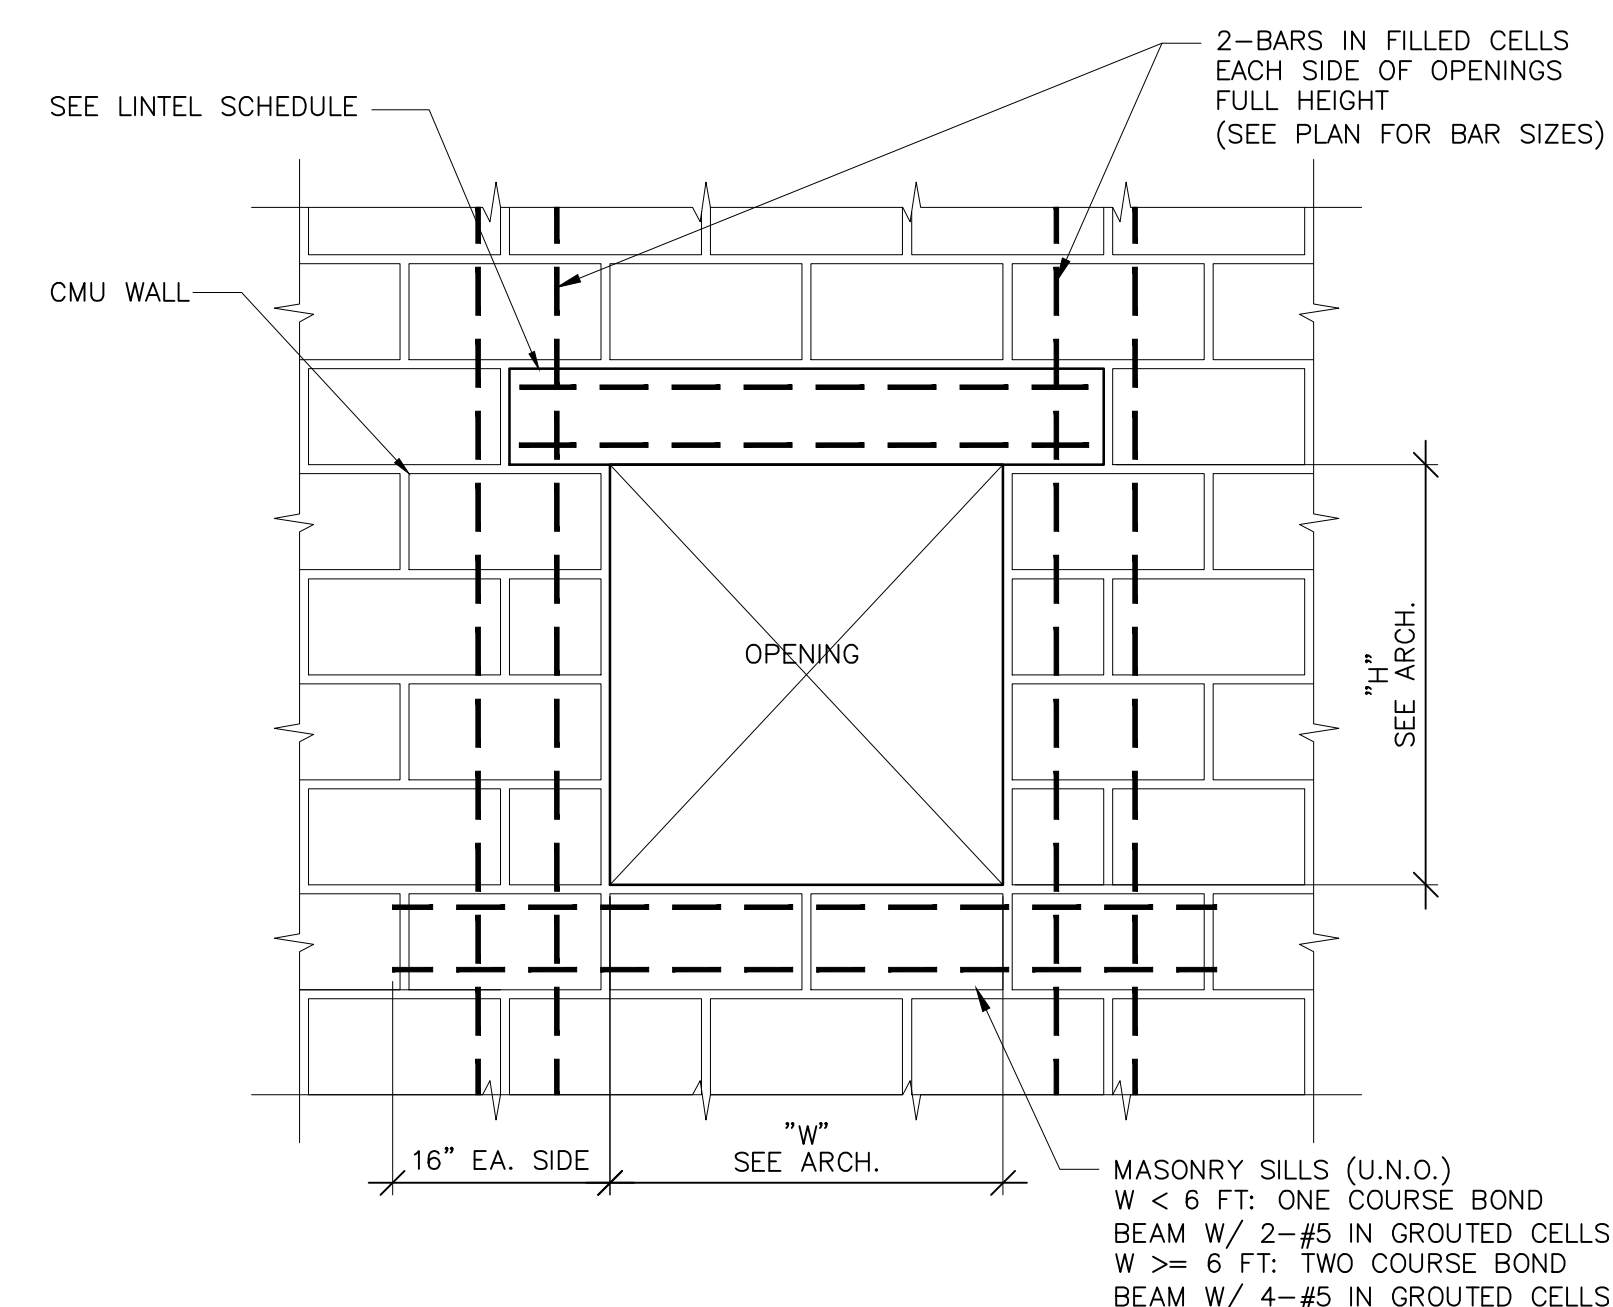
1

TYPICAL DETAIL
CONCRETE SLAB TO CMU WALL
CONNECTION

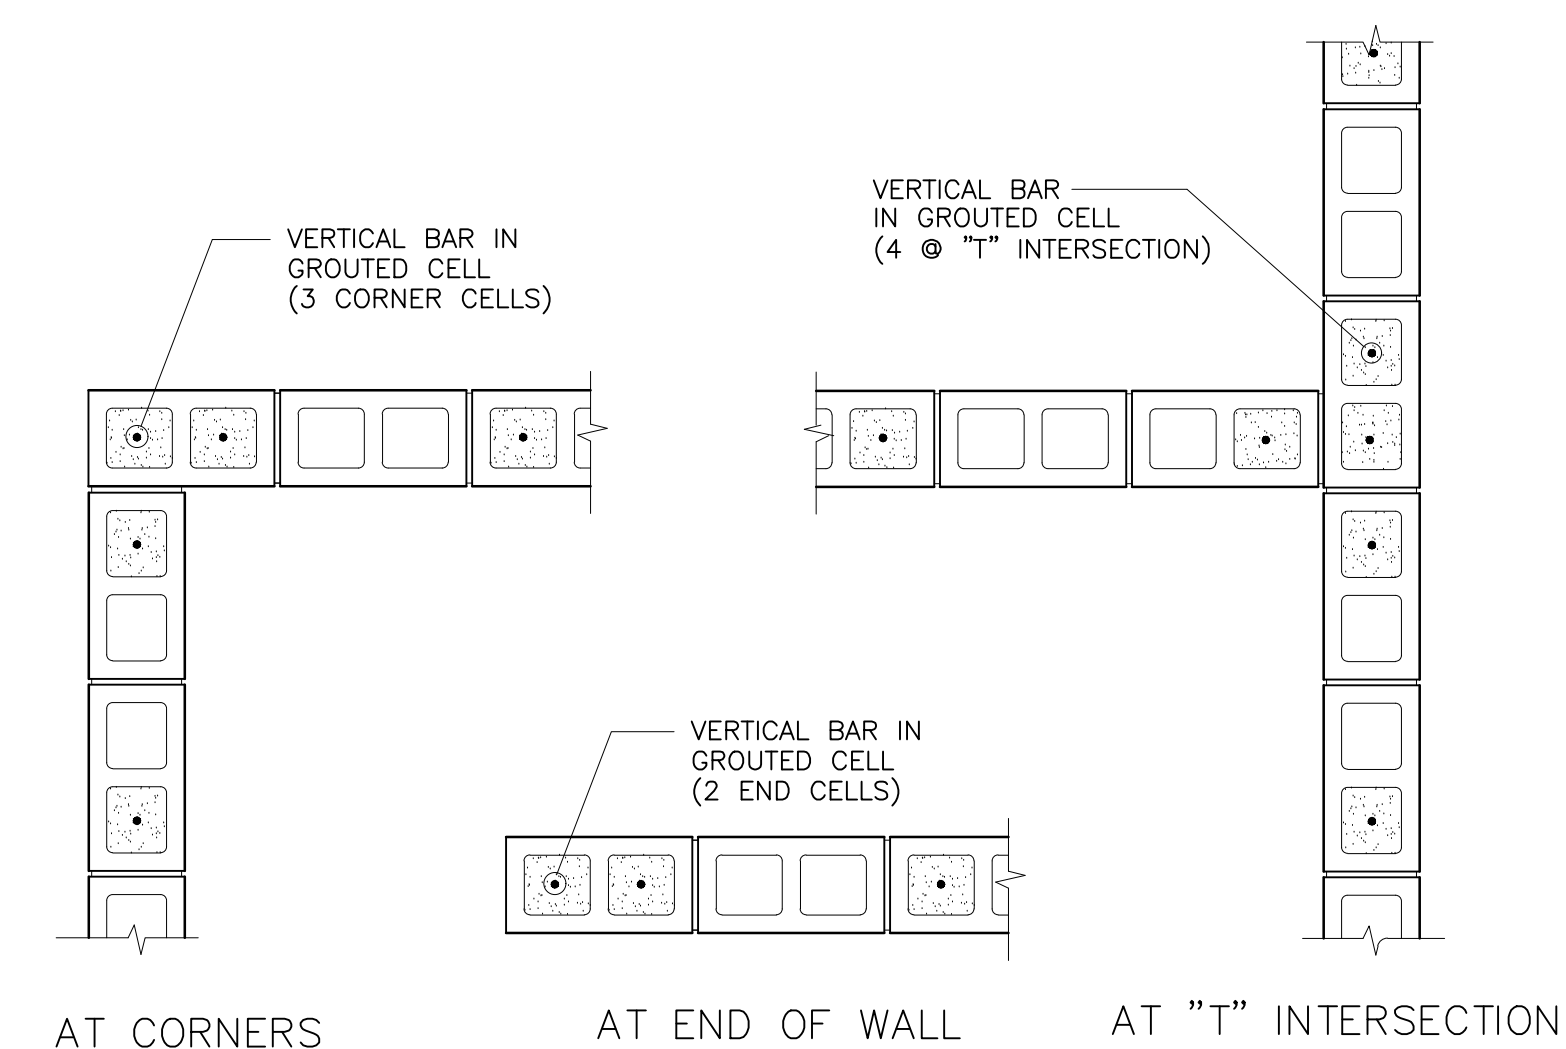
11

TYPICAL DETAIL
CONCRETE SLAB TO CMU WALL
CONNECTION

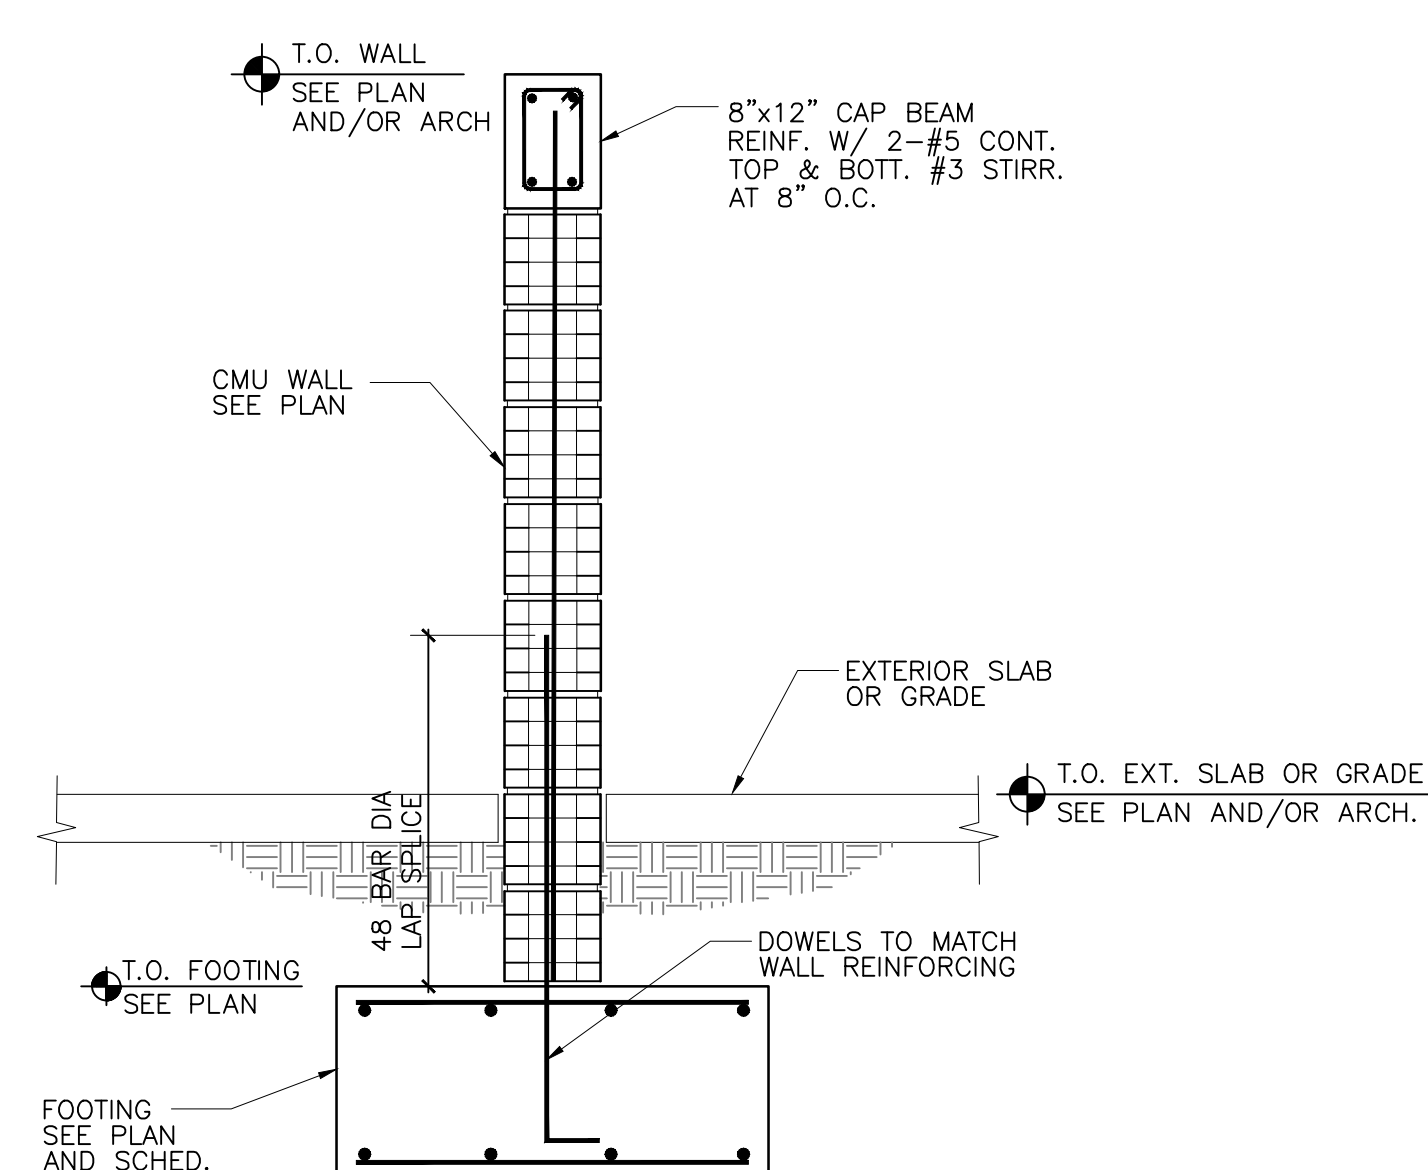
8

TYPICAL DETAIL
WINDOW OPENING AT CMU WALL

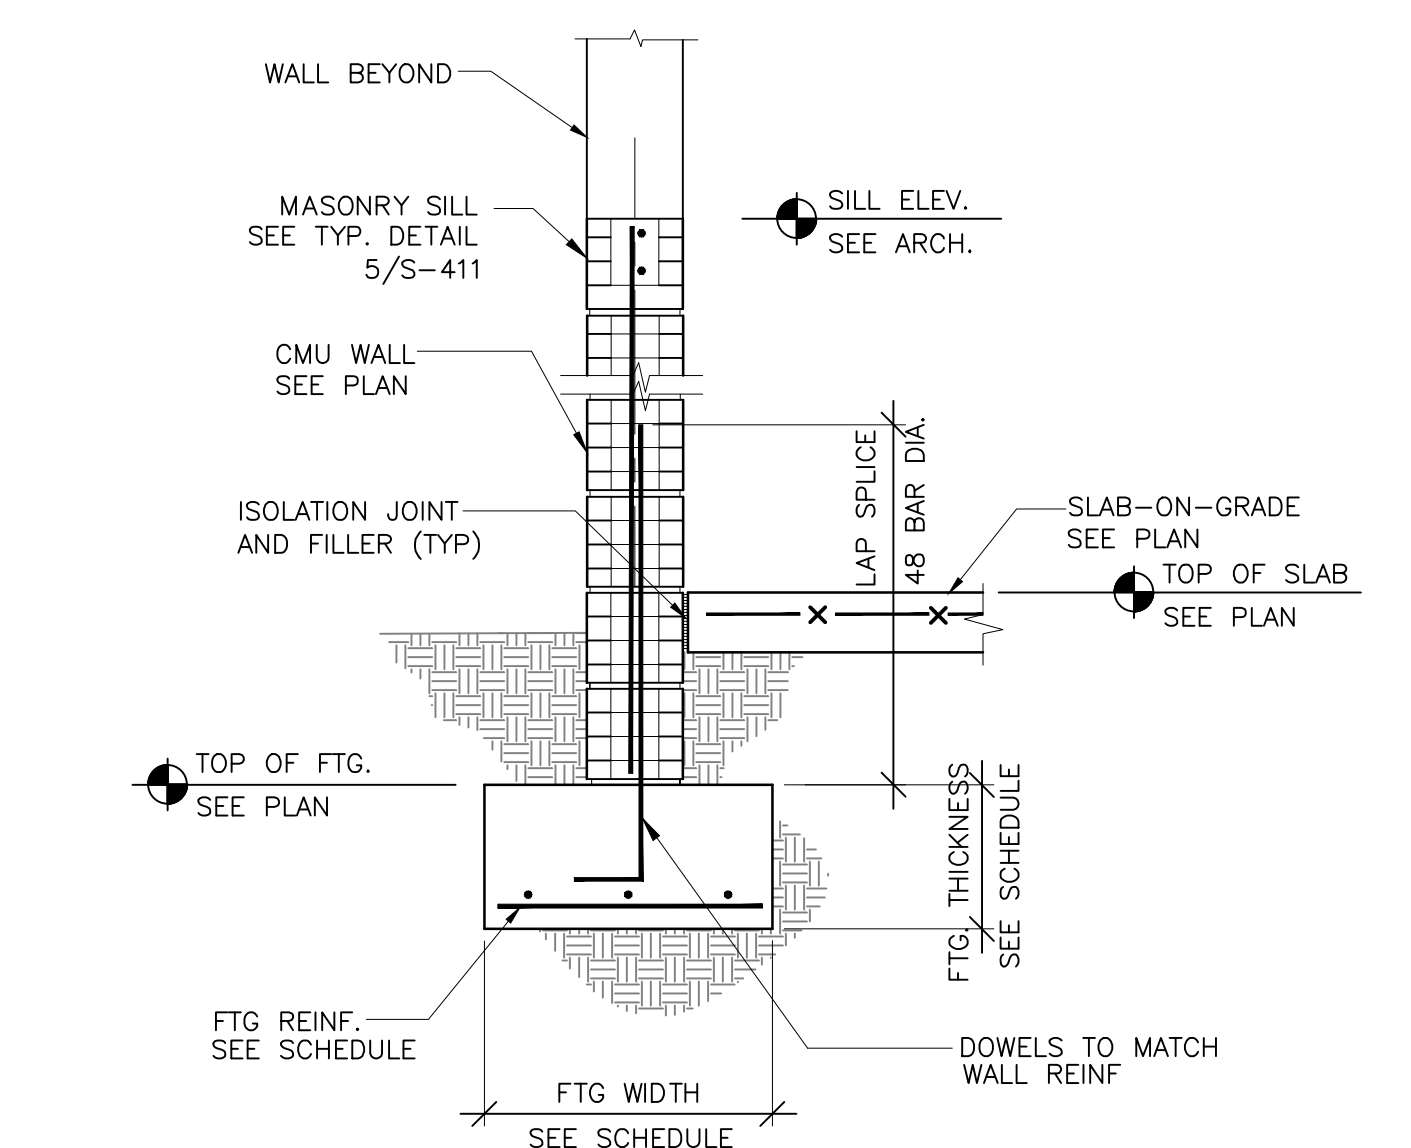
5

TYPICAL DETAIL
BAR PLACEMENT AT CORNERS AND
END OF CMU WALLS

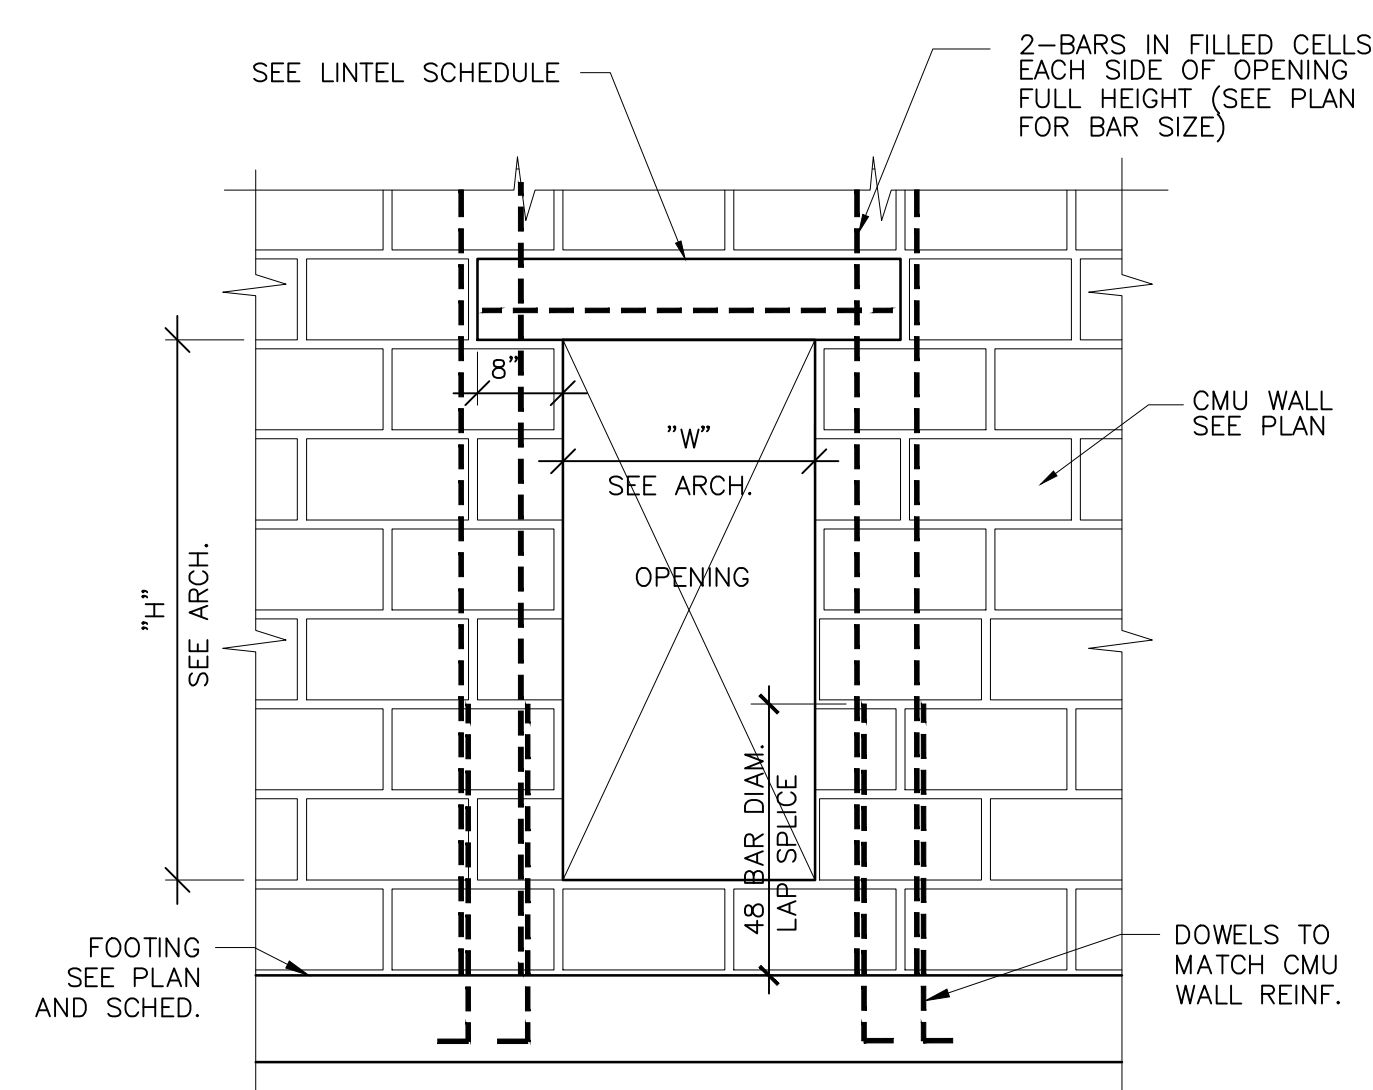
2

TYPICAL DETAIL
SITE CMU WALL TO FOOTING
CONNECTION

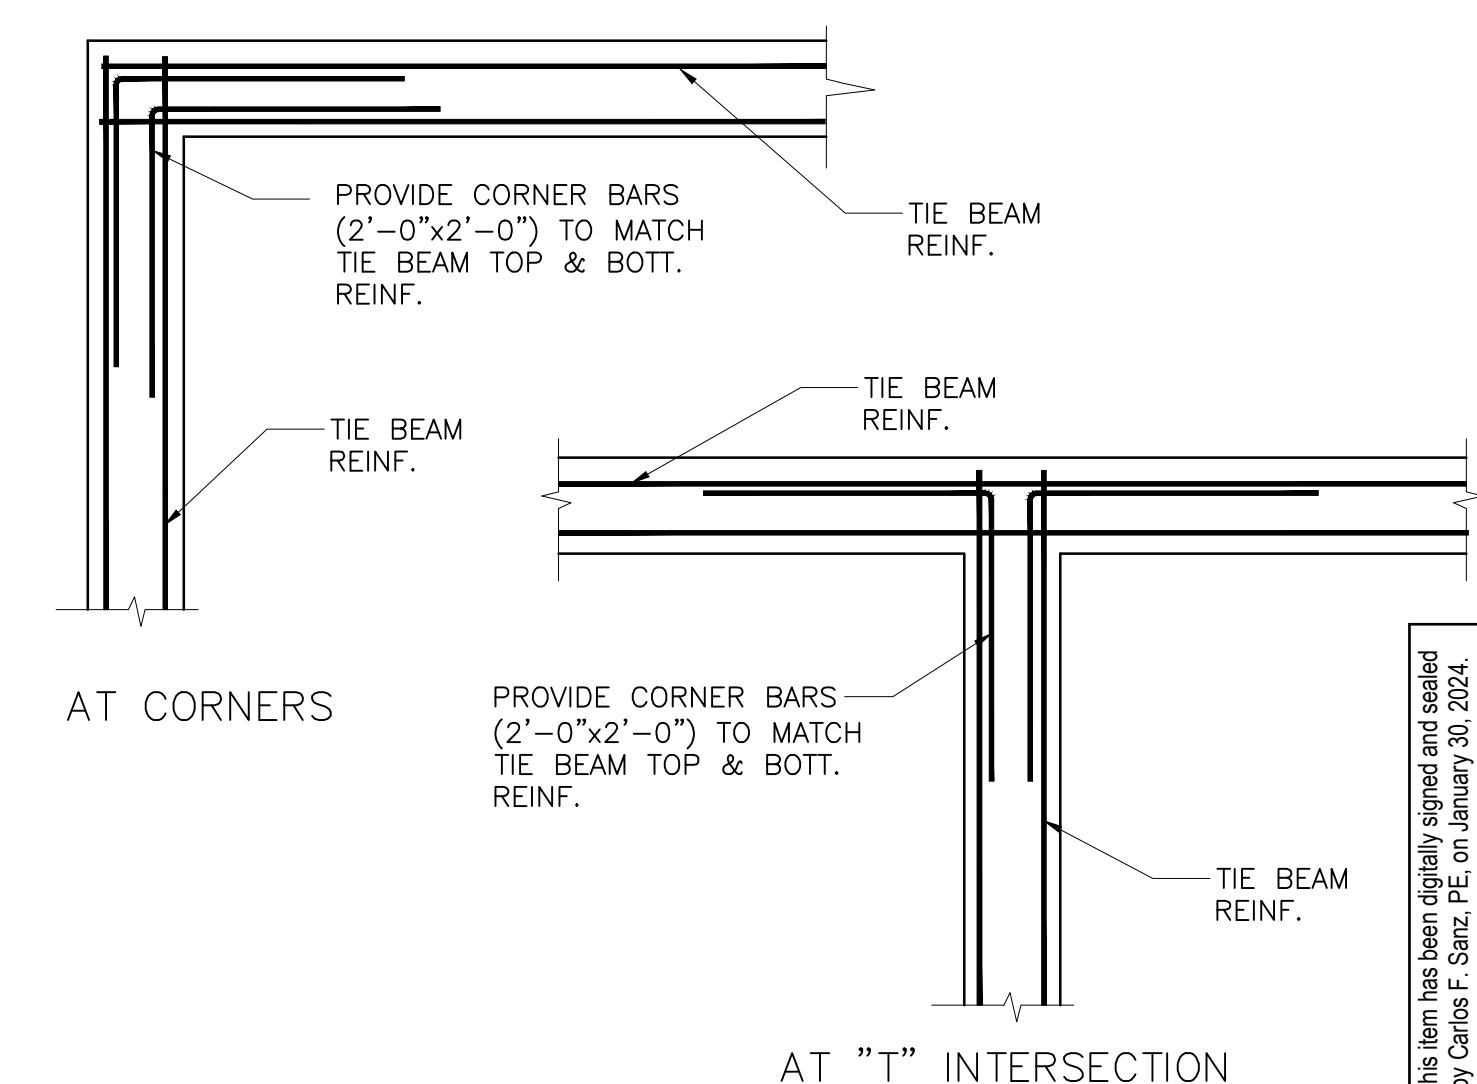
12

TYPICAL DETAIL
CMU WALL TO FOOTING CONNECTION
AT EXTERIOR WINDOW OPENING

9

TYPICAL DETAIL
EXTERIOR DOOR OPENING
AT CMU WALL

6

TYPICAL DETAIL
BAR PLACEMENT AT TIE BEAMS
CMU WALLS

3