

*** PRODUCTS DEPICTED ARE THE PROPERTY OF SCHUCO USA L.L.P.
USE OF THIS PRODUCT REQUIRES WRITTEN AUTHORIZATION BY SCHUCO USA L.L.P.
TO THE BUILDING DEPARTMENT WHEN APPLYING FOR A PERMIT. ***

DAYLITE OPENINGS WIDTHS:
OPERABLE PANEL WIDTH - 4.937"
FIXED PANEL WIDTH - 2.813"

DAYLITE OPENING HEIGHT:
PANEL HEIGHT - 2.687"

PANEL HEIGHT = DOOR FRAME HEIGHT - 4.062"

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT.
SHUTTERS ARE NOT REQUIRED.

ASS 39 PD.NI
ALUMINUM SLIDING GLASS DOOR (L.M.I.)

DESIGN LOAD RATING FOR DOORS TO BE AS PER CHARTS SHOWN
ON SHEET 4.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE
REQUIREMENTS OF THE 2017 (6TH EDITION)/2020 (7TH EDITION) FLORIDA
BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE
DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS
TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS
AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE
MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.


A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.
ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT
COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE
REQUIREMENTS OF THE 2017/2020 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION
FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY
OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR
WATER INFILTRATION RESISTANCE ETC.
CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY,
AND TO BE REVIEWED BY BUILDING OFFICIAL.


DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION
IN ACCORDANCE WITH SECTION 1709.9.3 OF FLORIDA BUILDING CODE.
LABELING TO COMPLY WITH SECTION 1709.9.2.

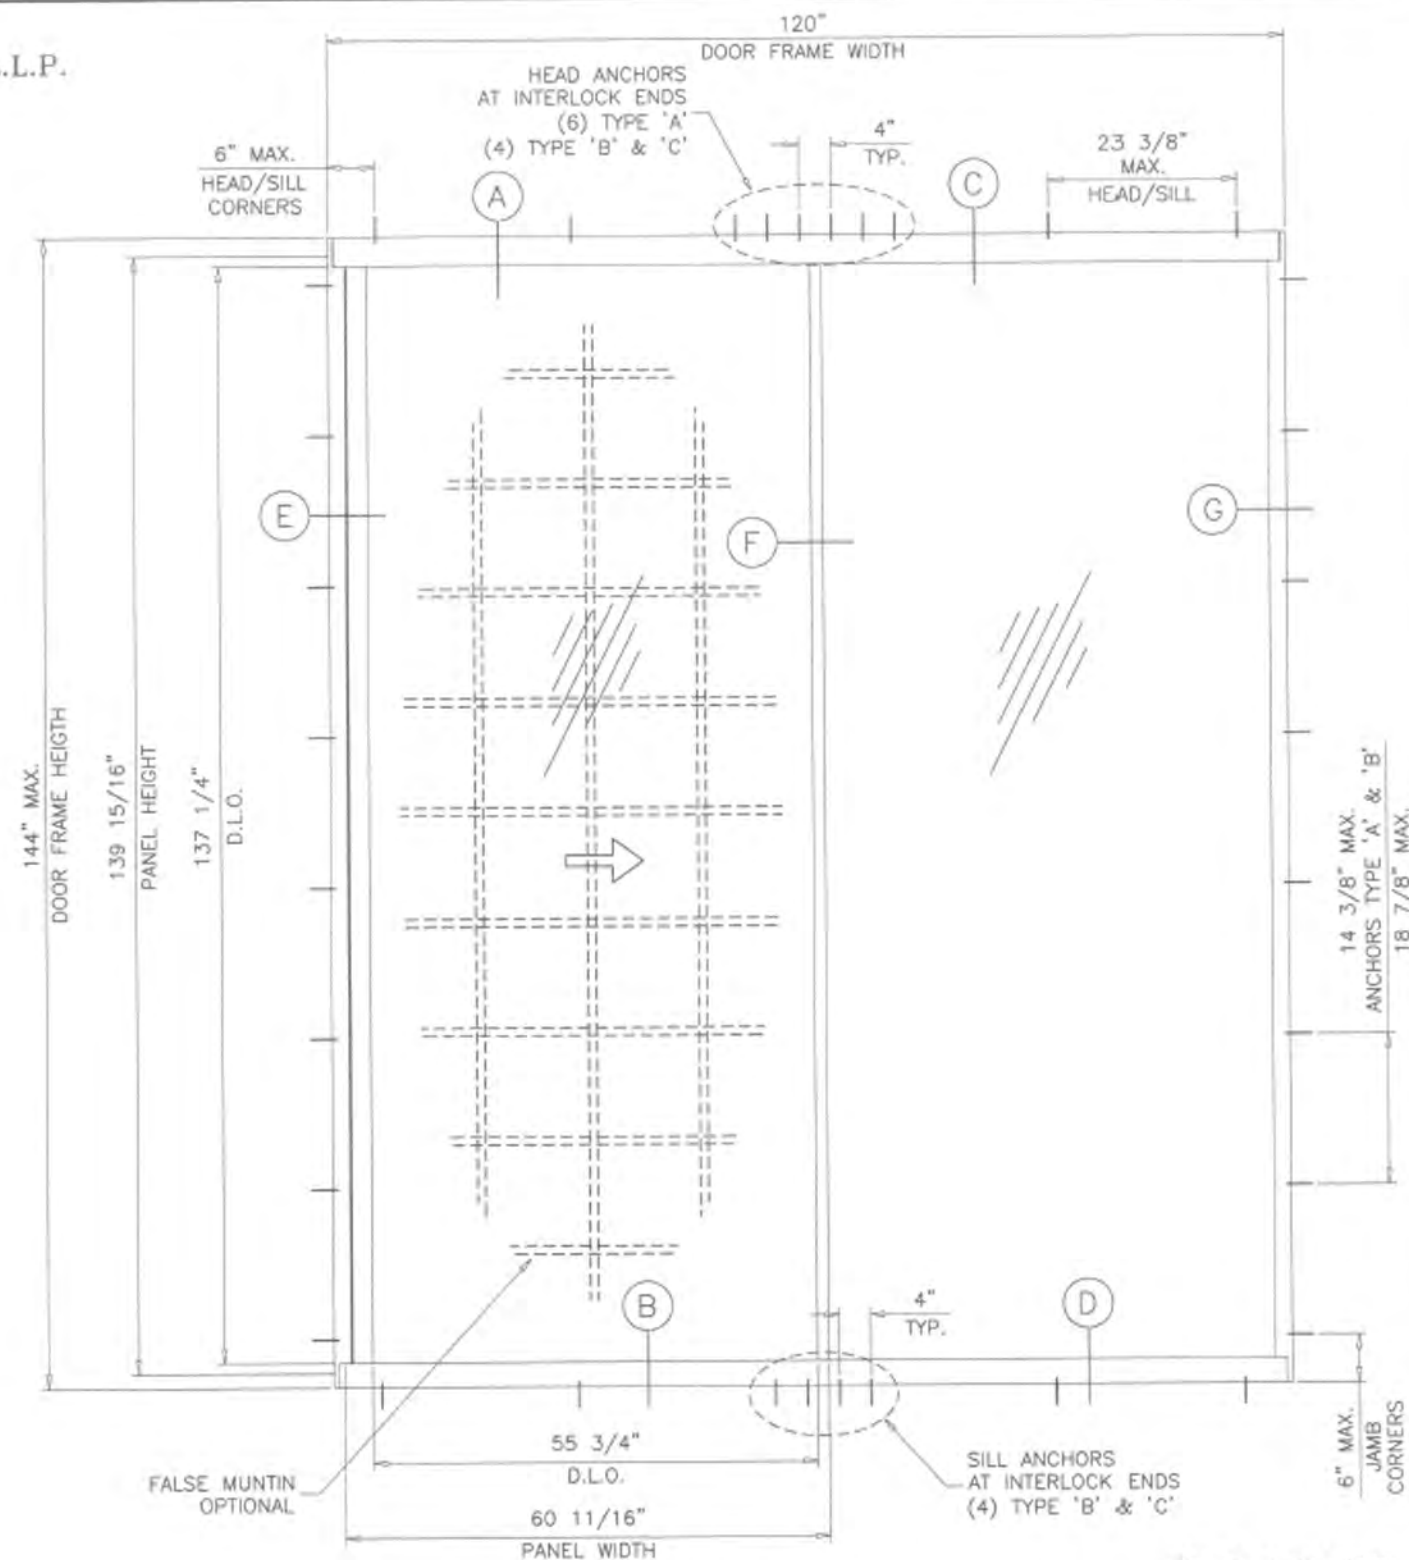

TYPICAL ELEVATION
TESTED UNIT (2 TRACK)

A- CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND
INSTALLATION OF THIS PRODUCT BASED ON THIS PRODUCT EVALUATION
PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED
ON THIS DOCUMENT.
B- THIS PRODUCT EVALUATION DOCUMENT WILL BE CONSIDERED INVALID IF
ALTERED BY ANY MEANS.
C- SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED
ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.)
FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER
USE OF THE P.E.D. ENGINEER OF RECORD, ACTING AS A DELEGATED
ENGINEER TO THE P.E.D. ENGINEER SHALL SUBMIT TO THIS LATTER THE SITE
SPECIFIC DRAWINGS FOR REVIEW.
D- THIS P.E.D. SHALL BEAR THE DATE AND ORIGINAL SEAL AND SIGNATURE OF
THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.

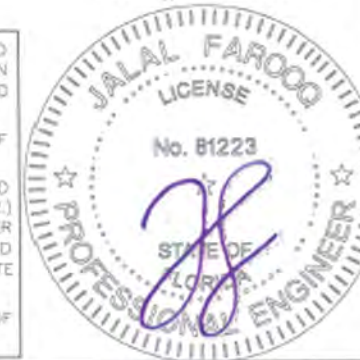


Sealed: 9/15/20
FL #27938

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL 18-74F-SUL

ASS 39 PD.NI ALUM SLIDING GLASS DOOR (L.M.I.)
Schuco USA L.L.P.
240 Pane Road
Newington, CT. 06111
Phone: (860) 666-0505 Fax: (860) 616-0188

revisions:	no	date	description
	A	11.30.18	3 TRACK ADDED
	B	02.01.19	ORXX OPTION ADDED
	C	05.07.19	MINI INTERLOCK OPTION ADDED
	D	09.08.20	UPDATED TO 2020 FBC
date:	07-31-18		
scale:	1/2"=1'-0"		
dr. by:	TARIQ		
chk. by:			
drawing no.	18-74F		
sheet	1 of 17		

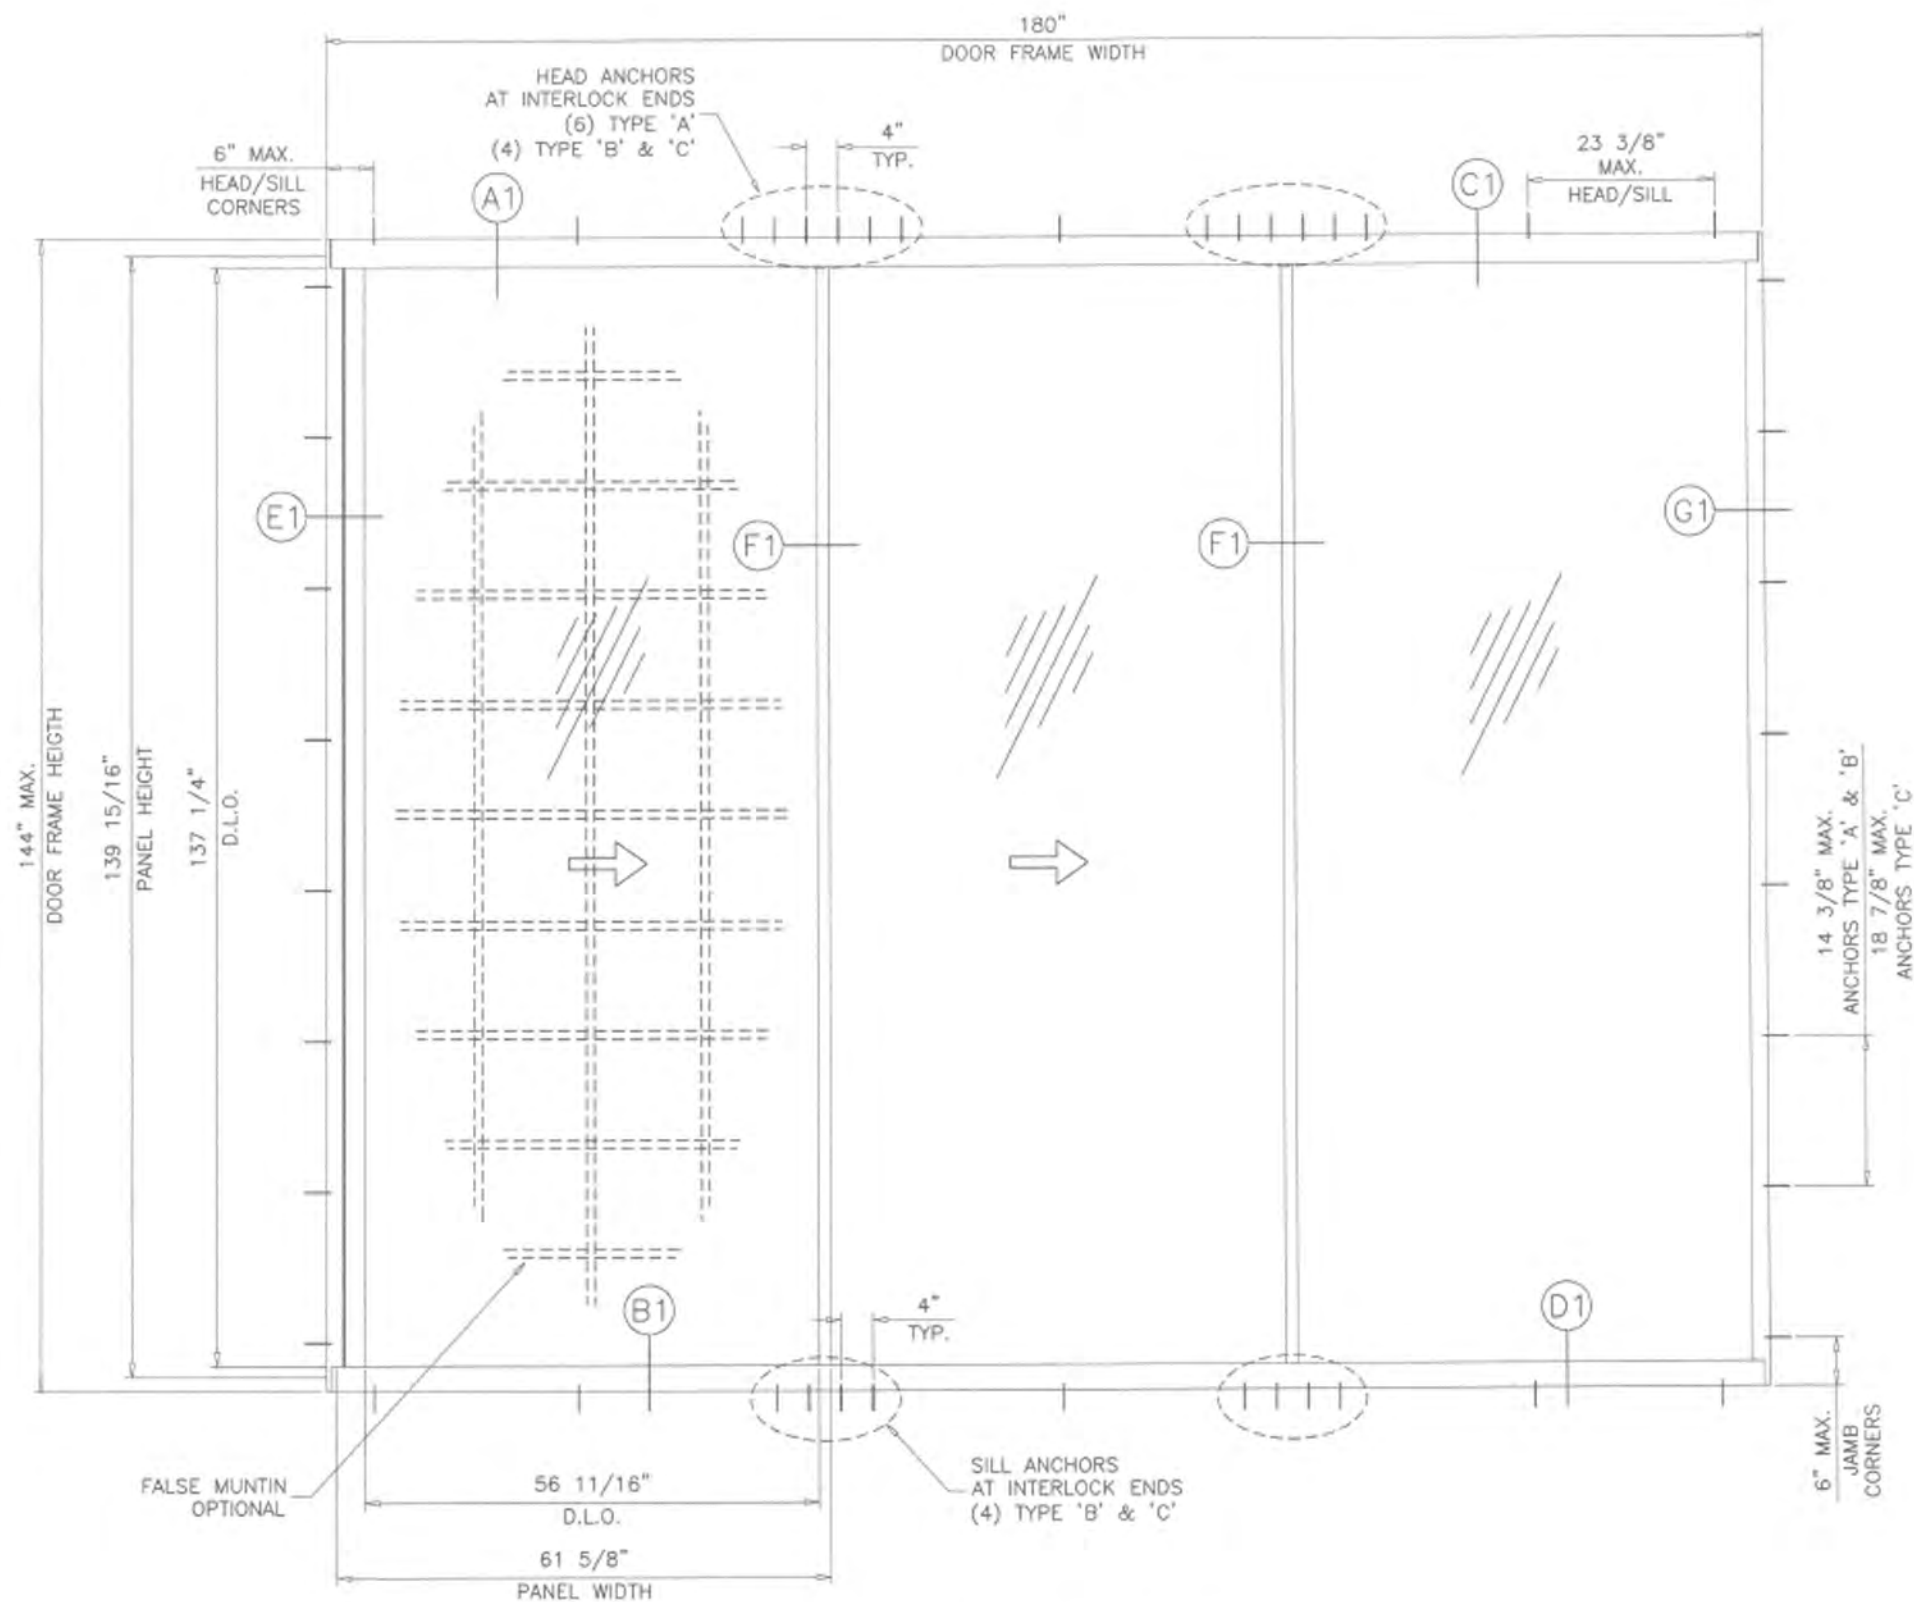

TYPICAL ELEVATION
TESTED UNIT (3 TRACK)

Sealed: 9/15/20
FL #27938



revisions:		date		by		description	
no.	date	no.	date	no.	date	no.	date
1	07-31-18	1	07-31-18	1	07-31-18	1	07-31-18
2		2		2		2	
3		3		3		3	
4		4		4		4	
5		5		5		5	
6		6		6		6	
7		7		7		7	
8		8		8		8	
9		9		9		9	
10		10		10		10	

ASS 39 PD.NI ALUM SLIDING GLASS DOOR (L.M.I.)
Schuco USA L.L.P.
240 Pane Road
Newington, CT. 06111
Phone: (860) 666-0505 Fax: (860) 616-0188

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL 18-74F-SUL

DOOR DESIGN LOAD CAPACITY - PSF MINI INTERLOCKS			
AVERAGE PANEL WIDTH INCHES	DOOR FRAME HEIGHT INCHES	GLASS TYPES 'A' & 'Ai'	
		EXT.(+)	INT.(-)
36	84	63.0	70.0
42		63.0	70.0
48		63.0	70.0
54		63.0	70.0
36	96	63.0	70.0
42		63.0	70.0
48		63.0	70.0




MINI INTERLOCKS

AVERAGE PANEL WIDTH = $\frac{\text{DOOR FRAME WIDTH}}{\text{NUMBER OF PANELS}}$


ALTERNATE SIZE UNITS:
MAX. FRAME AREA OF S.G.D. SHALL NOT
EXCEED FRAME AND PANEL AREA OF TESTED UNIT
PER FBC REQUIREMENTS.

DOOR HEIGHT AND WIDTH SIZE MUST COMPLY
EGRESS REQUIREMENTS PER FBC AS REQUIRED.

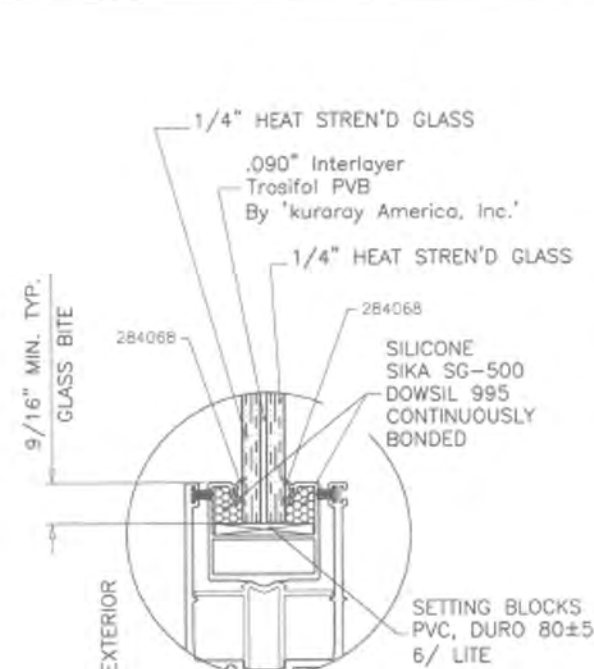

GLASS TYPE 'A'

9/16" OVERALL LAMINATED GLASS

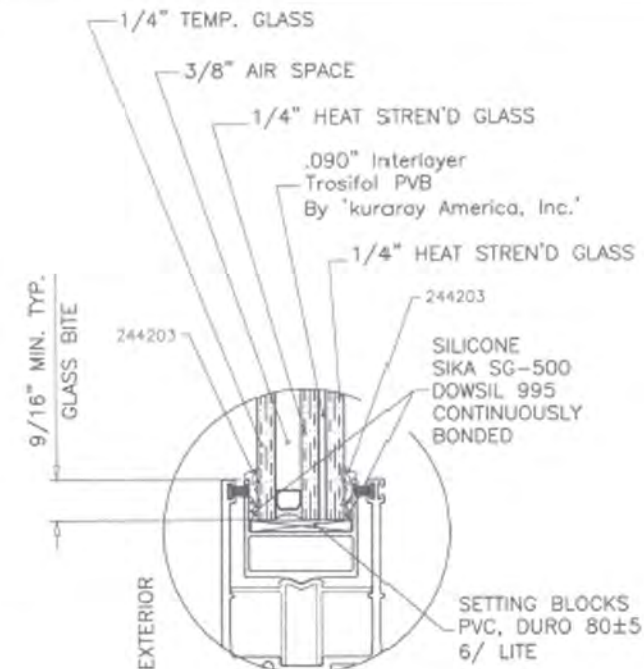

GLASS TYPE 'Ai'

1-3/16" OVERALL INSUL. LAM. GLASS



NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

Sealed: 9/15/20

FL #27938

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL (305) 264-8100 FAX (305) 262-8978
COMP-ANL 18-74F-SUL

ASS 39 PD.NI ALUM SLIDING GLASS DOOR (L.M.I.)

Schuco USA L.L.P.
240 Pane Road
Newington, CT. 06111
Phone: (860) 666-0505 Fax: (860) 616-0188

revisions:	no	date	by	description

date: 07-31-18

scale: 3/8" = 1"

dr. by: TARIQ

chk. by:


drawing no.
18-74F

sheet 4 of 17


DOOR DESIGN LOAD CAPACITY - PSF STANDARD INTERLOCKS					
AVERAGE PANEL WIDTH INCHES	DOOR FRAME HEIGHT INCHES	GLASS TYPES 'B' & 'Bi'		GLASS TYPES 'C' & 'Ci'	
		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
36	108	63.0	70.0	63.0	70.0
42		63.0	70.0	63.0	70.0
48		63.0	70.0	63.0	70.0
54		63.0	70.0	63.0	70.0
60		63.0	70.0	63.0	70.0
66		63.0	70.0	63.0	70.0
72		63.0	70.0	63.0	70.0
78		-	-	63.0	70.0
36	114	63.0	70.0	63.0	70.0
42		63.0	70.0	63.0	70.0
48		63.0	70.0	63.0	70.0
54		63.0	70.0	63.0	70.0
60		63.0	70.0	63.0	70.0
66		63.0	70.0	63.0	70.0
72		-	-	63.0	70.0
36	120	63.0	70.0	63.0	70.0
42		63.0	70.0	63.0	70.0
48		63.0	70.0	63.0	70.0
54		63.0	70.0	63.0	70.0
60		63.0	70.0	63.0	70.0
66		63.0	70.0	63.0	70.0
72		-	-	63.0	70.0
36	126	63.0	70.0	63.0	70.0
42		63.0	70.0	63.0	70.0
48		63.0	70.0	63.0	70.0
54		63.0	70.0	63.0	70.0
60		63.0	70.0	63.0	70.0
66		-	-	63.0	66.9
72		-	-	63.0	66.9
36	132	63.0	70.0	63.0	70.0
42		63.0	70.0	63.0	70.0
48		63.0	70.0	63.0	70.0
54		63.0	70.0	63.0	70.0
60		63.0	70.0	63.0	70.0
66		-	-	63.0	67.1
72		-	-	63.0	67.1
36	138	63.0	70.0	63.0	70.0
42		63.0	70.0	63.0	70.0
48		63.0	70.0	63.0	70.0
54		63.0	68.5	63.0	68.5
60		-	-	63.0	63.3
66		-	-	63.0	63.3
72		-	-	63.0	63.3
36	144	63.0	70.0	63.0	70.0
42		63.0	70.0	63.0	70.0
48		63.0	70.0	63.0	70.0
54		63.0	65.0	63.0	65.0
60		-	-	60.0	60.0
66		-	-	60.0	60.0
72		-	-	60.0	60.0




STANDARD INTERLOCKS

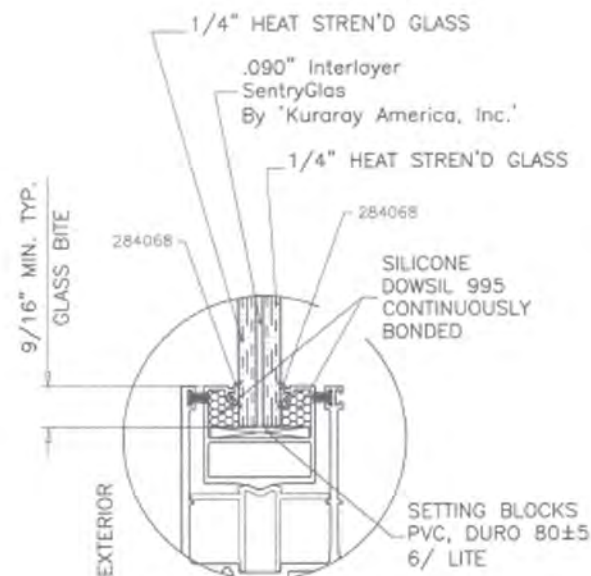


GLASS TYPE 'B'
9/16" OVERALL LAMINATED GLASS

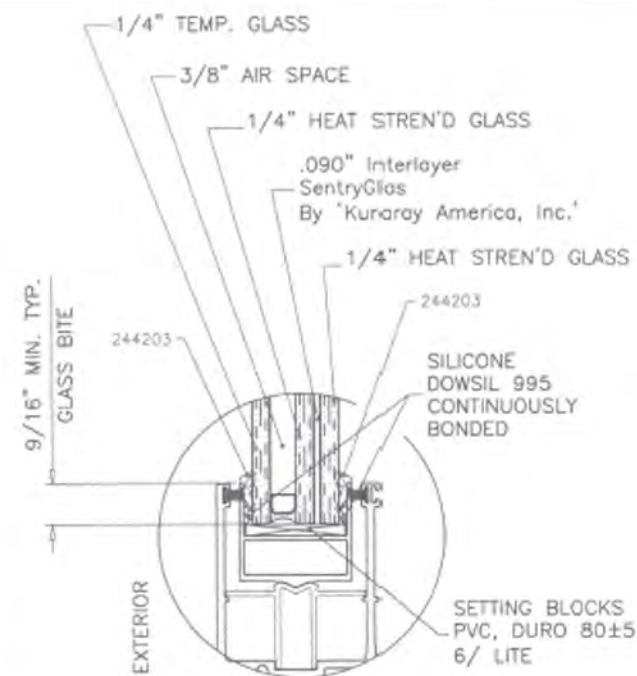

GLASS TYPE 'Bi'
1-3/16" OVERALL INSUL. LAM. GLASS

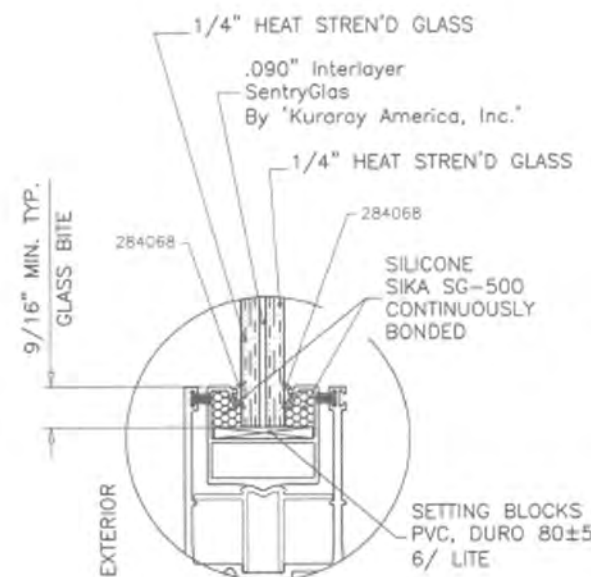

GLASS TYPE 'C'
9/16" OVERALL LAMINATED GLASS

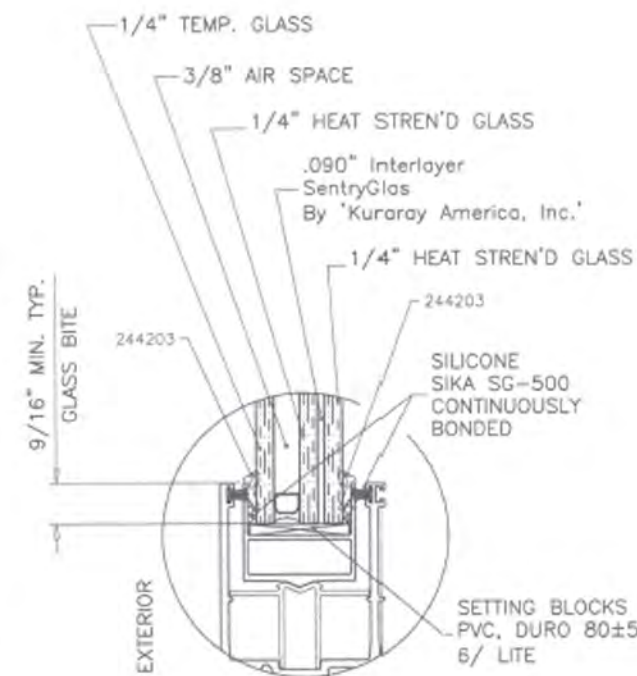

GLASS TYPE 'Ci'
1-3/16" OVERALL INSUL. LAM. GLASS

AVERAGE PANEL WIDTH = $\frac{\text{DOOR FRAME WIDTH}}{\text{NUMBER OF PANELS}}$

ALTERNATE SIZE UNITS:
MAX. FRAME AREA OF S.G.D. SHALL NOT
EXCEED FRAME AND PANEL AREA OF TESTED UNIT
PER FBC REQUIREMENTS.

DOOR HEIGHT AND WIDTH SIZE MUST COMPLY
EGRESS REQUIREMENTS PER FBC AS REQUIRED.

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

Sealed: 9/15/20

FL #27938



AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL\18-74F-SUL

ASS 39 PD,NI ALUM SLIDING GLASS DOOR (L.M.I.)
Schuco USA L.L.P.
240 Pane Road
Newington, CT. 06111
Phone: (860) 666-0505 Fax: (860) 616-0188

revisions:	no	date	by	description

date: 07-31-18
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
18-74F
sheet 4.1 of 17




ALT. INTERLOCKS
479800

STD. INTERLOCKS
479740

MINI INTERLOCK NOT APPLICABLE FOR O-XO CONFIGURATION

APPROVED CONFIGURATIONS
TWO (2) TRACKS

DOOR CONFIGURATIONS SHOWN FOR STANDARD INTERLOCKS
APPLICABLE TO MINI INTERLOCKS ALSO.



FL #27938

ASS 39 PD.NI ALUM SLIDING GLASS DOOR (L.M.I.)

Schuco USA L.L.P.
240 Pane Road
Newington, CT. 06111
Phone: (860) 666-0505

Phone: (860) 666-0505 Fax: (860) 616-0188

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
(C.A.N. 3538)
TEL (305) 264-8100 FAX (305) 262-6978
COMP-NUM 18

[illegible]

COMP-ANI \ 18-



COMP-ANL\18-74F-SUL

[illegible]

date: 07-31-18
scale: -
dr. by: TARD
chk. by:


drawing no.
18-74F

(sheet 5 of 17)

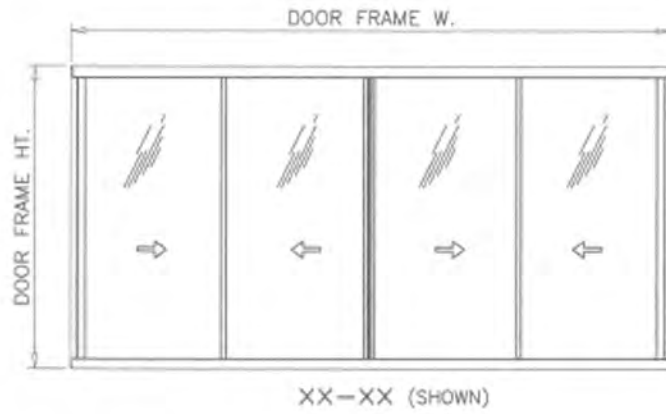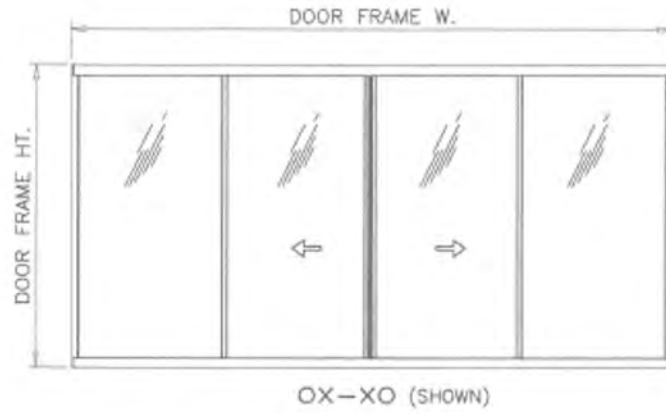


APPROVED CONFIGURATIONS
TWO (2) TRACKS

DOOR CONFIGURATIONS SHOWN FOR STANDARD INTERLOCKS
APPLICABLE TO MINI INTERLOCKS ALSO.

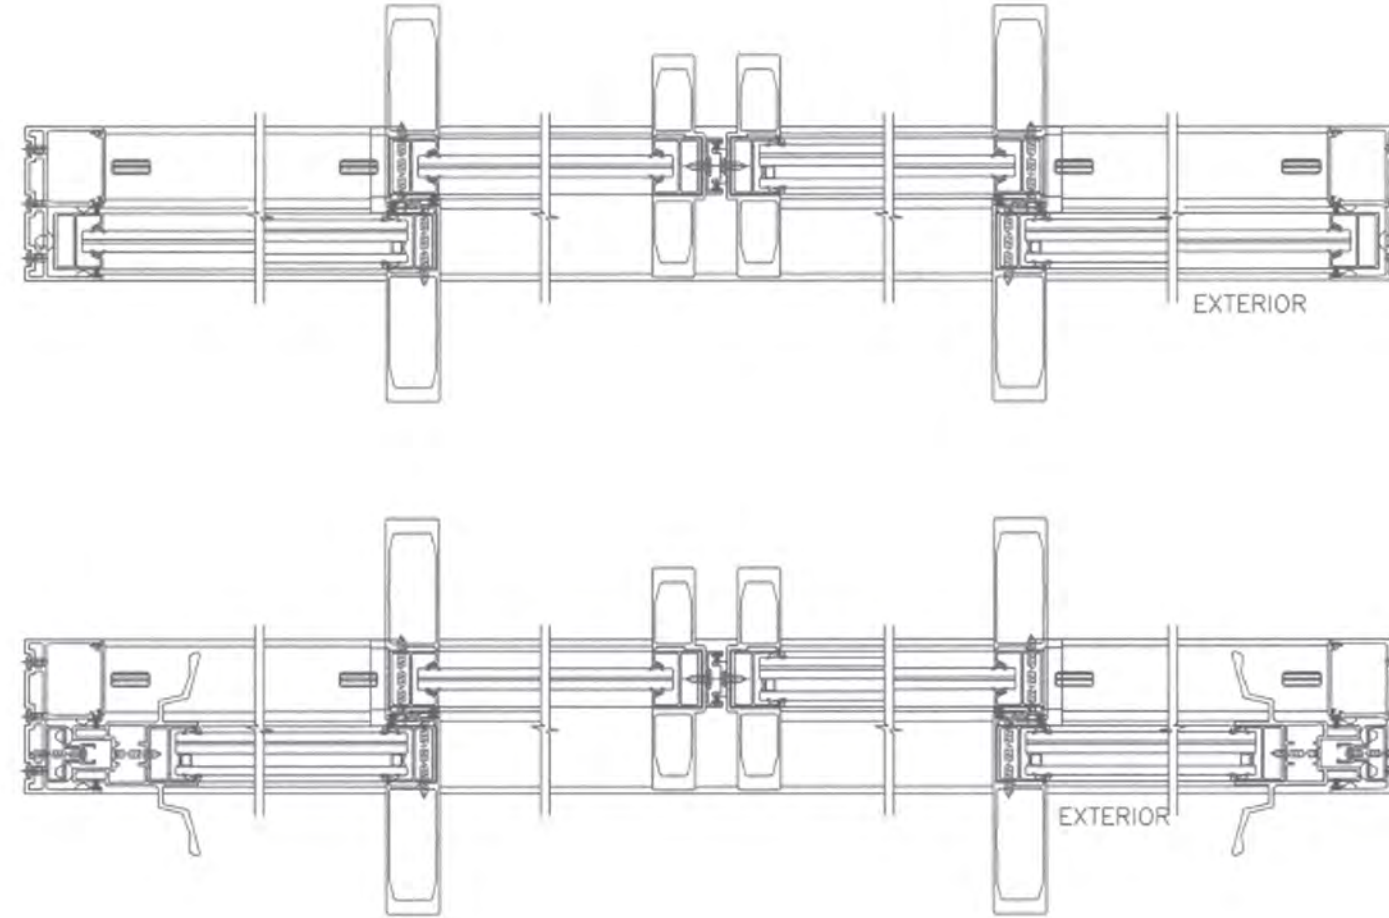

Sealed: 9/15/20

FL #27938

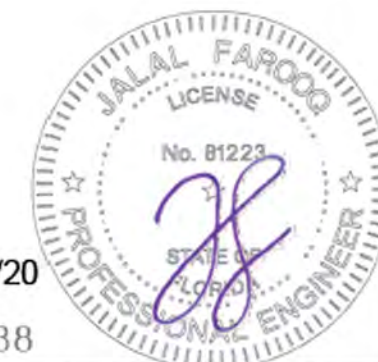

date: 07-31-18	scale: -	dr. by: TARIQ	chk. by:
revisions:	no	date	by description

drawing no.

18-74F

sheet 6 of 17

ASS 39 PD.NI ALUM SLIDING GLASS DOOR (L.M.I.)

Schuco USA L.L.P.

240 Pane Road

Newington, CT. 06111

Phone: (860) 666-0505

Fax: (860) 616-0188

AL-FAROOQ CORPORATION

ENGINEERS & PRODUCT DEVELOPMENT

9360 SUNSET DRIVE, SUITE 220

MIAMI, FLORIDA 33173


(C.A.N. 3538)

TEL (305) 264-8100

FAX (305) 262-6978




afc

COMP-ANL\18-74F-SUL

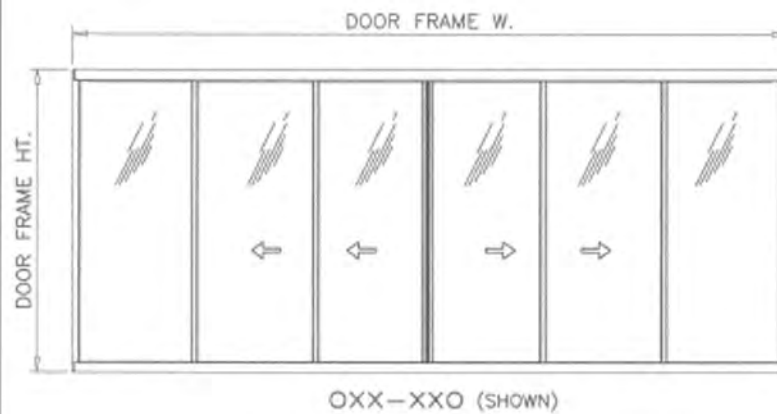

APPROVED CONFIGURATIONS
THREE (3) TRACKS

DOOR CONFIGURATIONS SHOWN FOR STANDARD INTERLOCKS
APPLICABLE TO MINI INTERLOCKS ALSO.

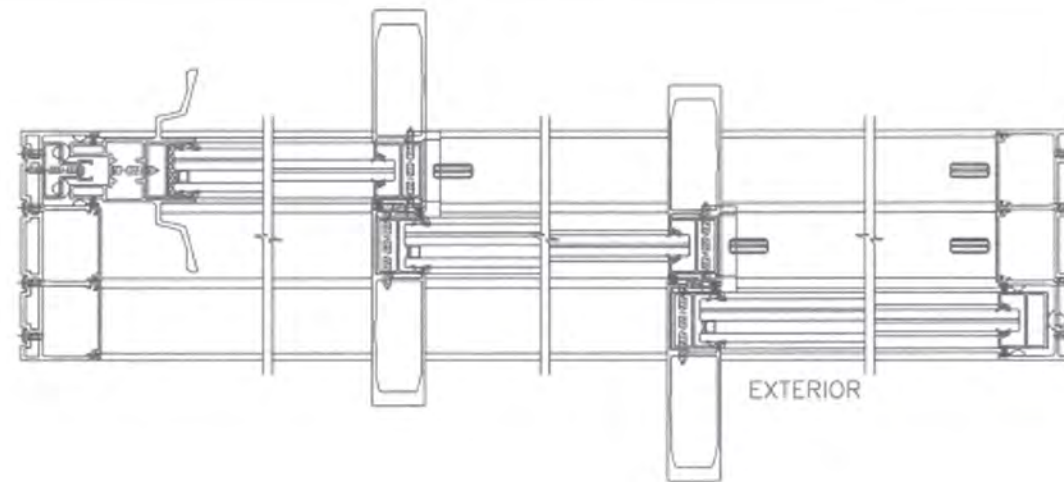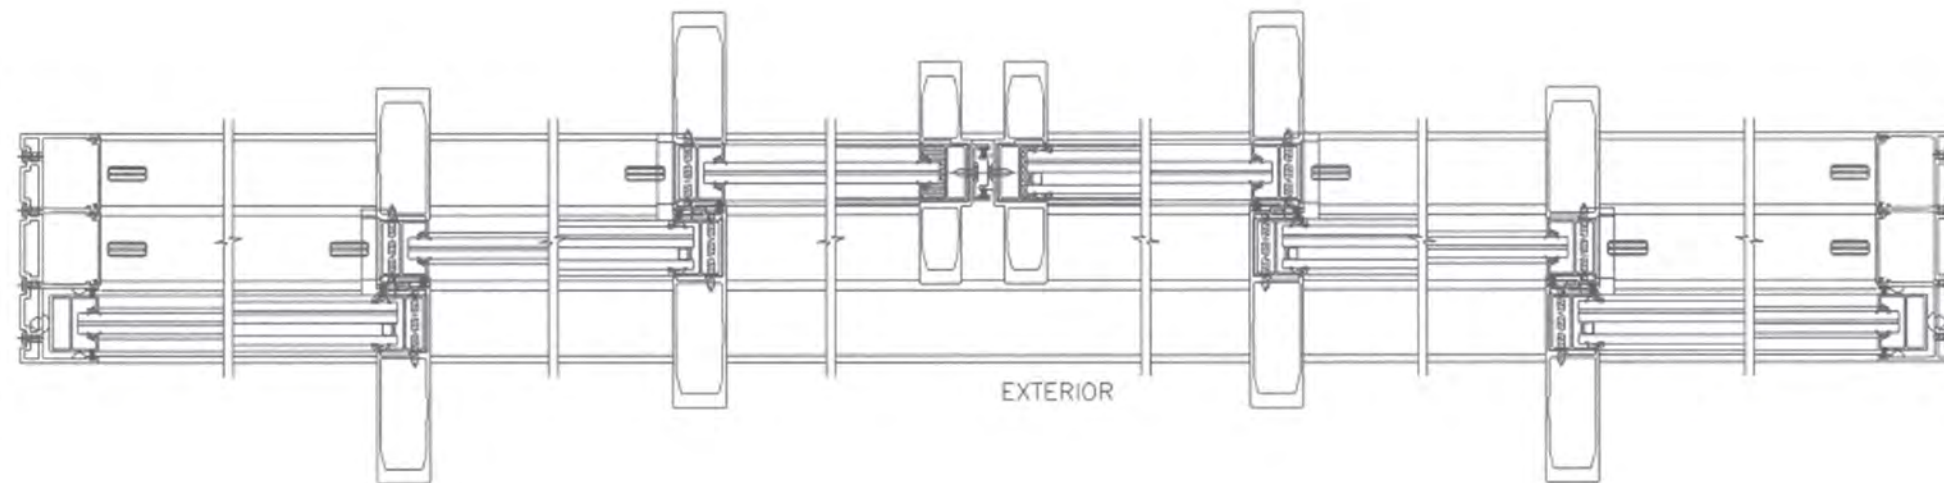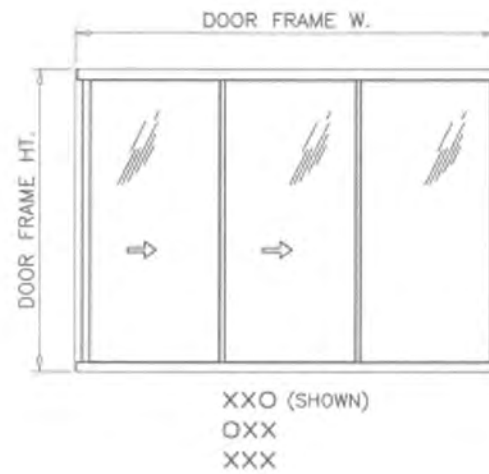

Sealed: 9/15/20

FL #27938

revisions:			
no	date	by	description

date: 07-31-18	scale: -	dr. by: TARIO	chk. by:
----------------	----------	---------------	----------



drawing no.
18-74F

sheet 7 of 17

ASS 39 PD.NI ALUM SLIDING GLASS DOOR (L.M.I.)


Schuco USA L.L.P.
240 Pane Road
Newington, CT. 06111
Phone: (860) 666-0505 Fax: (860) 616-0188

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL\18-74F-SUL

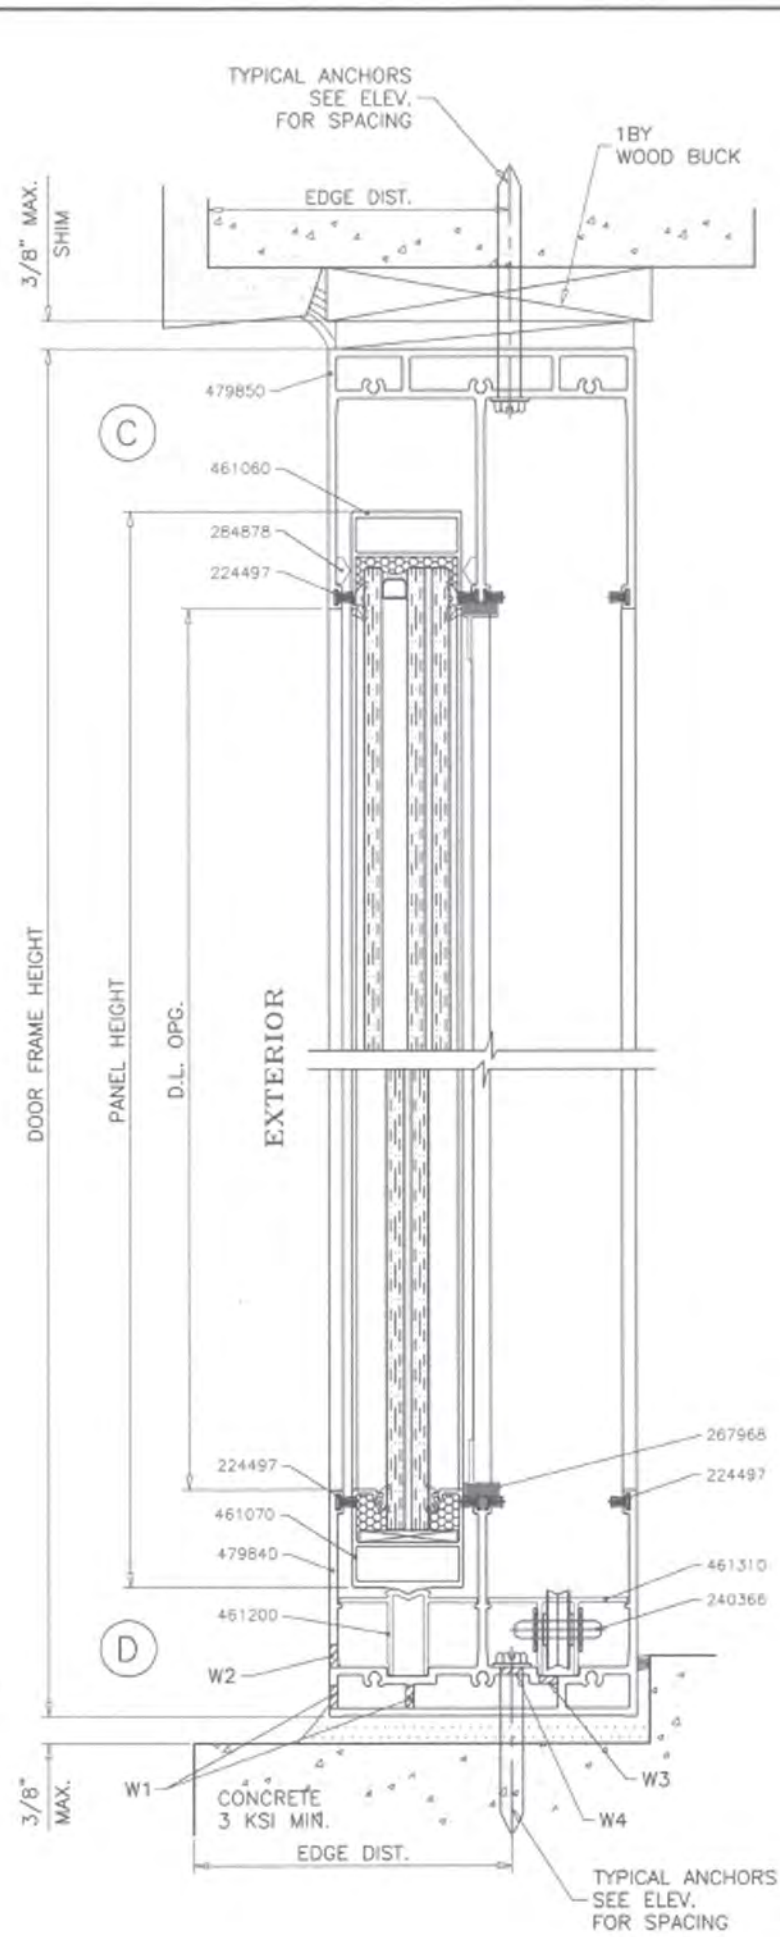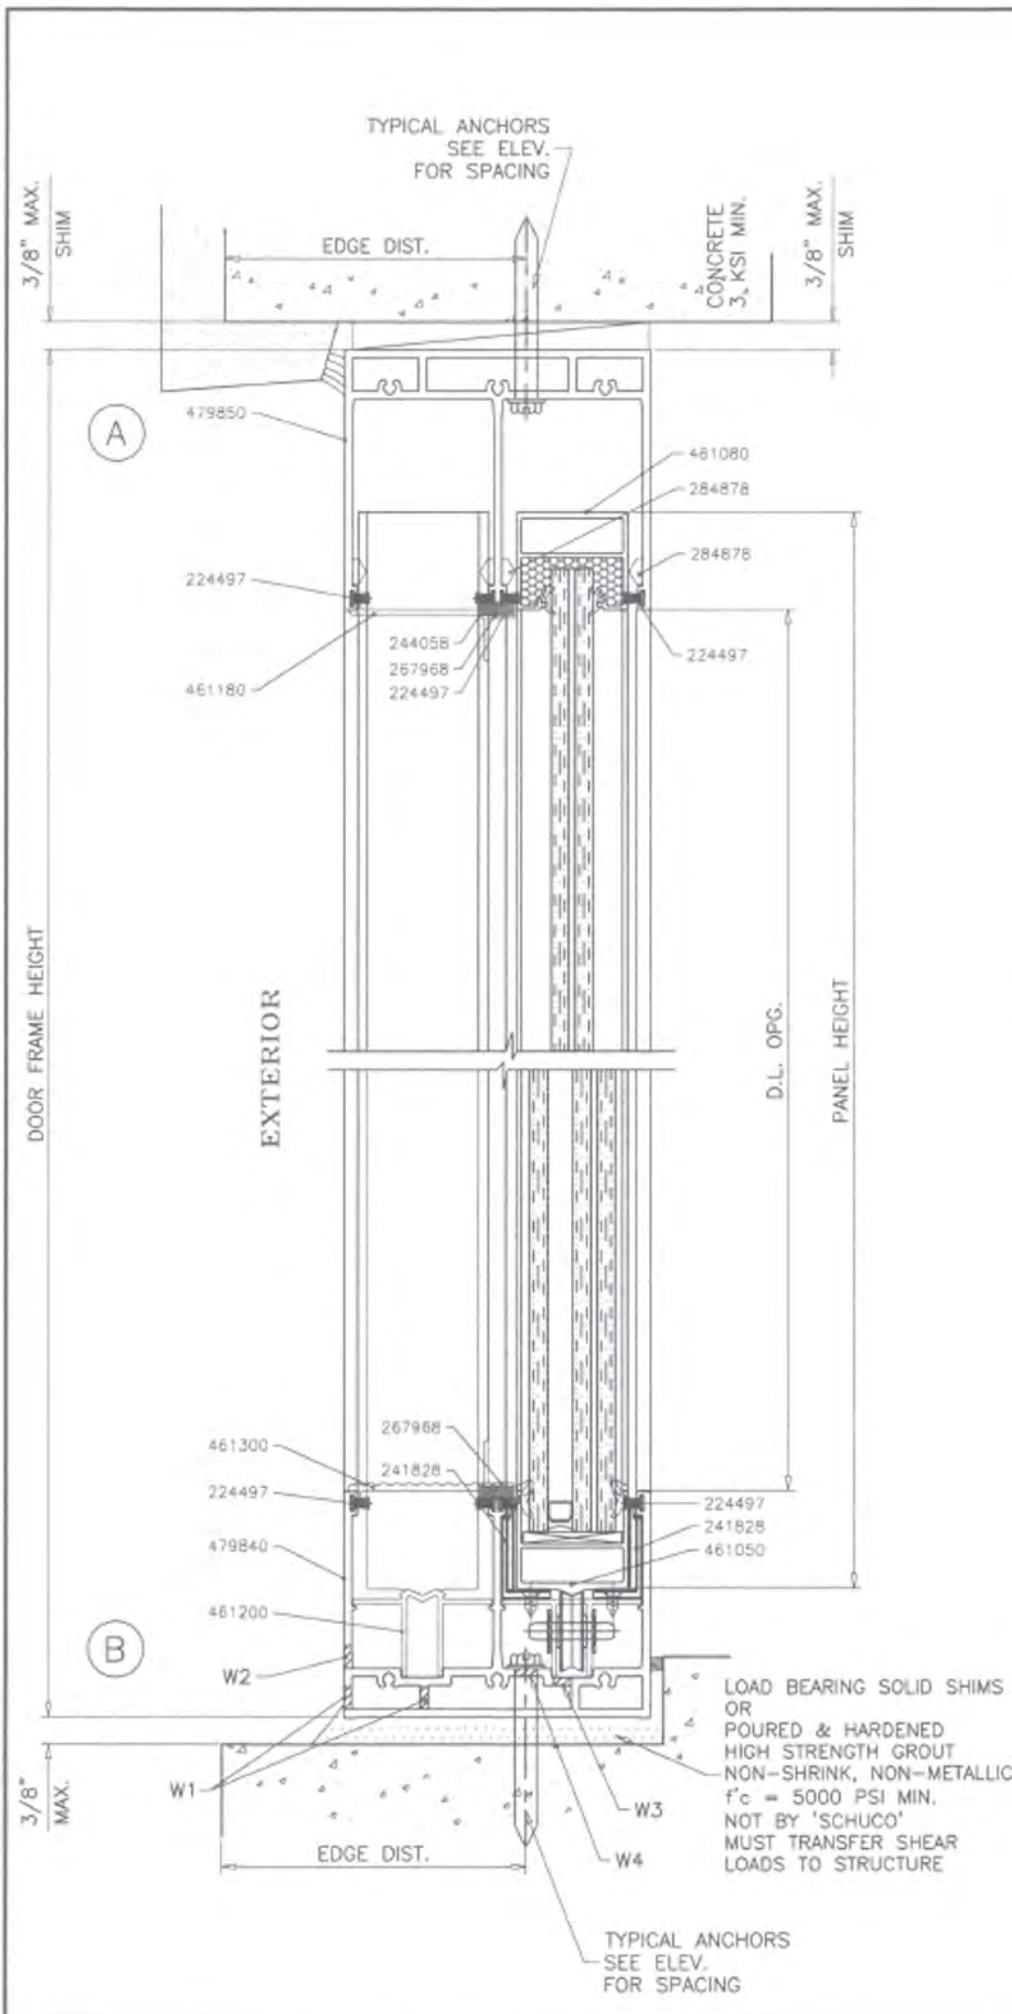


WEEPHOLES:

- W1 = 5/16" DIA. WEEP HOLES IN CLUSTERS OF 3 SPACED TOGETHER 1/2" APART. CLUSTERS LOCATED AT 4" FROM EACH END AND 8" TO THE LEFT AND RIGHT OF CENTERLINE.
- W2 = 5/16" DIA. WEEP HOLES IN CLUSTERS OF 3 SPACED TOGETHER 1/2" APART. CLUSTERS LOCATED AT 26" FROM EACH END AND 22" O.C.
- W3 = 1/4" DIA. WEEP HOLES IN CLUSTERS OF 3 SPACED TOGETHER 1/2" APART. CLUSTERS LOCATED AT 8" FROM EACH END AND 34-5/16" O.C.
- W4 = 5/16" DIA. WEEP HOLES IN CLUSTERS OF 3 SPACED TOGETHER 1/2" APART. CLUSTERS LOCATED AT 8" FROM EACH END AND 34-5/16" O.C.

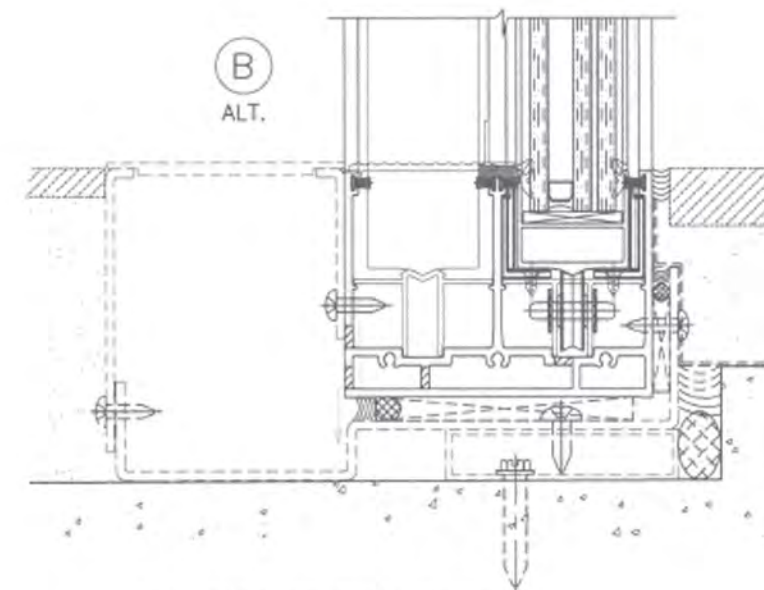

NOT PART OF THIS APPROVAL
DRAINAGE TO BE DESIGNED SEPARATELY
FOR WATER INFILTRATION RESISTANCE

2 TRACK FRAMES

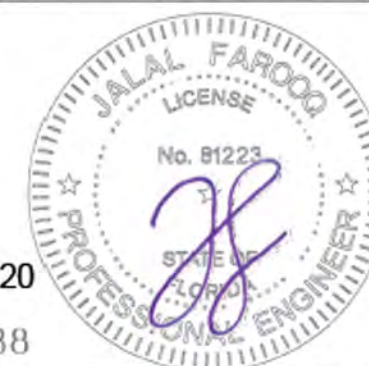

Sealed: 9/15/20

FL #27938

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL (305) 262-6978 FAX (305) 262-6978
COMP-ANL 18-74F-SUL




ASS 39 PD.NI ALUM SLIDING GLASS DOOR (L.M.I.)

Schuco USA L.L.P.
240 Pane Road
Newington, CT. 06111
Phone: (860) 666-0505 Fax: (860) 616-0186

revisions:	no	date	by	description

date: 07-31-18
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
18-74F
sheet 8 of 17

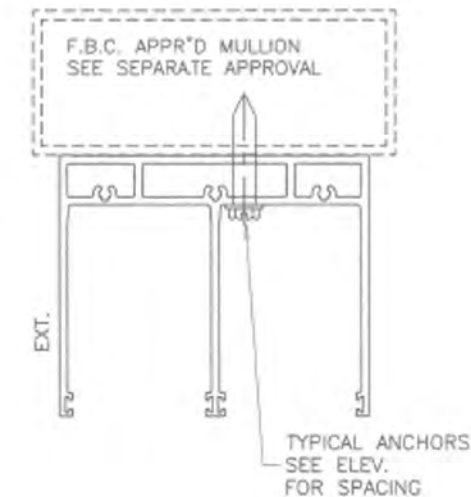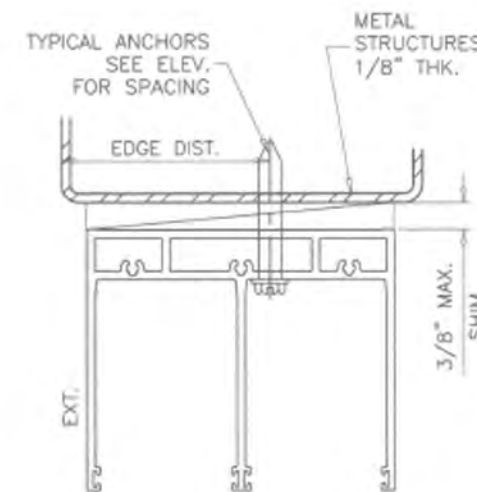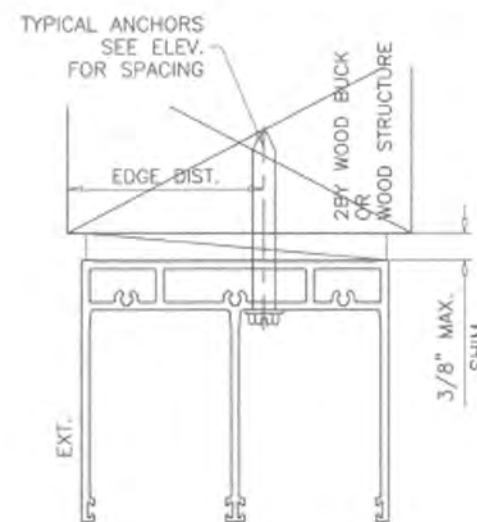

1BY OR 2BY WOOD BUCKS AND METAL STRUCTURE NOT BY "SCHUCO"
MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

TYPE 'A' - 5/16" DIA. ULTRACON BY 'DEWALT' ($F_u=177$ KSI, $F_y=155$ KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-1/2" MIN. PENETRATION INTO WOOD (HEAD/JAMBS)

THRU 1BY BUCKS INTO CONC. OR BLOCKS
1-1/2" MIN. EMBED INTO CONCRETE (HEAD/JAMBS)
1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)

TYPE 'B' - 5/16" DIA. ULTRACON BY 'DEWALT' ($F_u=177$ KSI, $F_y=155$ KSI)
DIRECTLY INTO CONCRETE OR BLOCKS
1-1/2" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)
1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)

TYPE 'C' - 5/16" DIA. TEKS OR SELF-DRILLING SCREWS (GRADE 5 CRS)
 INTO F.B.C. APPROVED MULLIONS
 OR
 INTO METAL STRUCTURES (HEAD/JAMBS)
 (3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS
 ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
 STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

CRITICAL EDGE DISTANCE

INTO CONCRETE AND BLOCKS = 3-1/8" MIN.
 INTO WOOD STRUCTURE = 1-1/4" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD OR JAMBS $SG = 0.55$ MIN.
CONCRETE AT HEAD, SILL OR JAMBS $f'_c = 3000$ PSI MIN.
C-90 HOLLOW/FILLED BLOCK AT JAMBS $f'_m = 2000$ PSI MIN.

2 TRACK FRAMES



Sealed: 9/15/20

FL #27938

ASS 39 PD.NI ALUM SLIDING GLASS DOOR (L.M.I.)

Schuco USA L.L.P.

Schuco USA L.L.P.
240 Pane Road
Newington, CT 06111

Phone: (860) 666-0505

Fax: (860) 616-0188

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
(C.A.N. 3538)
TEL (305) 264-8300 FAX (305) 262-6978

(305) 262-6978
COMP-ANL\18-74F-SUL

no	date	by	description
revisions:			

date: 07-31-18



dr. by: TARIQ

chk. by:

drawing no.

18-74F

sheet 9 of 17

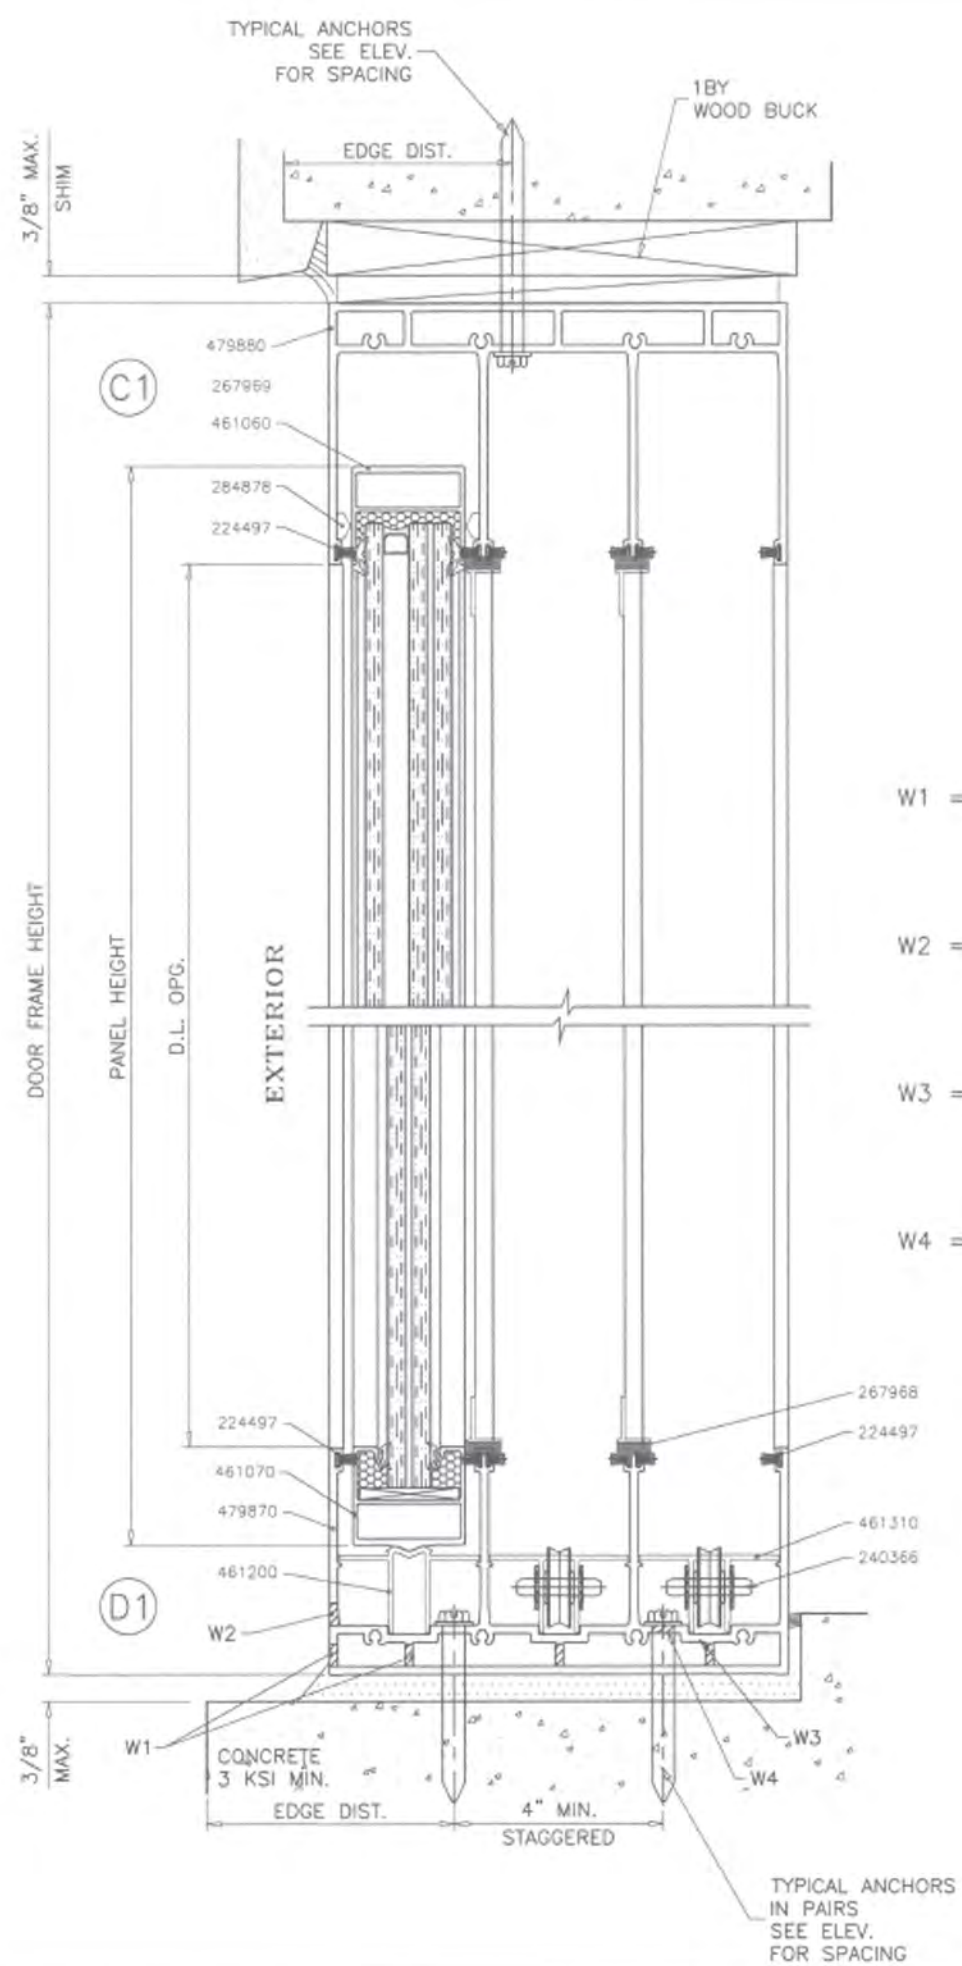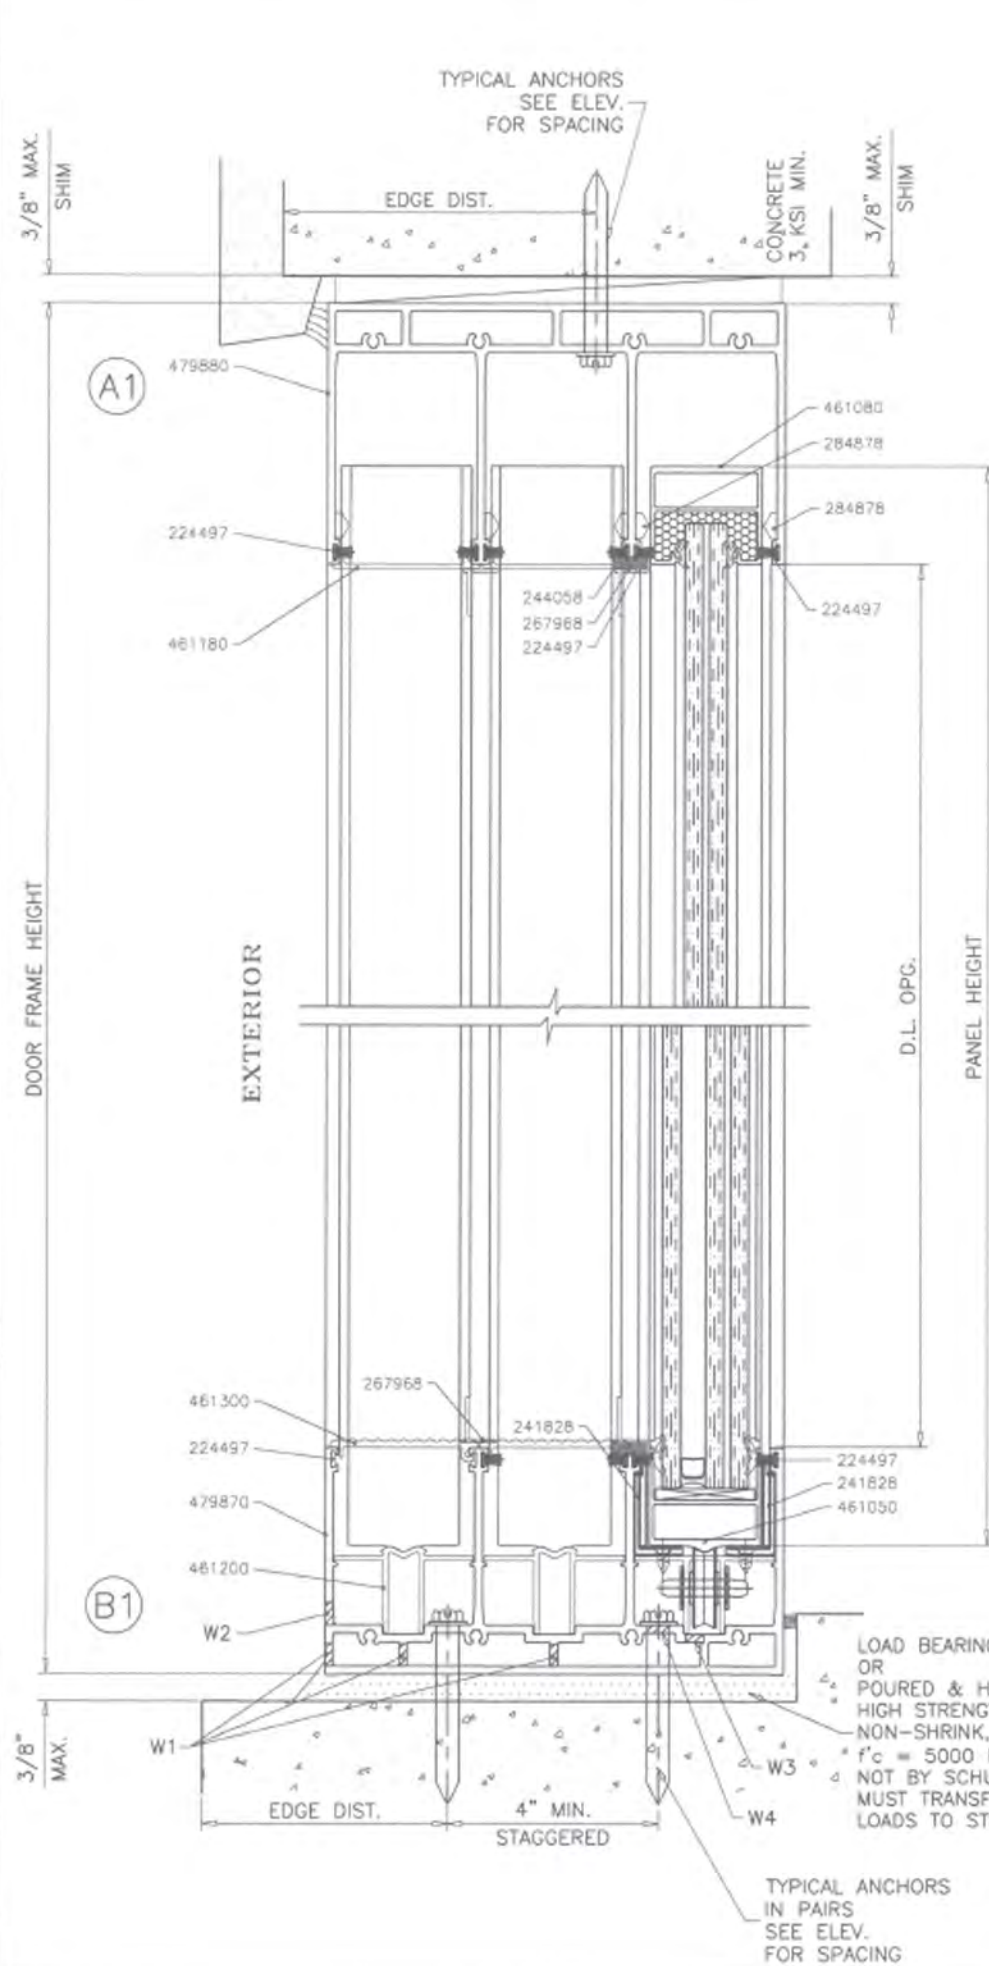

WEEPHOLES:

- W1 = 5/16" DIA. WEEP HOLES IN CLUSTERS OF 3 SPACED TOGETHER 1/2" APART. CLUSTERS LOCATED AT 4" FROM EACH END AND 8" TO THE LEFT AND RIGHT OF CENTERLINE.
- W2 = 5/16" DIA. WEEP HOLES IN CLUSTERS OF 3 SPACED TOGETHER 1/2" APART. CLUSTERS LOCATED AT 26" FROM EACH END AND 22" O.C.
- W3 = 1/4" DIA. WEEP HOLES IN CLUSTERS OF 3 SPACED TOGETHER 1/2" APART. CLUSTERS LOCATED AT 8" FROM EACH END AND 34-5/16" O.C.
- W4 = 5/16" DIA. WEEP HOLES IN CLUSTERS OF 3 SPACED TOGETHER 1/2" APART. CLUSTERS LOCATED AT 8" FROM EACH END AND 34-5/16" O.C.

3 TRACK FRAMES




Sealed: 9/15/20

FL #27938




AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANI 18-74F-SUL

ASS 39 PD.NI ALUM SLIDING GLASS DOOR (L.M.I.)
Schuco USA L.L.P.
240 Pane Road
Newington, CT. 06111
Phone: (860) 666-0505 Fax: (860) 616-0188

revisions:	no	date	by	description
date:	07-31-18			
scale:	3/8" = 1"			
dr. by:	TARIQ			
chk. by:				
drawing no.	18-74F			
sheet	11 of 17			

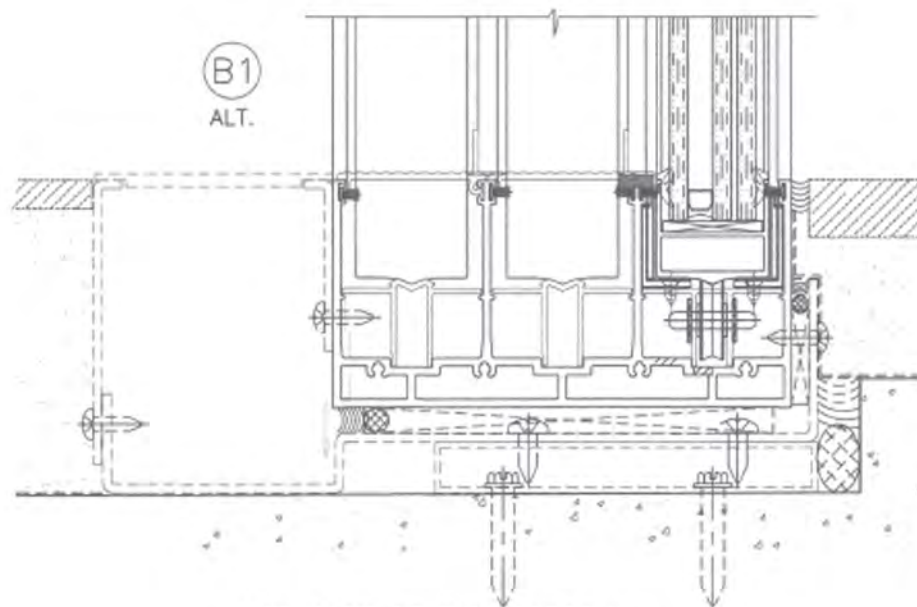

NOT PART OF THIS APPROVAL
DRAINAGE TO BE DESIGNED SEPARATELY
FOR WATER INFILTRATION RESISTANCE

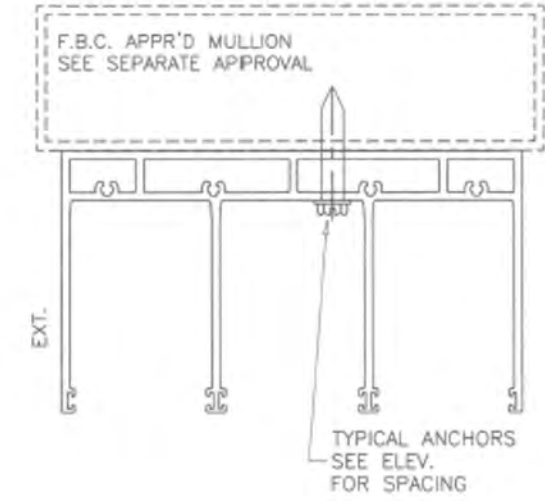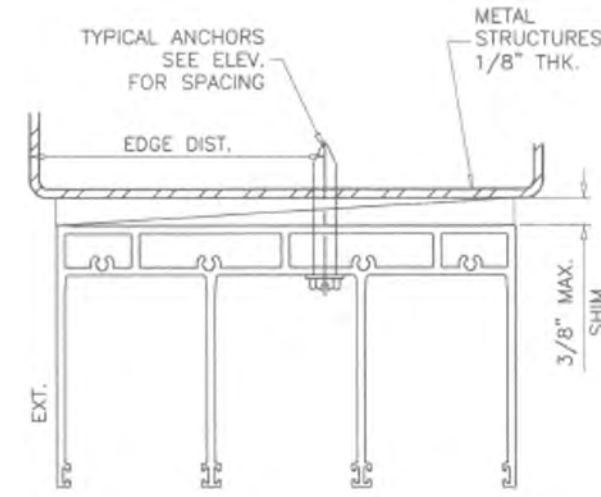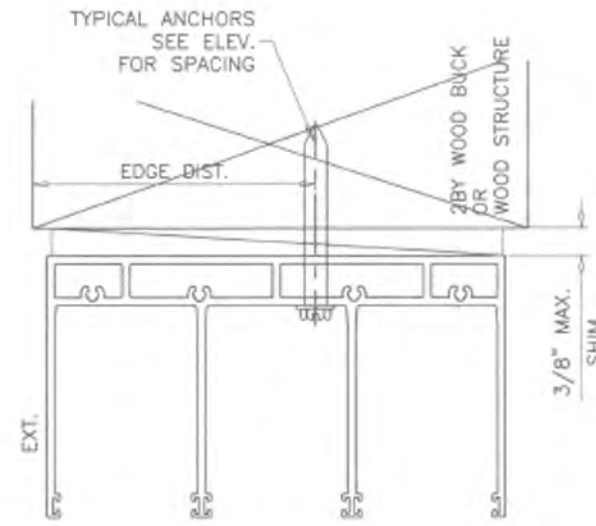

3 TRACK FRAMES



Sealed: 9/15/20

FL #27938





ASS 39 PD.NI ALUM SLIDING GLASS DOOR (L.M.I.)

Schuco USA L.L.P.
240 Pane Road
Newington, CT. 06111
Phone: (860) 666-0505 Fax: (860) 616-0188


revisions:	
no	date by description

date: 07-31-18
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:
drawing no.
18-74F
sheet 12 of 17

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL\18-74F-SUL

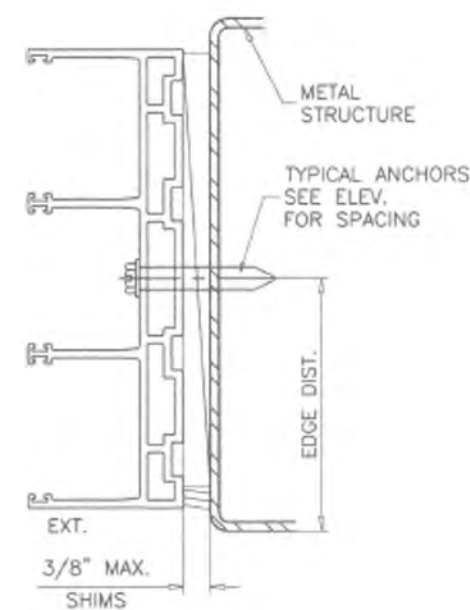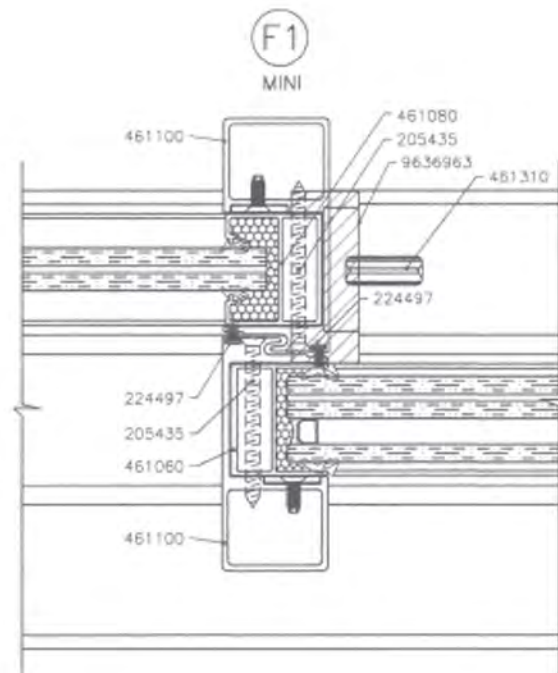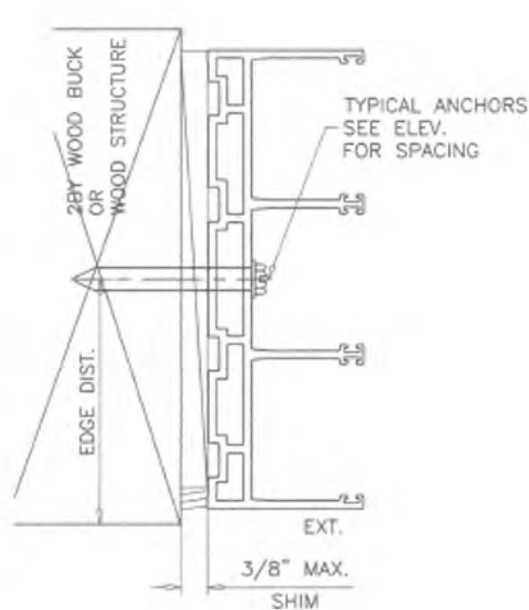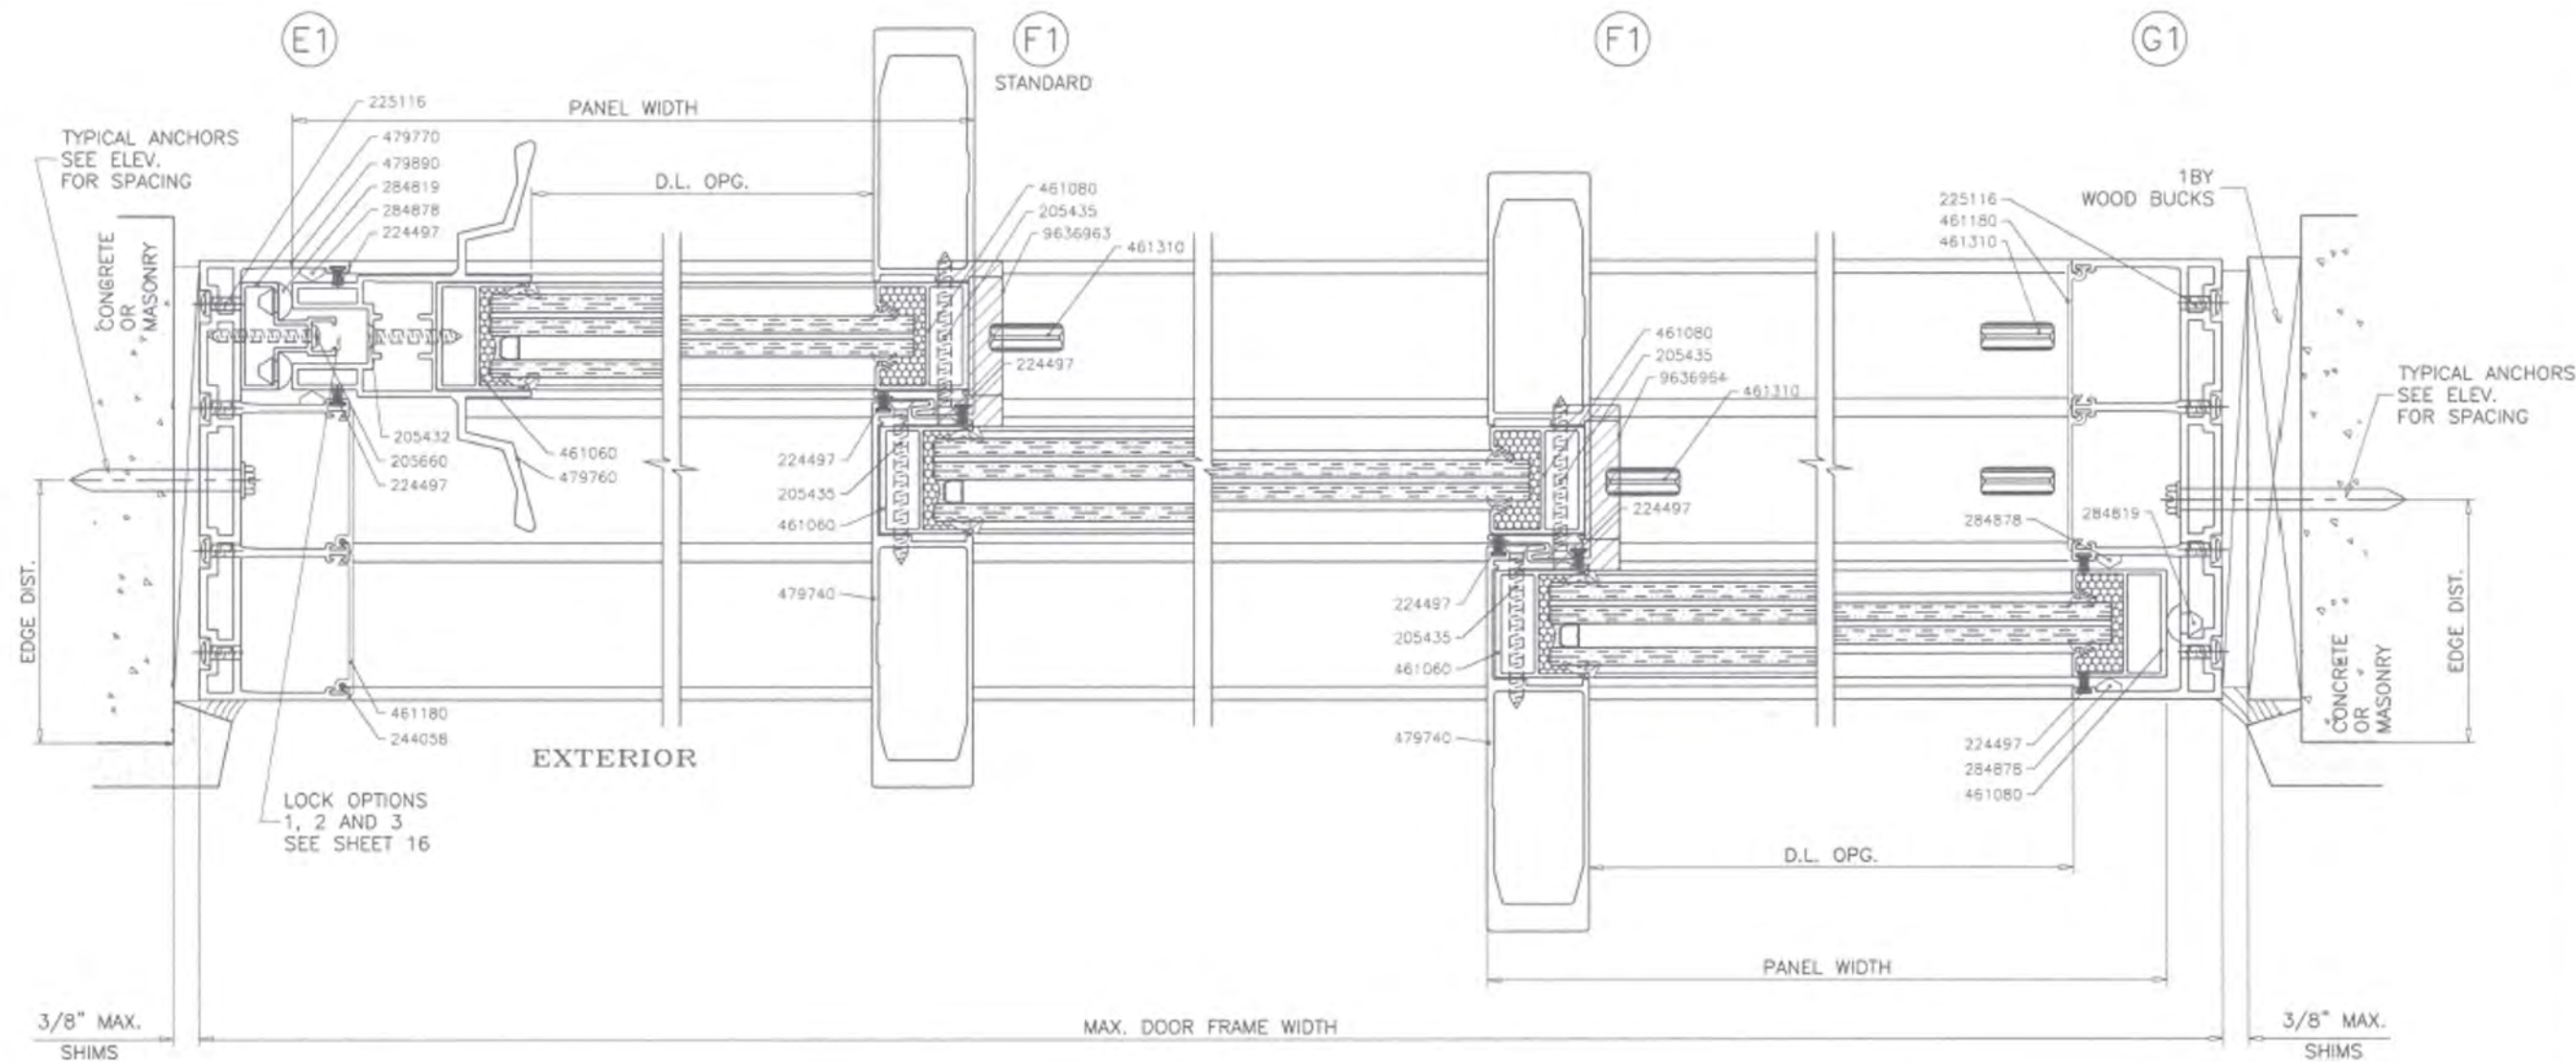

3 TRACK FRAMES

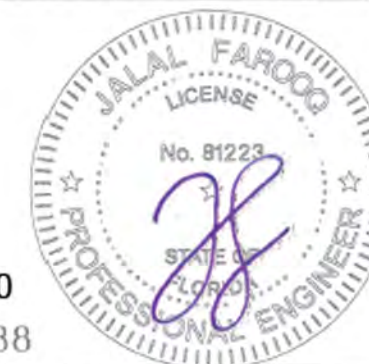


Sealed: 9/15/20
FL #27938


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
(C.A.N. 3538)
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL\18-74F-SUL

ASS 39 PD.NI ALUM SLIDING GLASS DOOR (L.M.I.)
Schuco USA L.L.P.
240 Pane Road
Newington, CT. 06111
Phone: (860) 666-0505 Fax: (860) 616-0188

revisions:	no	date	by	description
date:	07-31-18	scale:	3/8" = 1"	
dr. by:	TARIQ	chk. by:		
drawing no.	18-74F	sheet	13 of 17	

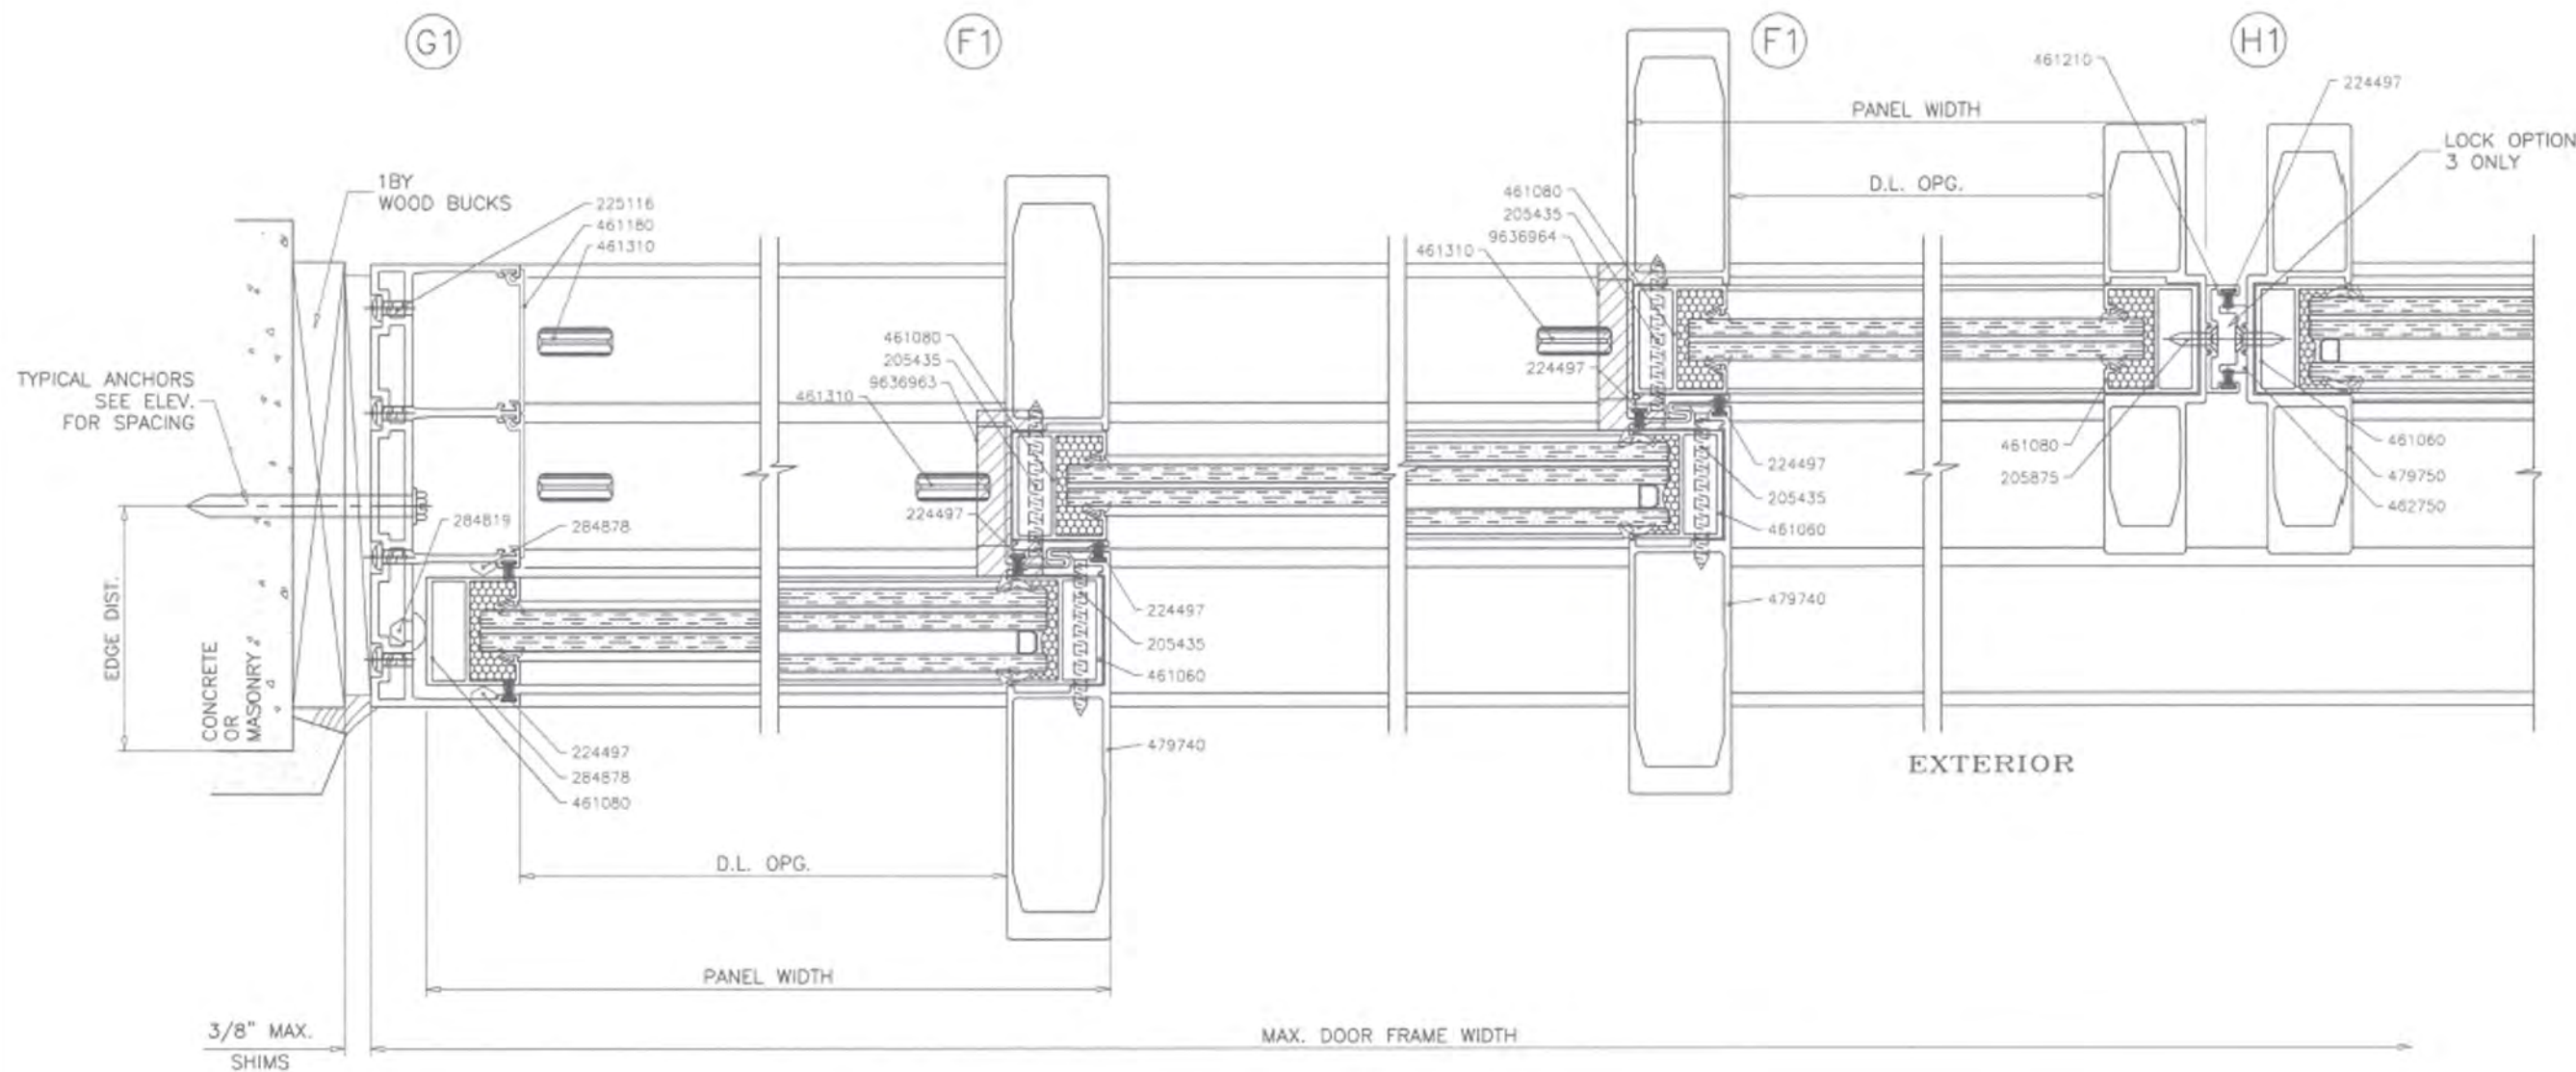

3 TRACK FRAMES

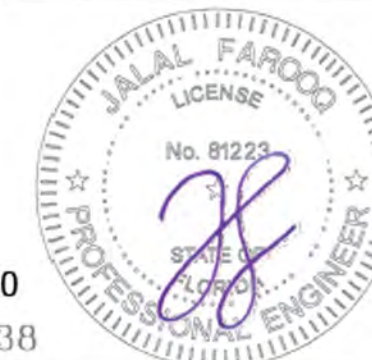

Sealed: 9/15/20























FL #27938

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173 (C.A.N. 3538)
 TEL (305) 264-8100 FAX (305) 262-6978
 COMP-ANL\18-74F-SUL

ASS 39 PD.NI ALUM SLIDING GLASS DOOR (L.M.I.)

Schuco USA L.L.P.
 240 Pane Road
 Newington, CT. 06111
 Phone: (860) 666-0505 Fax: (860) 616-0188

revisions:		no date by description	
date:	07-31-18	no	date
scale:	3/8" = 1"	by	description
dr. by:	TARIO		
chk. by:			
drawing no.	18-74F		
sheet	14 of 17		

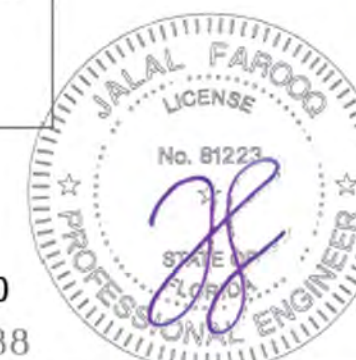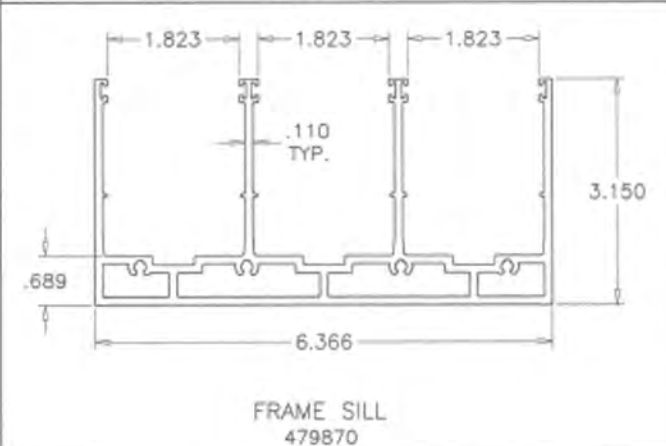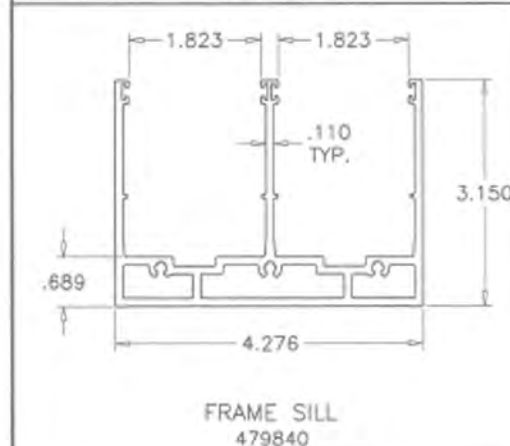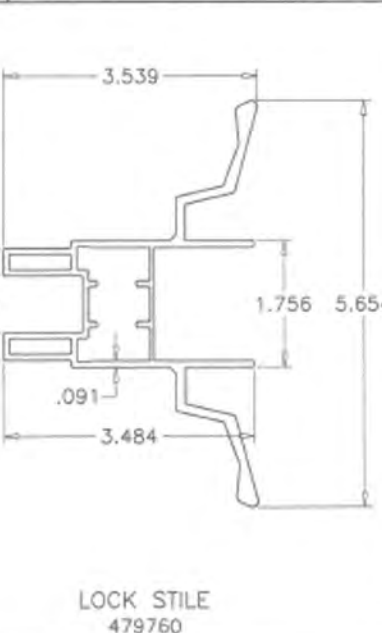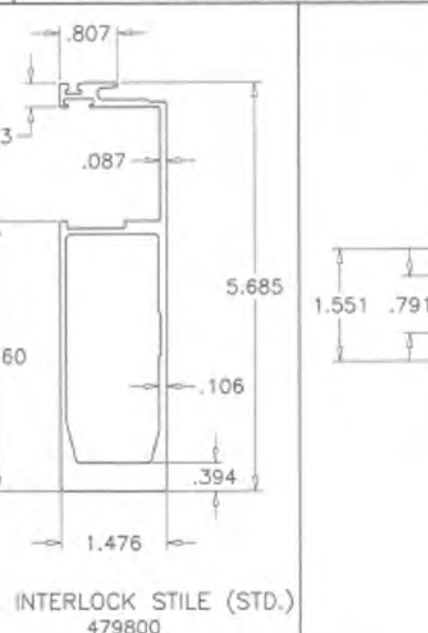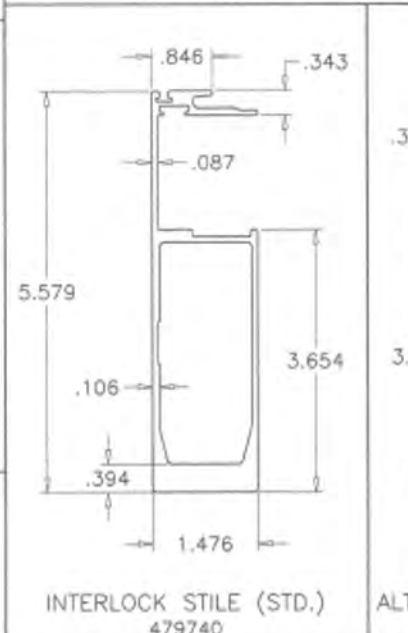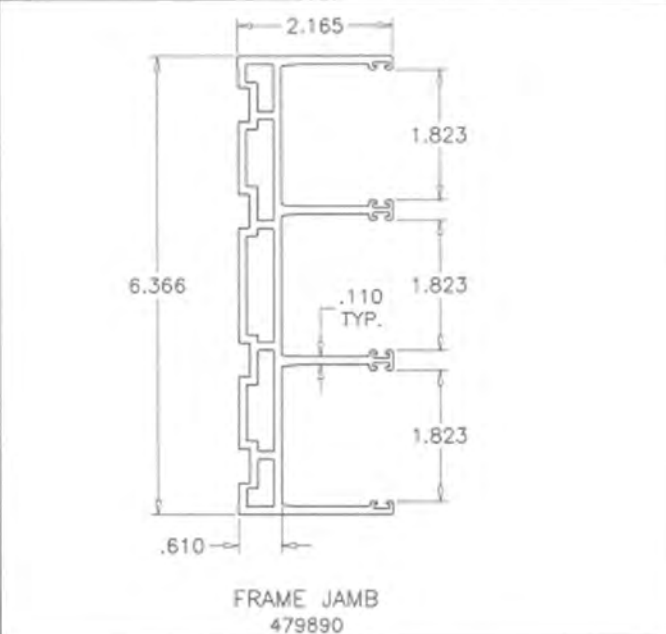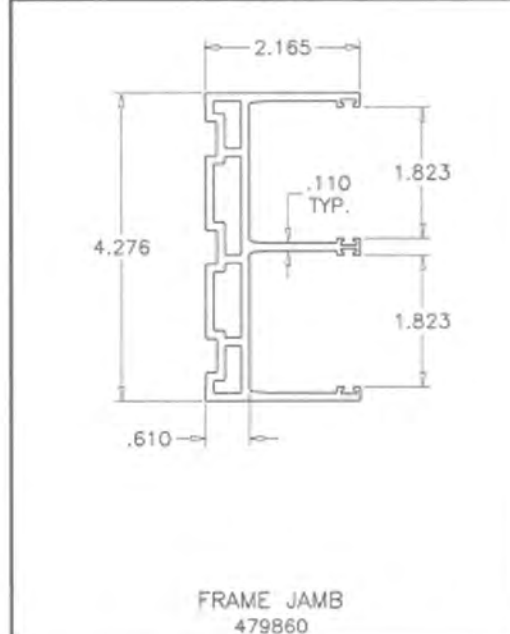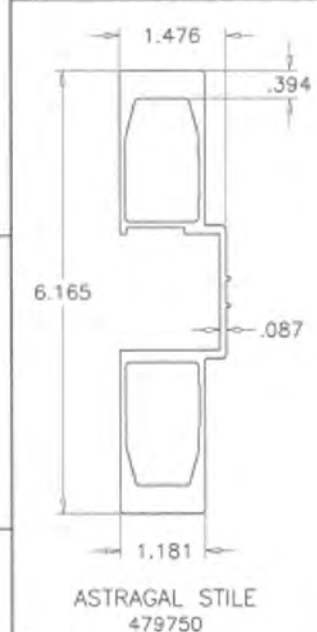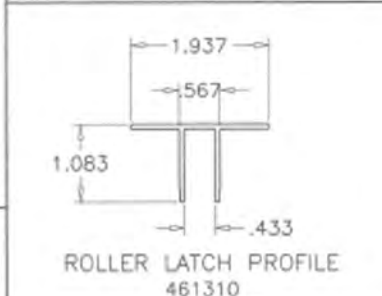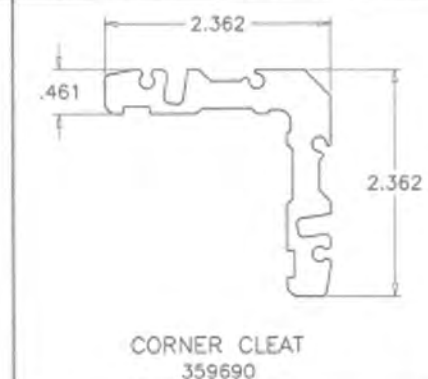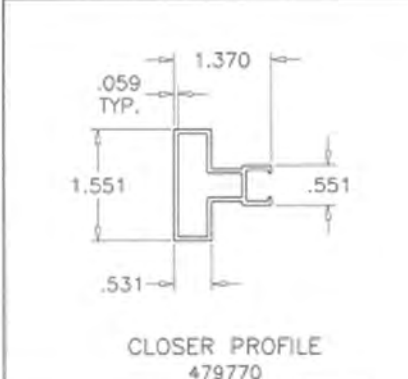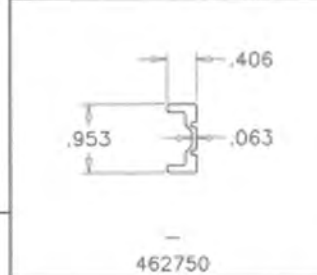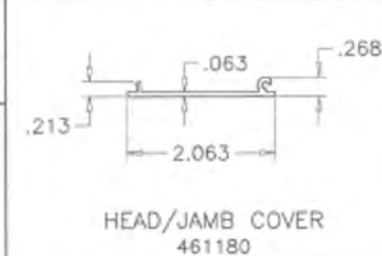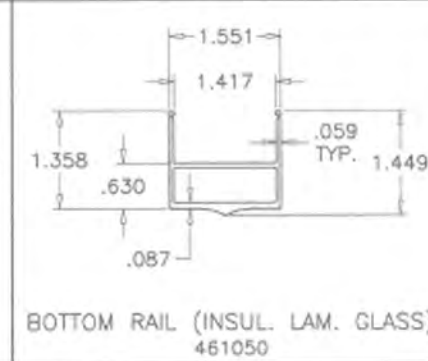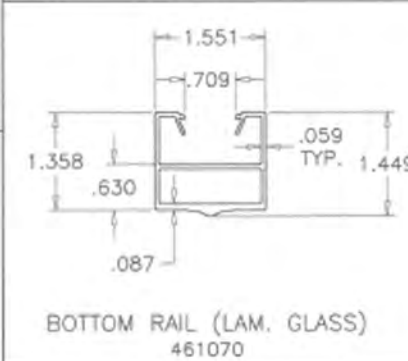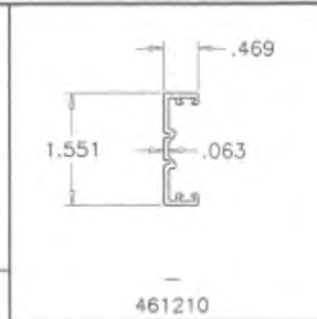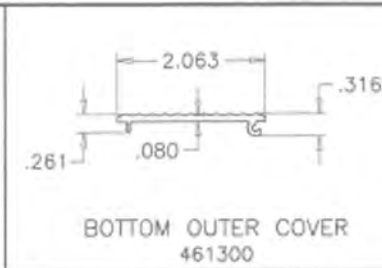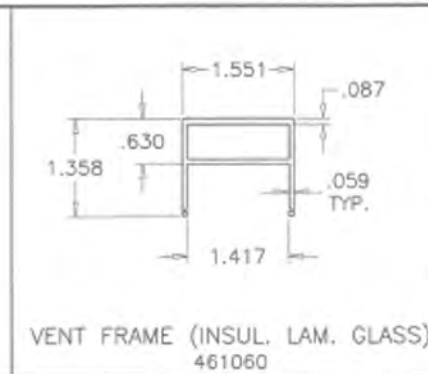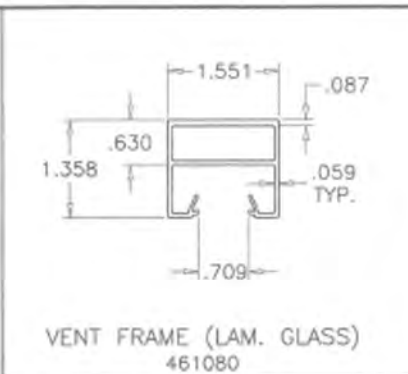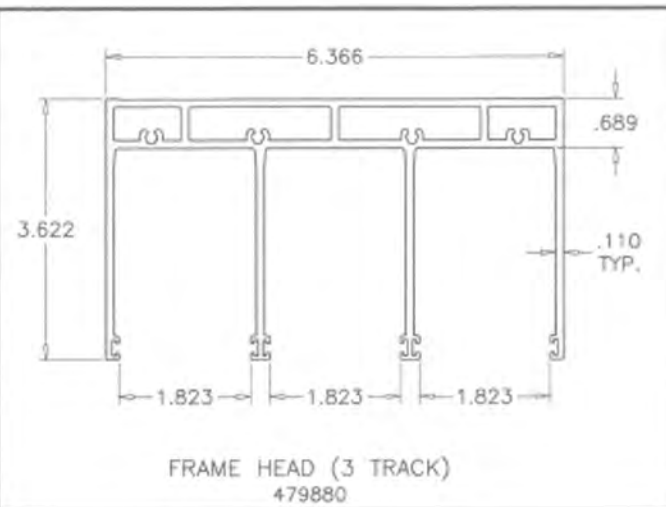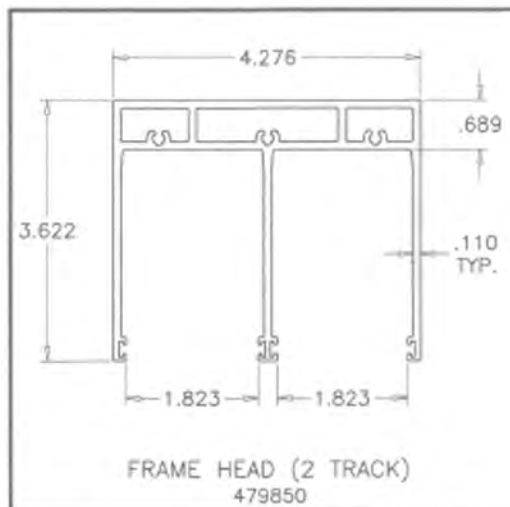

Sealed: 9/15/20
FL #27938

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL (305) 262-6978 FAX (305) 262-6978
COMP-ANL 18-74F-SUL

ASS 39 PD.NI ALUM SLIDING GLASS DOOR (L.M.I.)
Schuco USA L.L.P.
240 Pane Road
Newington, CT. 06111
Phone: (860) 666-0505 Fax: (860) 616-0188

revisions:	no	date	by	description

date: 07-31-18
scale: 3/8" = 1"
dr. by: TARIQ
chk. by:

drawing no.
18-74F
sheet 15 of 17

PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
284878	-	CENTERING PIECE	EPDM	DUROMETER 80±5 SHORE A
359690	-	CORNER CLEAT PROFILE	6063-T6	-
461070	-	BOTTOM RAIL (LAM. GLASS)	6063-T6	-
461050	-	BOTTOM RAIL (INSUL. LAM. GLASS)	6063-T6	-
461060	-	VENT FRAME (LAM. GLASS)	6063-T6	-
461080	-	VENT FRAME (INSUL. LAM. GLASS)	6063-T6	-
461180	-	HEAD/JAMB COVER	6063-T6	-
461200	-	SPACER VENT REBATE	6063-T6	-
461300	-	BOTTOM COVER	6063-T6	-
461310	-	ROLLER LATCH PROFILE	6063-T6	-
479740	-	INTERLOCK STILE (STANDARD)	6063-T6	-
461100	-	INTERLOCK STILE (MINI)	6063-T6	-
479800	-	ALT. INTERLOCK STILE (STANDARD)	6063-T6	-
479760	-	LOCK STILE	6063-T6	-
479750	-	ASTRAGAL STILE	6063-T6	-
461210	-	-	6063-T6	-
462750	-	-	6063-T6	-
479770	-	CLOSER PROFILE	6063-T6	-
479840	-	FRAME SILL (2 TRACK)	6063-T6	-
479870	-	FRAME SILL (3 TRACK)	6063-T6	-
479850	-	FRAME HEAD (2 TRACK)	6063-T6	-
479880	-	FRAME HEAD (3 TRACK)	6063-T6	-
479860	-	FRAME JAMB (2 TRACK)	6063-T6	-
479890	-	FRAME JAMB (3 TRACK)	6063-T6	-
240366	-	ROLLER	ST. STEEL	-
254519	-	DOOR STOP, BLACK	6063-T6	-
276827	-	LOCKING LEVER LH9005	6063-T6	-
276931	-	DOOR STOP RAL 9005	-	-
281151	-	SINGLE POINT LOCK	-	-
281152	-	3 POINT LOCK	-	-
281157	-	STRIKE PLATE	ST. STEEL	-
224497	-	BRUSH SEAL	WOOL	-
284068	-	GLAZING GASKET 3MM (LAM. GLASS)	EPDM	DUROMETER 80±5 SHORE A
244203	-	GLAZING GASKET 3MM (INSUL. LAM. GLASS)	EPDM	DUROMETER 80±5 SHORE A
278502	-	EDGE COVER 9005	-	-
278576	-	SEAL KIT	-	-
284819	-	REBATE DOOR STOP	-	-
205080	-	C. SUNK SCREW B3.9X13	ST. STEEL	-
205432	-	C. SUNK SCREW B4.8X35	ST. STEEL	-
205435	-	C. SUNK SCREW B4.8X60	ST. STEEL	-
205660	-	OH SCREW S.B4.2X38 A4	ST. STEEL	-
205666	-	DIN7982DACRO. B3.9X45	ST. STEEL	-
225010	-	C. SUNK SCREW #10 X 5/8"	ST. STEEL	-
225116	-	S-D.SWST4.8X45TORX25	ST. STEEL	-
225198	-	SPECIAL SCREW M6	ST. STEEL	-
244058	-	GASKET CORD 2.5MM SW	-	-
267968	-	SEAL	-	-
267990	-	MULL JOINT SEAL	-	-
9624596	-	END CAP G.BAR 9005	-	-
281776	-	END CAP STRUCT. 9005	-	-
288180	-	SPECIAL ADHESIVE	-	-
9636963	-	LEFT SIDE SPLASH GUARD, ATTACHED W/ (1) 1/4" X 3/4" PH SCREW	PVC	-
9636964	-	RIGHT SIDE SPLASH GUARD, ATTACHED W/ (1) 1/4" X 3/4" PH SCREW	PVC	-

SEALANT:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH WHITE/ALUMINUM COLORED SILICONE.

LOCKS:

OPTION #1

SURFACE MOUNT METALLIC THREE PLY DUAL HOOK LOCK AT 36" FROM BOTTOM FASTENED TO LOCK STILE WITH (2) #10 X 1-1/2" FH SELF DRILLING SCREWS

SURFACE MOUNT METALLIC KEEPER FACING LOCK AT 38" FROM BOTTOM FASTENED WITH (2) #10 X 1-1/2" FH SMS

OPTION #2

SURFACE MOUNT METALLIC 3 POINT LOCK AT 36" FROM BOTTOM FASTENED TO LOCK STILE WITH (2) #10 X 1-1/2" FH SELF DRILLING SCREWS

SURFACE MOUNT METALLIC KEEPER FACING LOCK AT 38" FROM BOTTOM FASTENED WITH (2) #10 X 1-1/2" FH SMS

OPTION #3

LOCK (279194) WITH LATCH (241849) AND RETAINING CATCH (241850) AT 36" FROM BOTTOM SHOOT BOLT (461220) ENGAGING AT SILL



Sealed: 9/15/20

FL #27938


a f c

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL (305) 262-6978 FAX (305) 262-6978
(C.A.N. 3538)


ASS 39 PD.NI ALUM SLIDING GLASS DOOR (L.M.I.)

Schuco USA L.L.P.
240 Pane Road
Newington, CT. 06111
Phone: (860) 666-0505 Fax: (860) 616-0188


revisions:		date: 07-31-18		scale: 3/8" = 1"		dr. by: TARIQ		chk. by:	
no	date	by	description						
drawing no.				18-74F					
sheet 16 of 17									

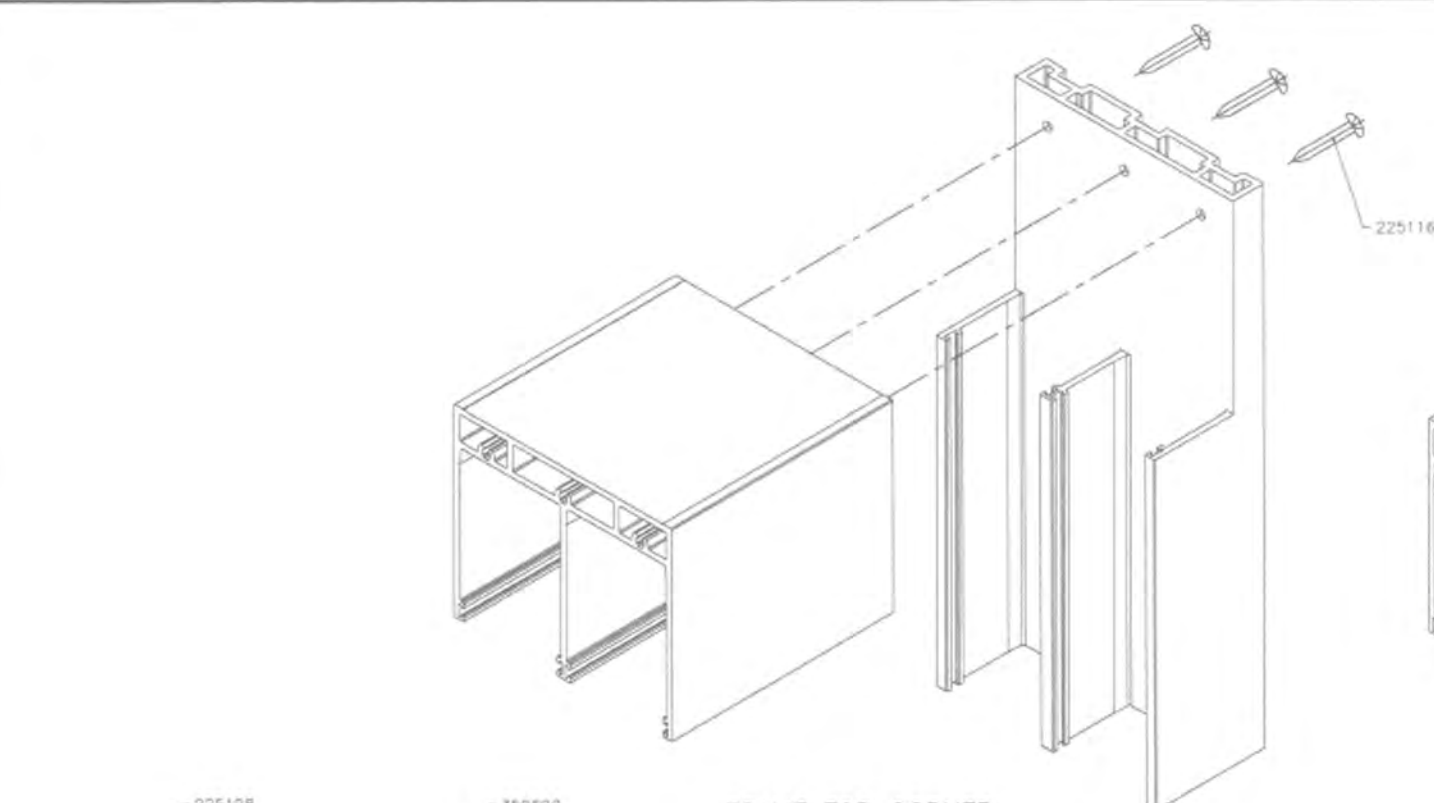


FRAME TOP CORNER
(2 TRACK FRAME)

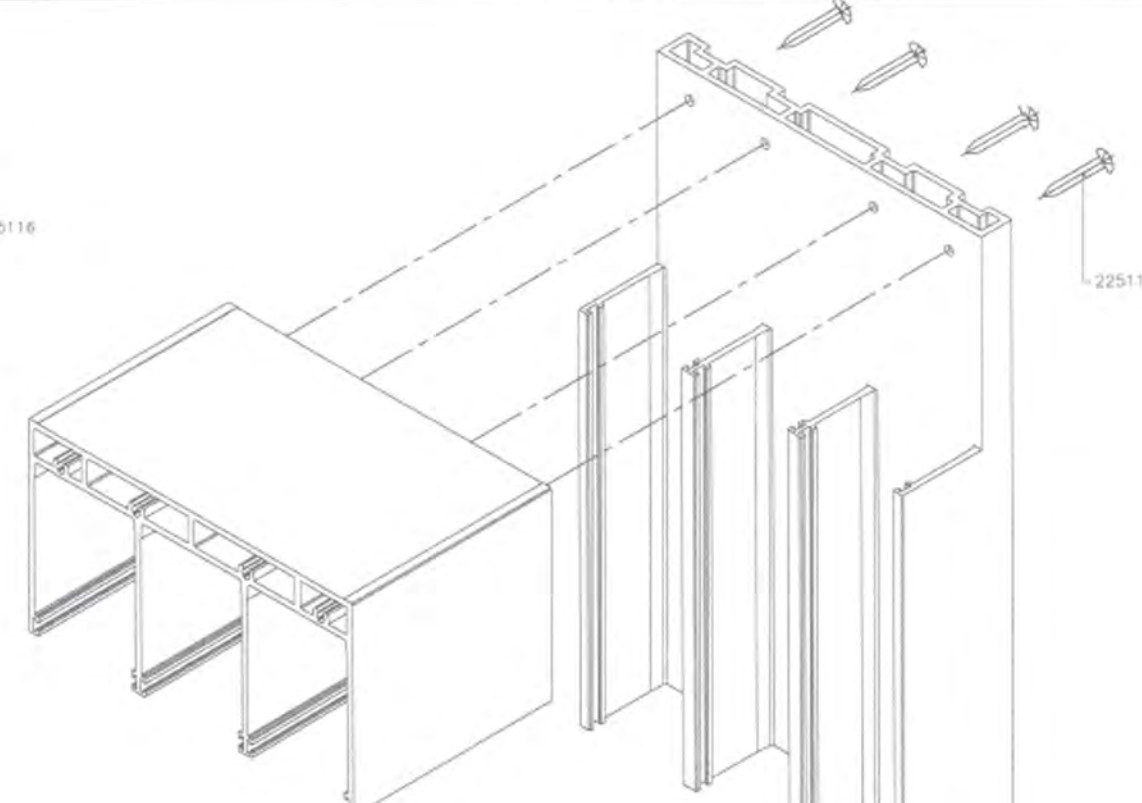


FRAME TOP CORNER
(3 TRACK FRAME)

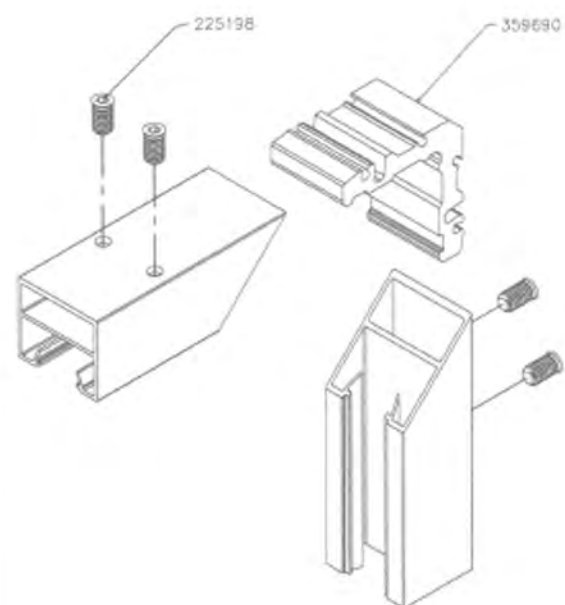

PANEL TOP/BOTTOM CORNER

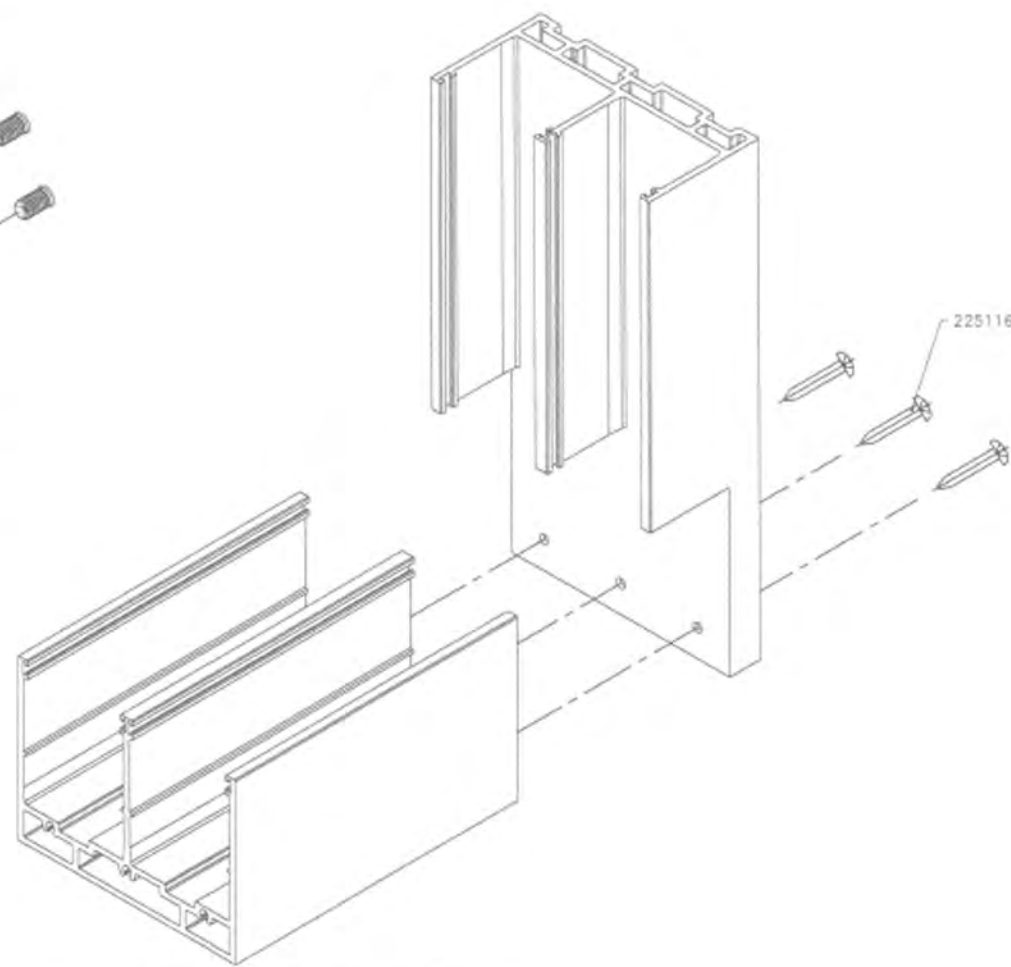

FRAME BOTTOM CORNER
(2 TRACK FRAME)

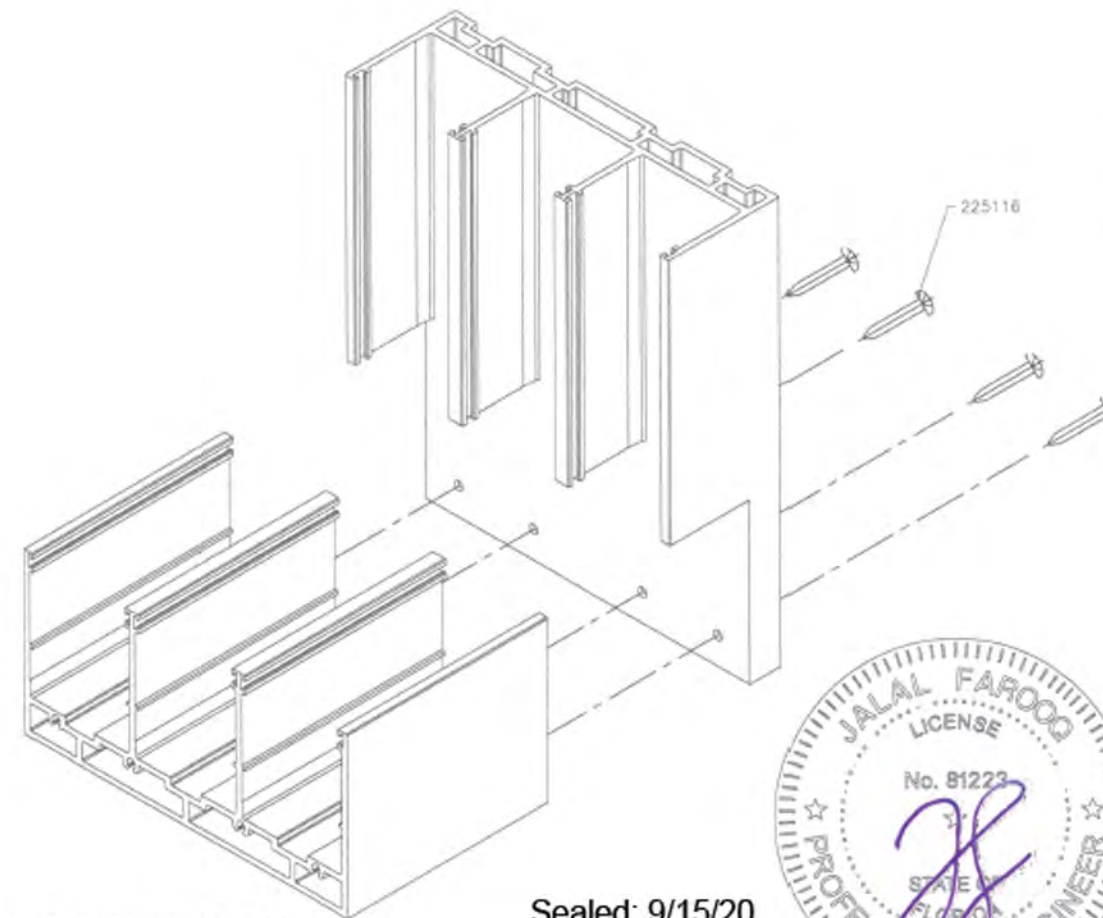

FRAME BOTTOM CORNER
(3 TRACK FRAME)

Sealed: 9/15/20

FL #27938



afc

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL 18-74F-SUL

ASS 39 PD.NI ALUM SLIDING GLASS DOOR (L.M.I.)

Schuco USA L.L.P.
240 Pane Road
Newington, CT. 06111
Phone: (860) 666-0505 Fax: (860) 616-0188

revisions:		by description
no	date	

date: 07-31-18	scale: 3/8" = 1"	dr. by: TARIQ	chk. by:
----------------	------------------	---------------	----------

drawing no.
18-74F

sheet 17 of 17