



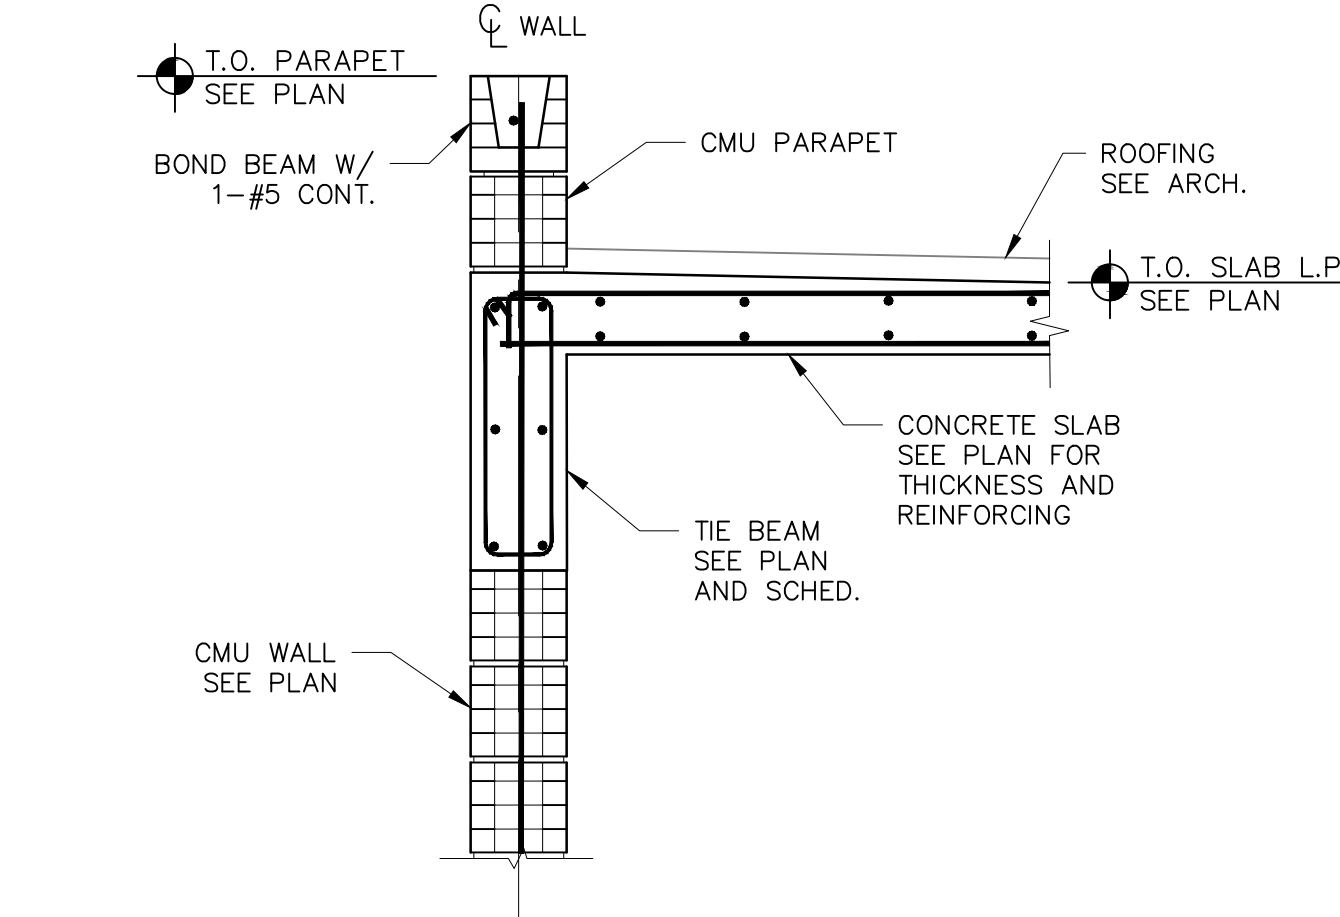


TYPICAL DETAIL
CONCRETE ROOF SLAB TO CMU WALL
CONNECTION

(10)

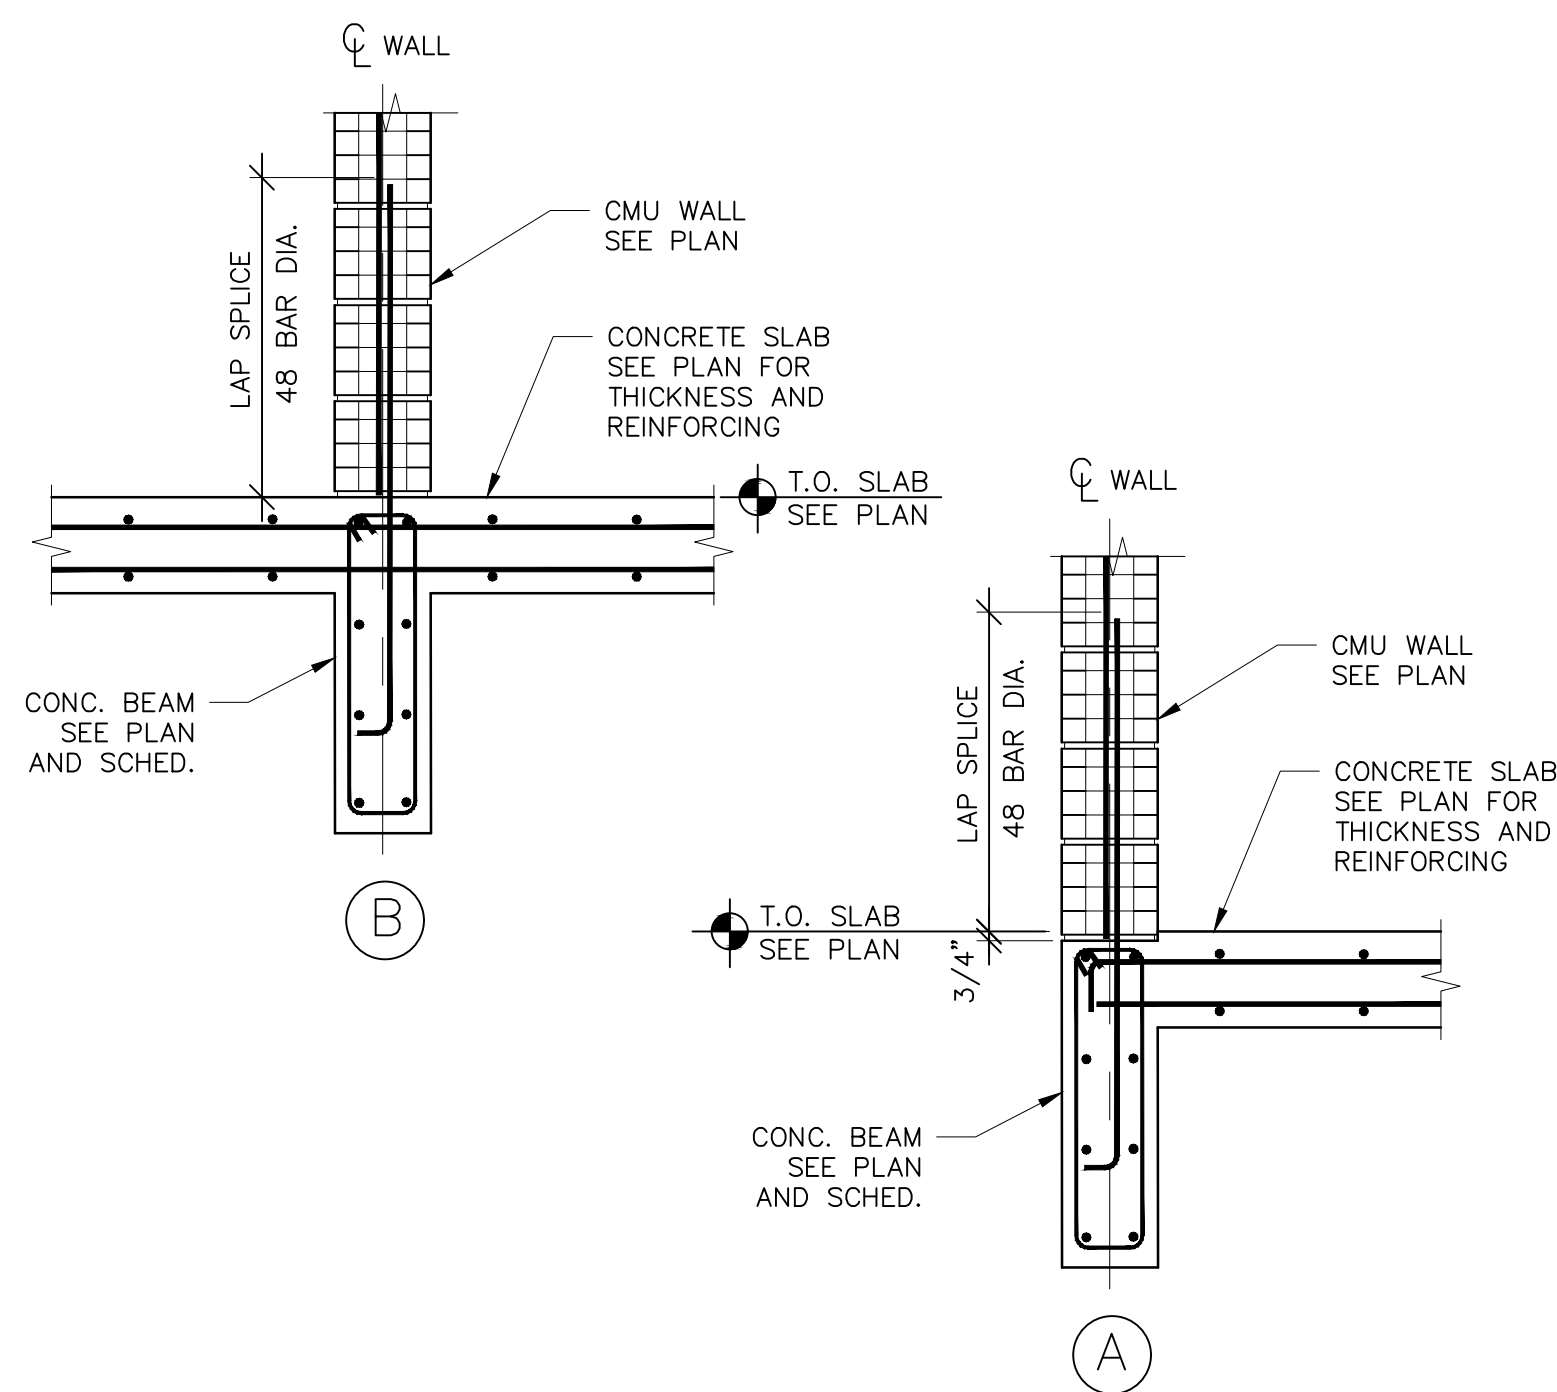

TYPICAL DETAIL
CMU WALL TO CONCRETE BEAM
CONNECTION

(7)

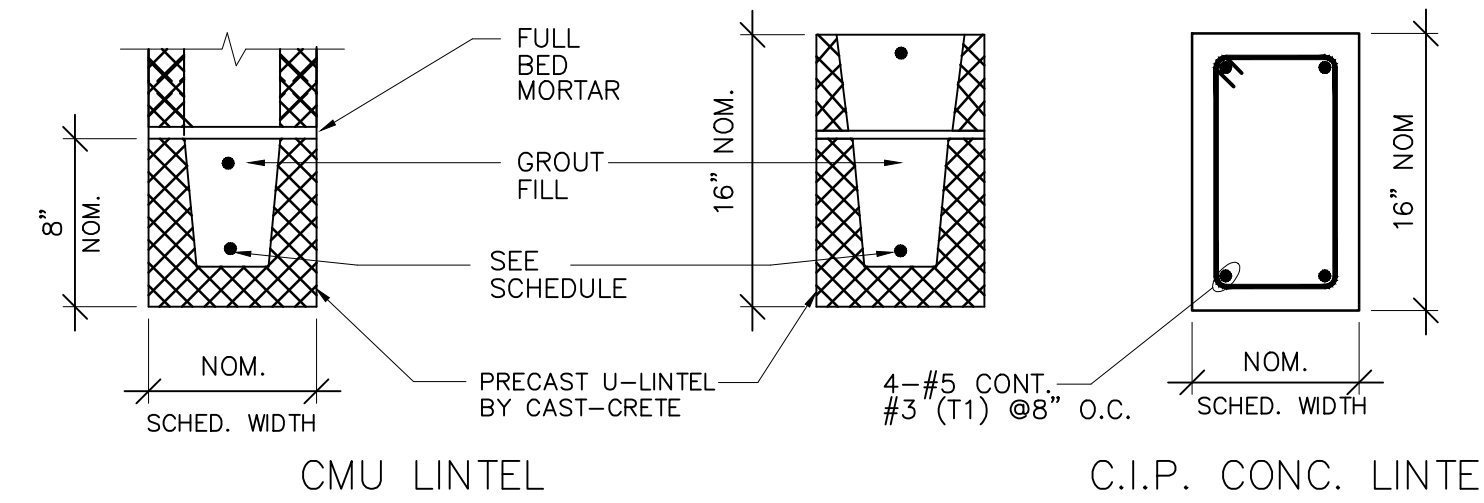


8" CMU LINTEL SCHEDULE

CLEAR SPAN	LINTEL SIZE	REIN. STEEL
3'-4"	8"x8"	1-#3
4'-0"	8"x8"	2-#3
4'-8"	8"x8"	2-#4
5'-4"	8"x8"	2-#4
6'-0"	8"x16"	4-#4
6'-8"	8"x16"	4-#4
7'-4"	8"x16"	4-#4
8'-0"	8"x16"	4-#4

- NOTES:
1. SEE ARCH'L DRAWINGS FOR SIZE AND LOCATION OF OPENINGS.
 2. PROVIDE MINIMUM OF 4" OF BEARING EACH SIDE OF OPENING.
 3. REINFORCING SHALL PROJECT A MINIMUM OF 16" INTO BEARING.
 4. MINIMUM MASONRY COMPRESSIVE STRENGTH, f'_m , SHALL BE 1500 P.S.I.
 5. CAST-IN-PLACE CONCRETE LINTELS SHALL BE PROVIDED AT OPENINGS ADJACENT TO CONCRETE COLUMNS OR TIE COLUMNS


TYPICAL DETAIL
LINTEL SCHEDULE
CMU WALL

(4)

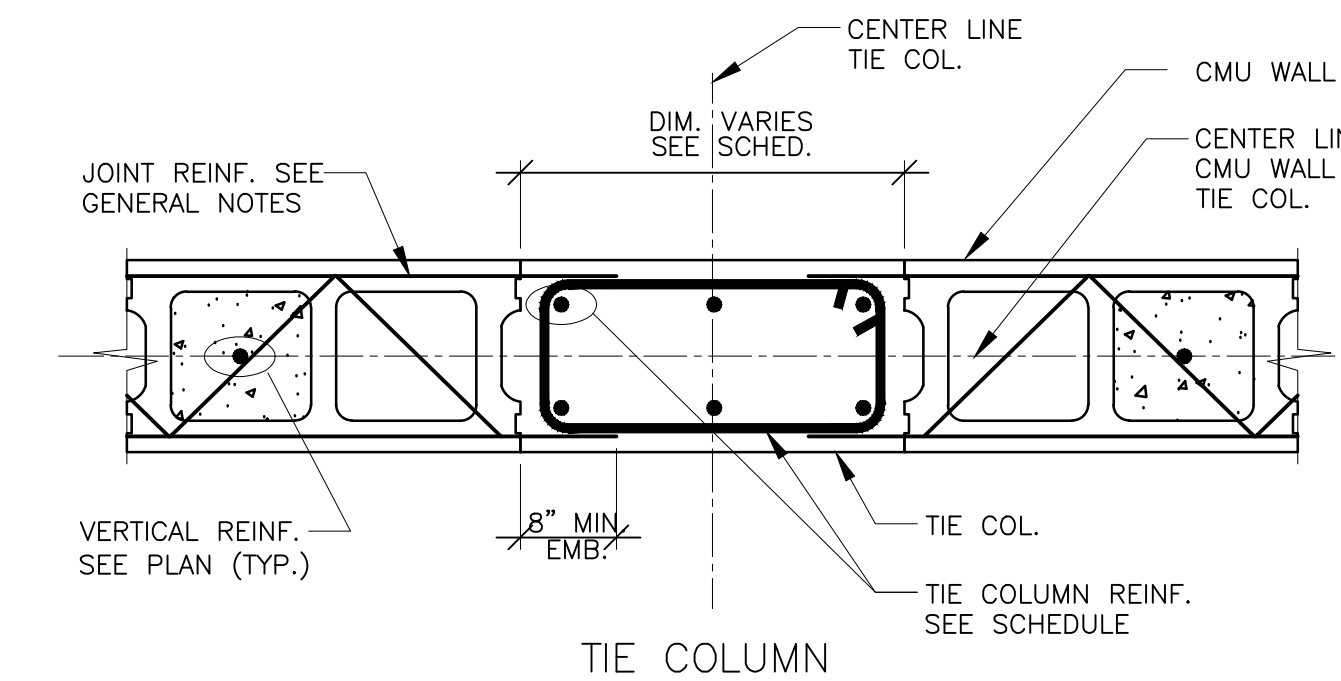


TYPICAL DETAIL
TIE COLUMN AT CMU WALL

(1)

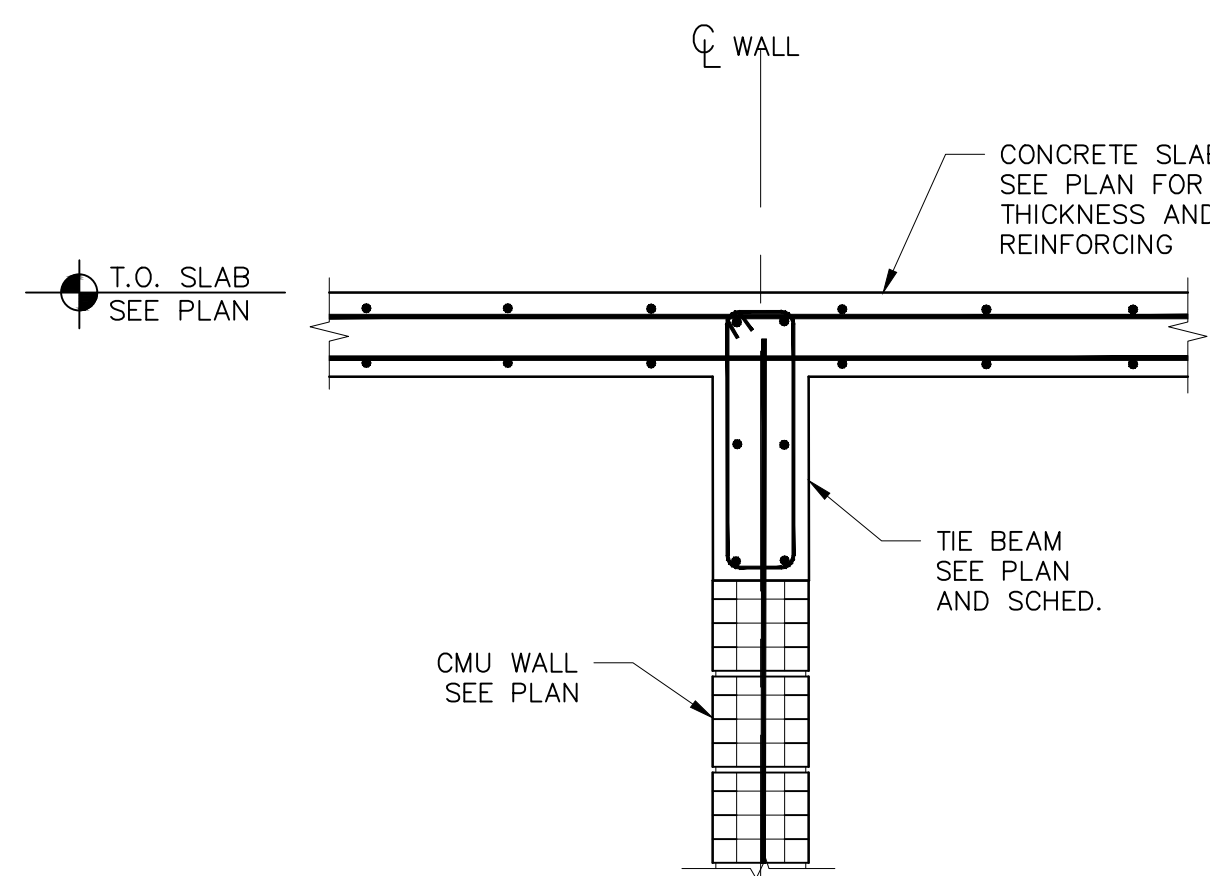


TYPICAL DETAIL
CONCRETE SLAB TO CMU WALL
CONNECTION

(11)

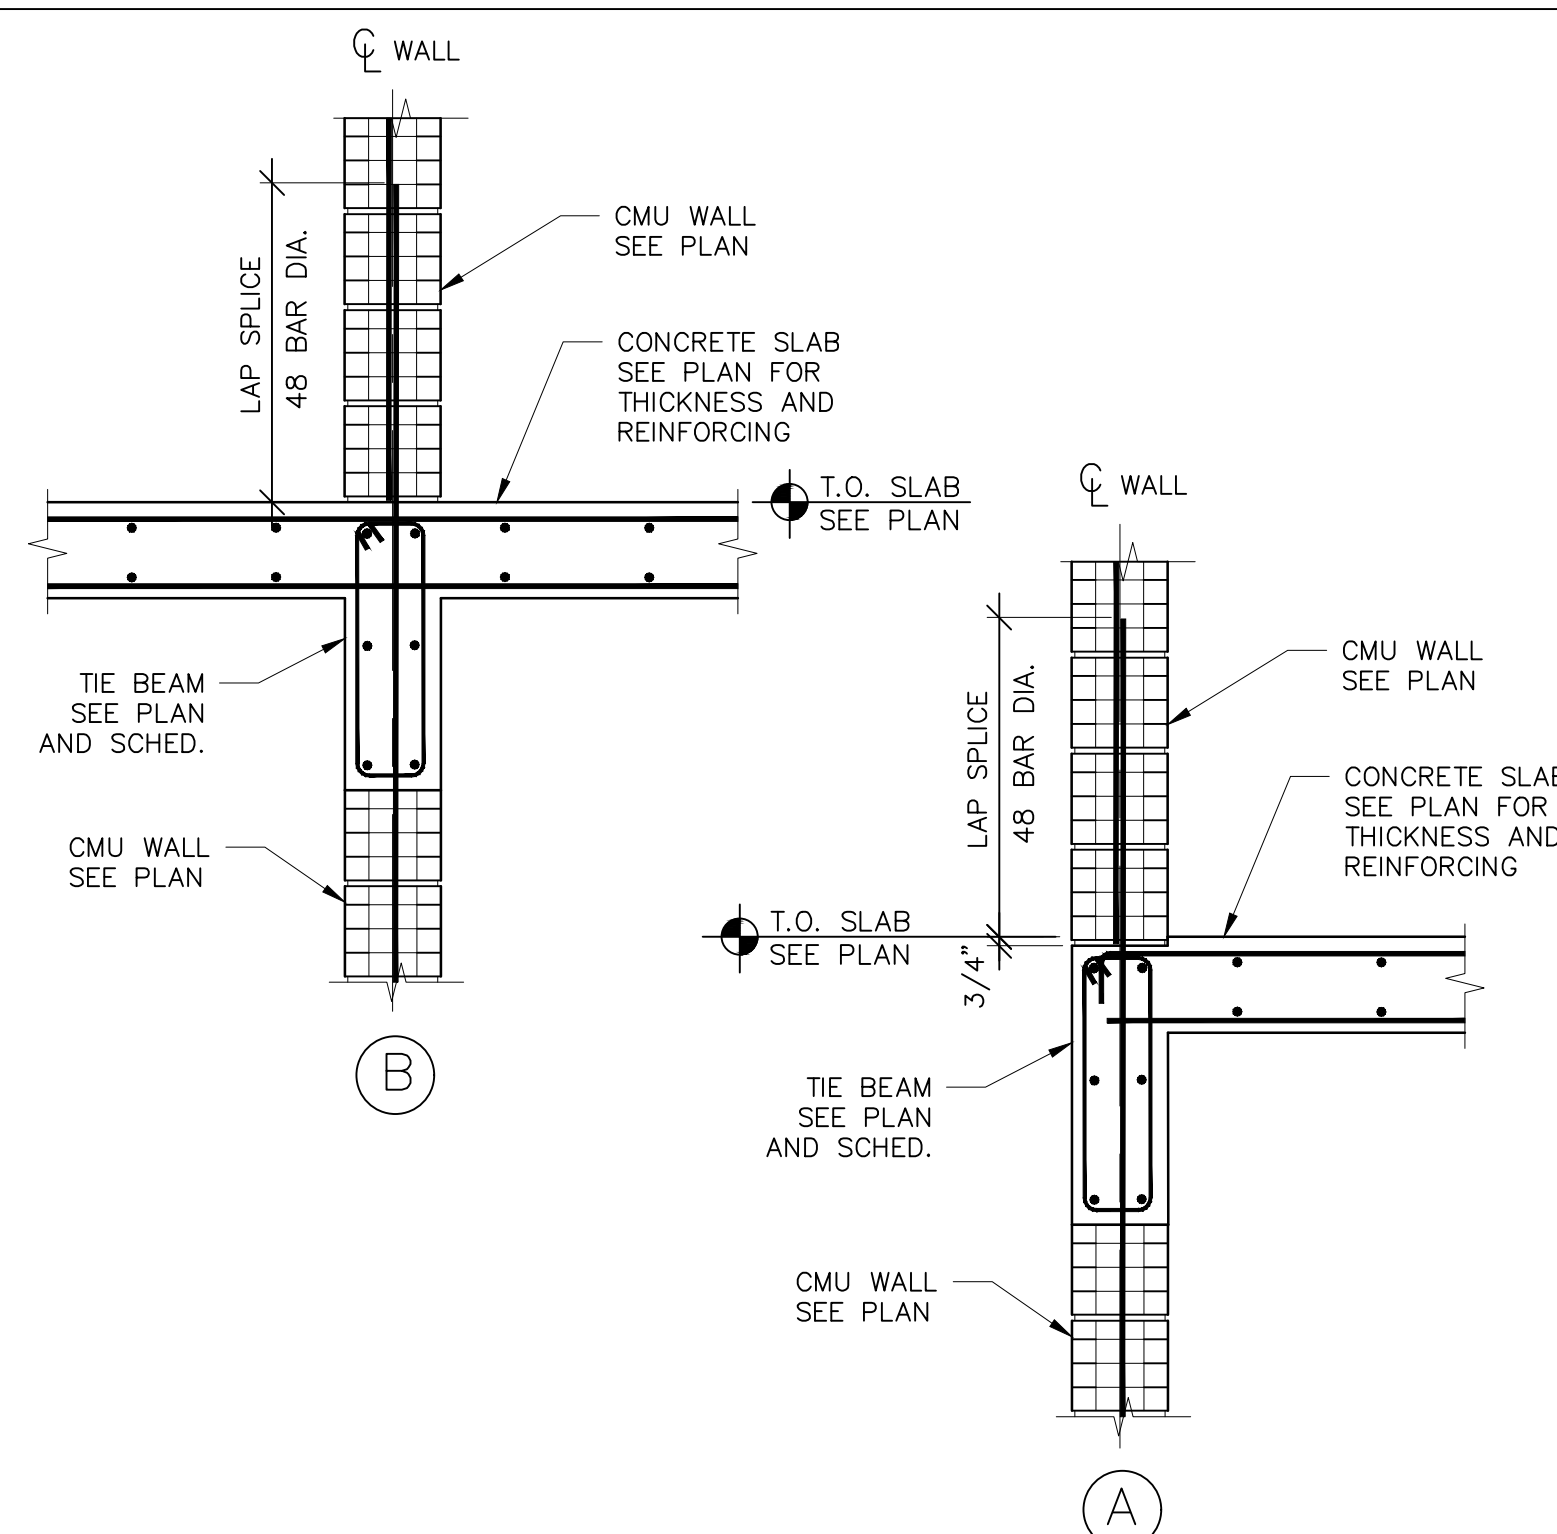


TYPICAL DETAIL
CONCRETE SLAB TO CMU WALL
CONNECTION

(8)

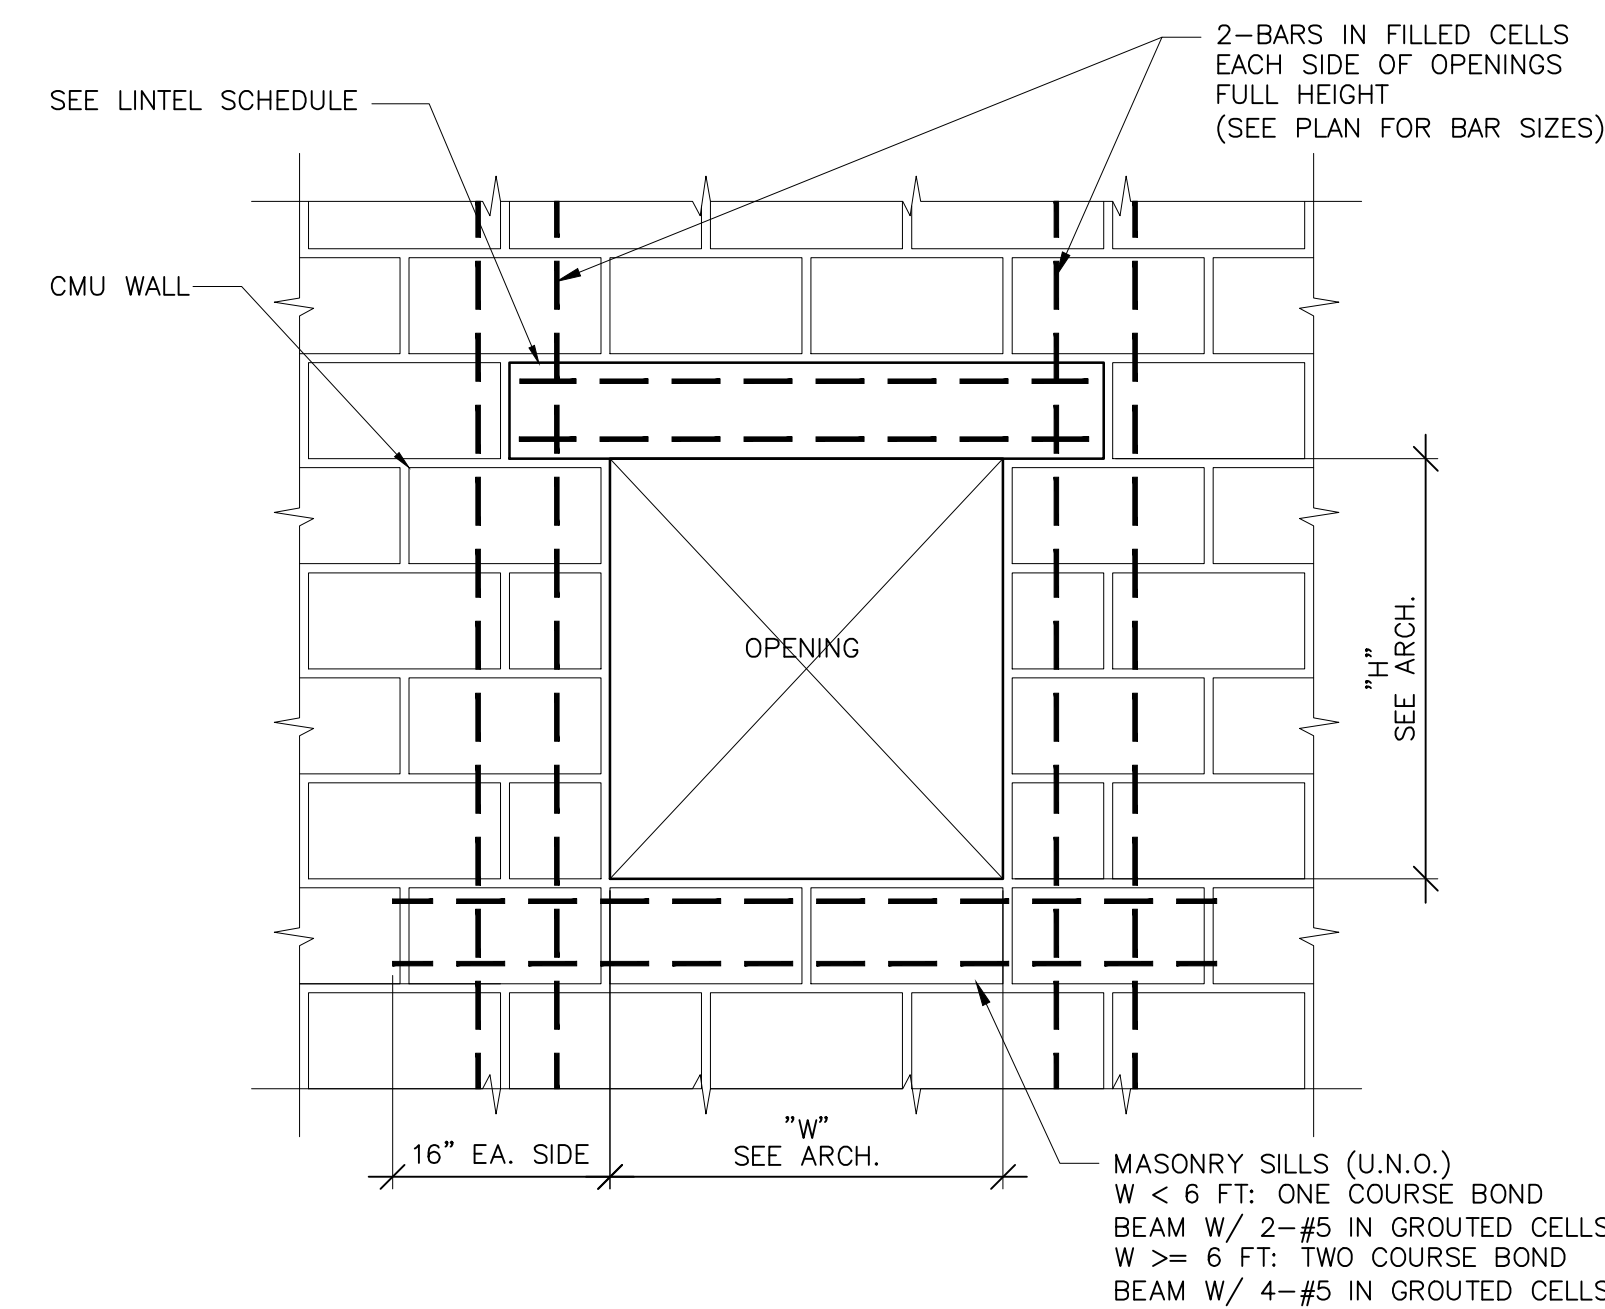


TYPICAL DETAIL
WINDOW OPENING AT CMU WALL

(5)

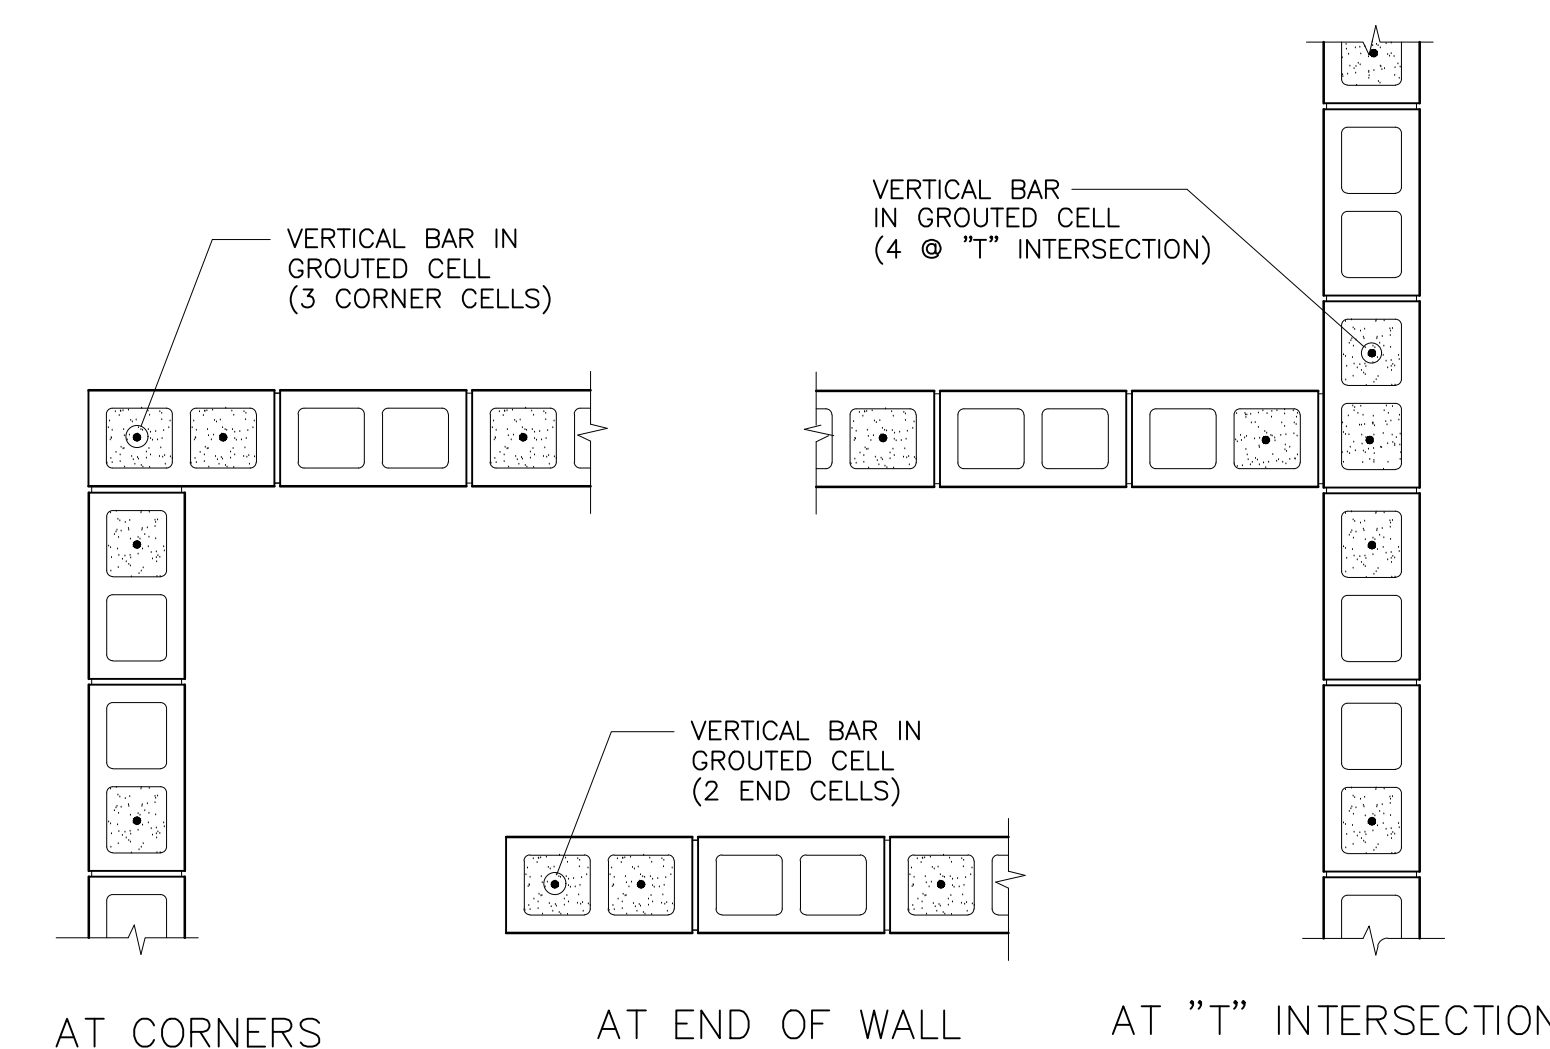


TYPICAL DETAIL
BAR PLACEMENT AT CORNERS AND
END OF CMU WALLS

(2)

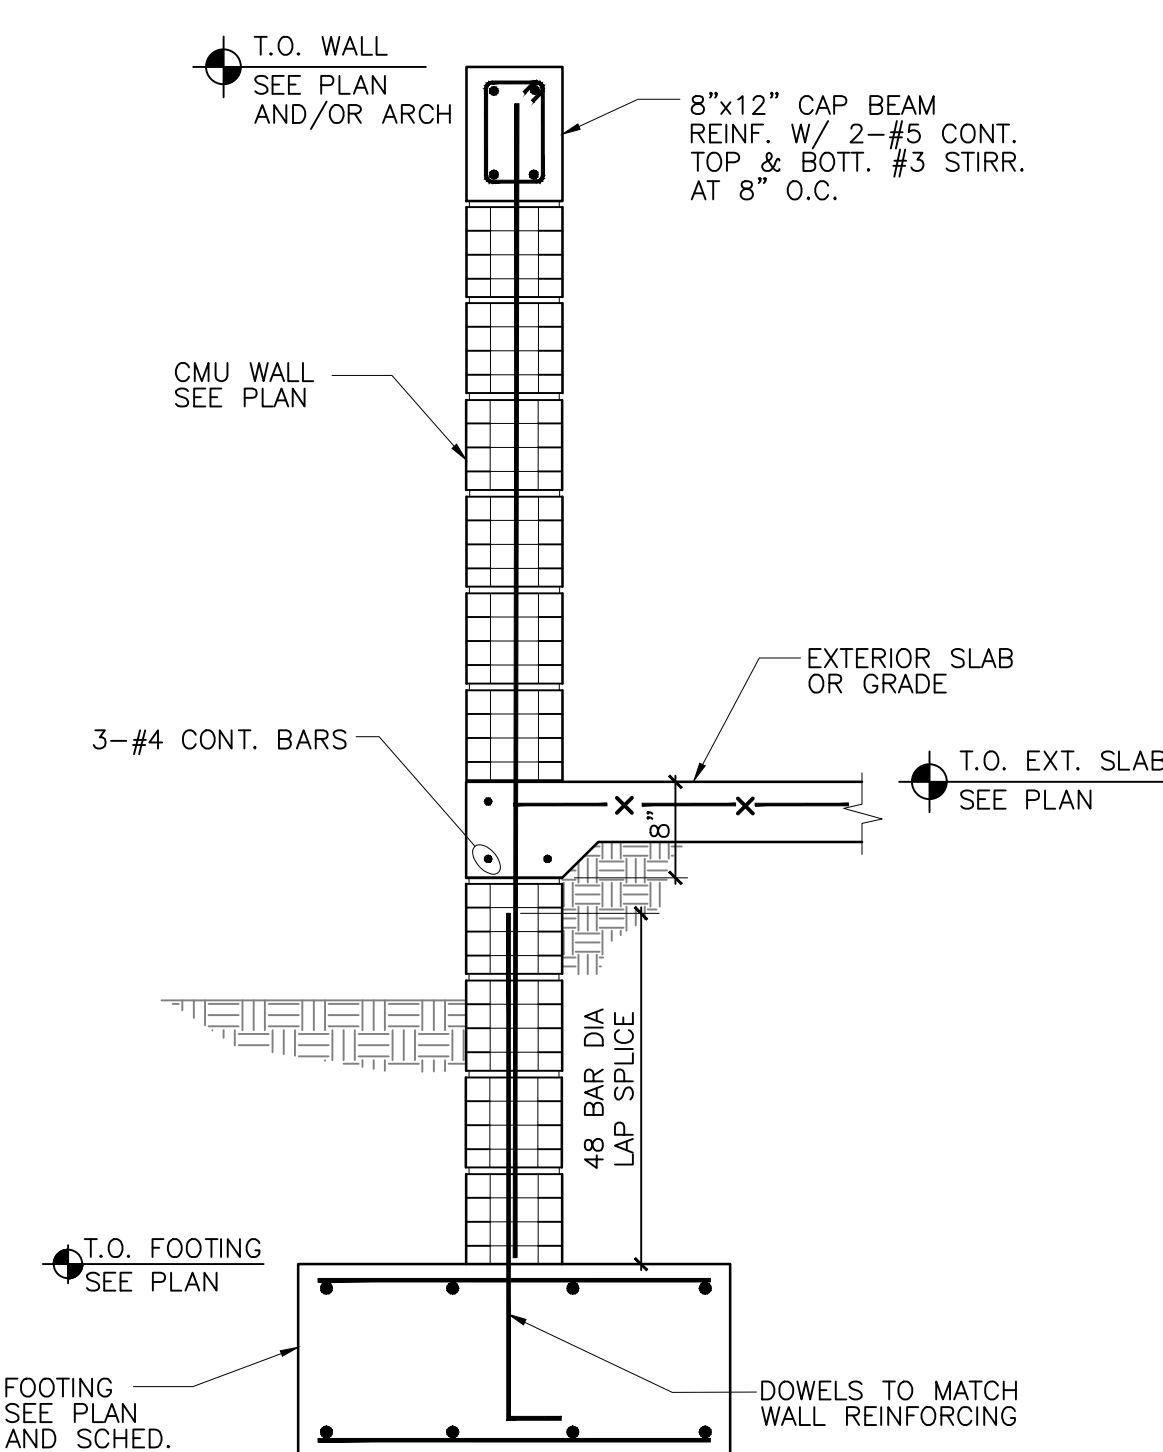


TYPICAL DETAIL
FREE-STANDING SITE CMU WALL
TO FOOTING CONNECTION

(12)

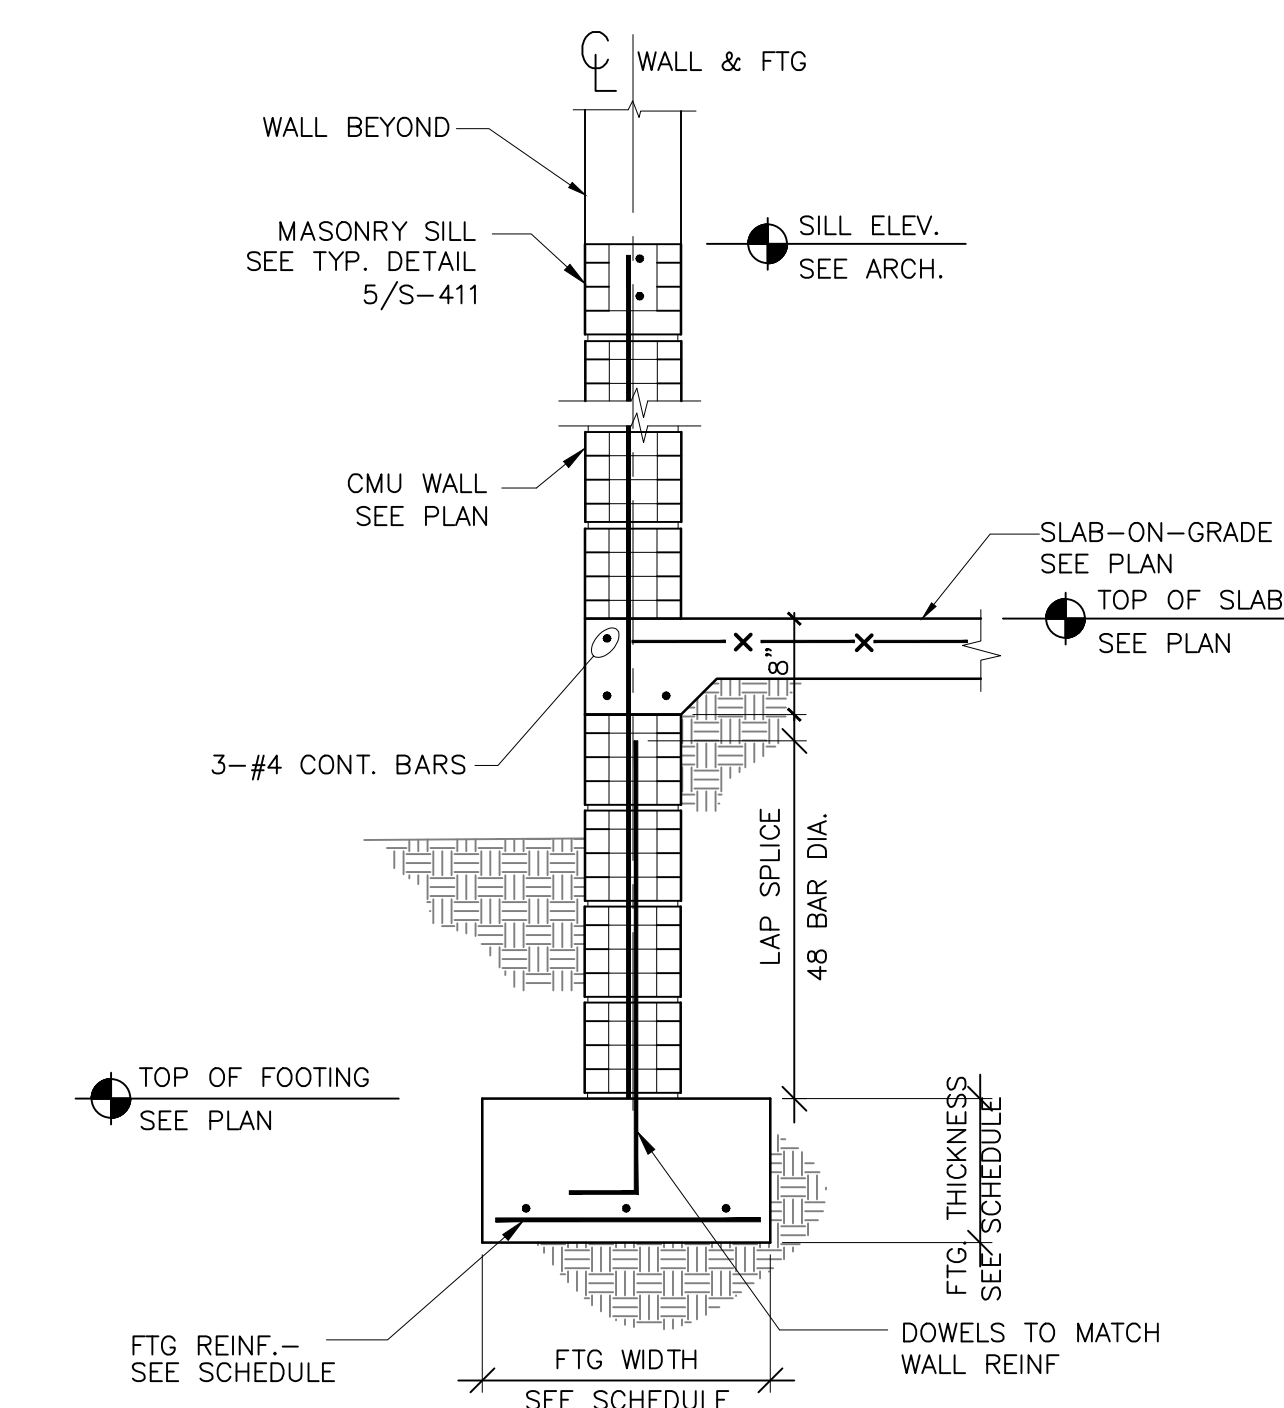


TYPICAL DETAIL
CMU WALL TO FOOTING CONNECTION
AT EXTERIOR WINDOW OPENING

(9)

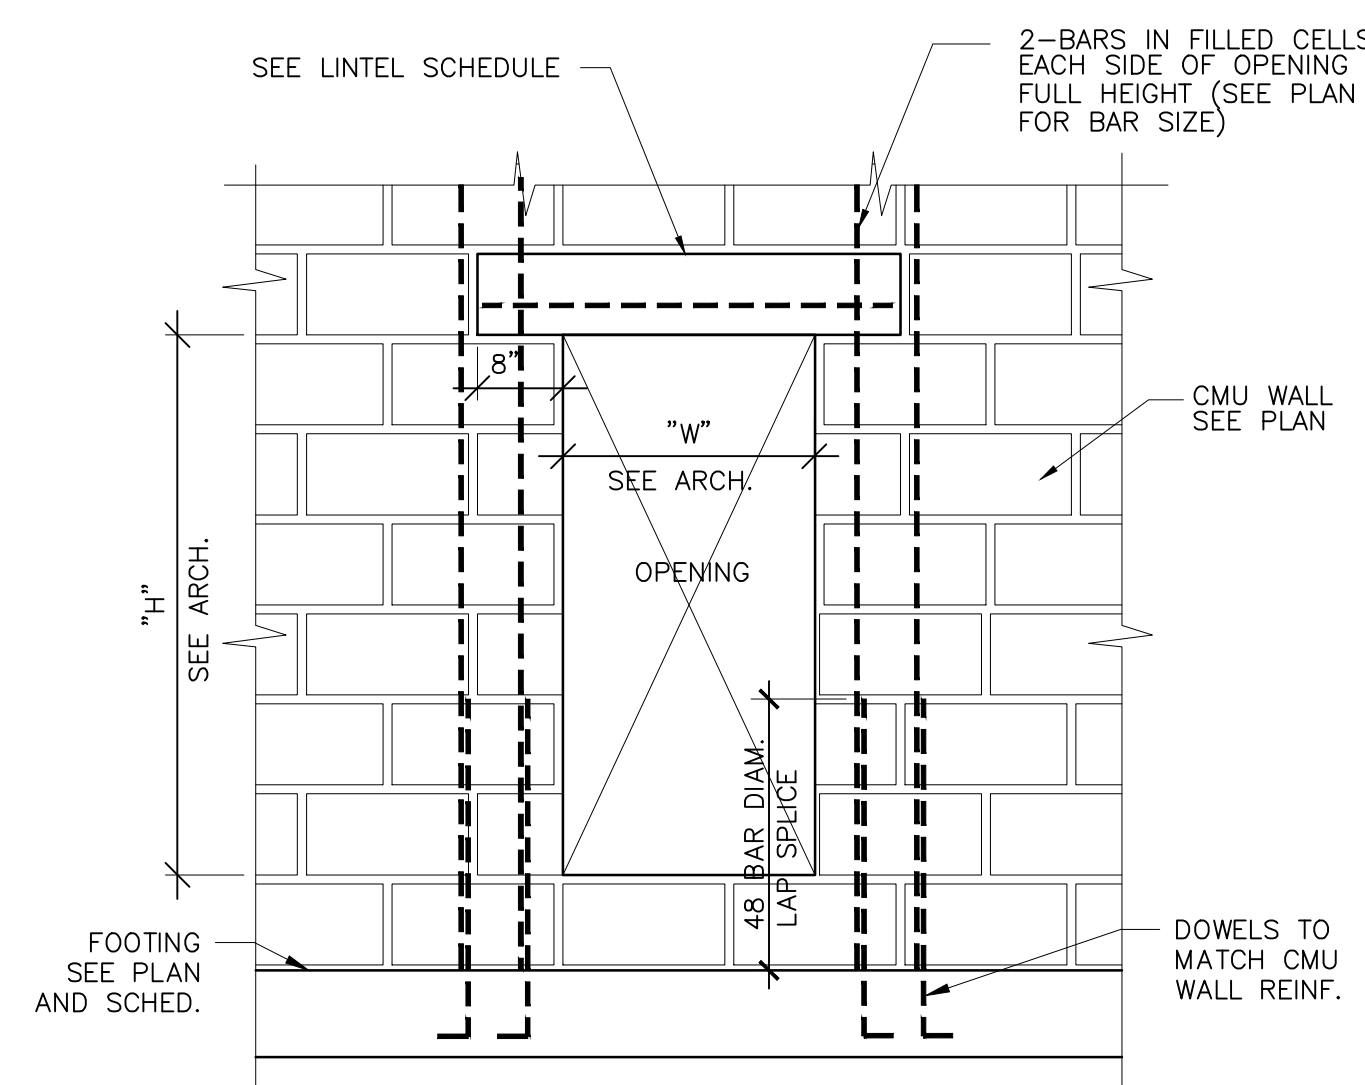

TYPICAL DETAIL
EXTERIOR DOOR OPENING
AT CMU WALL

(6)

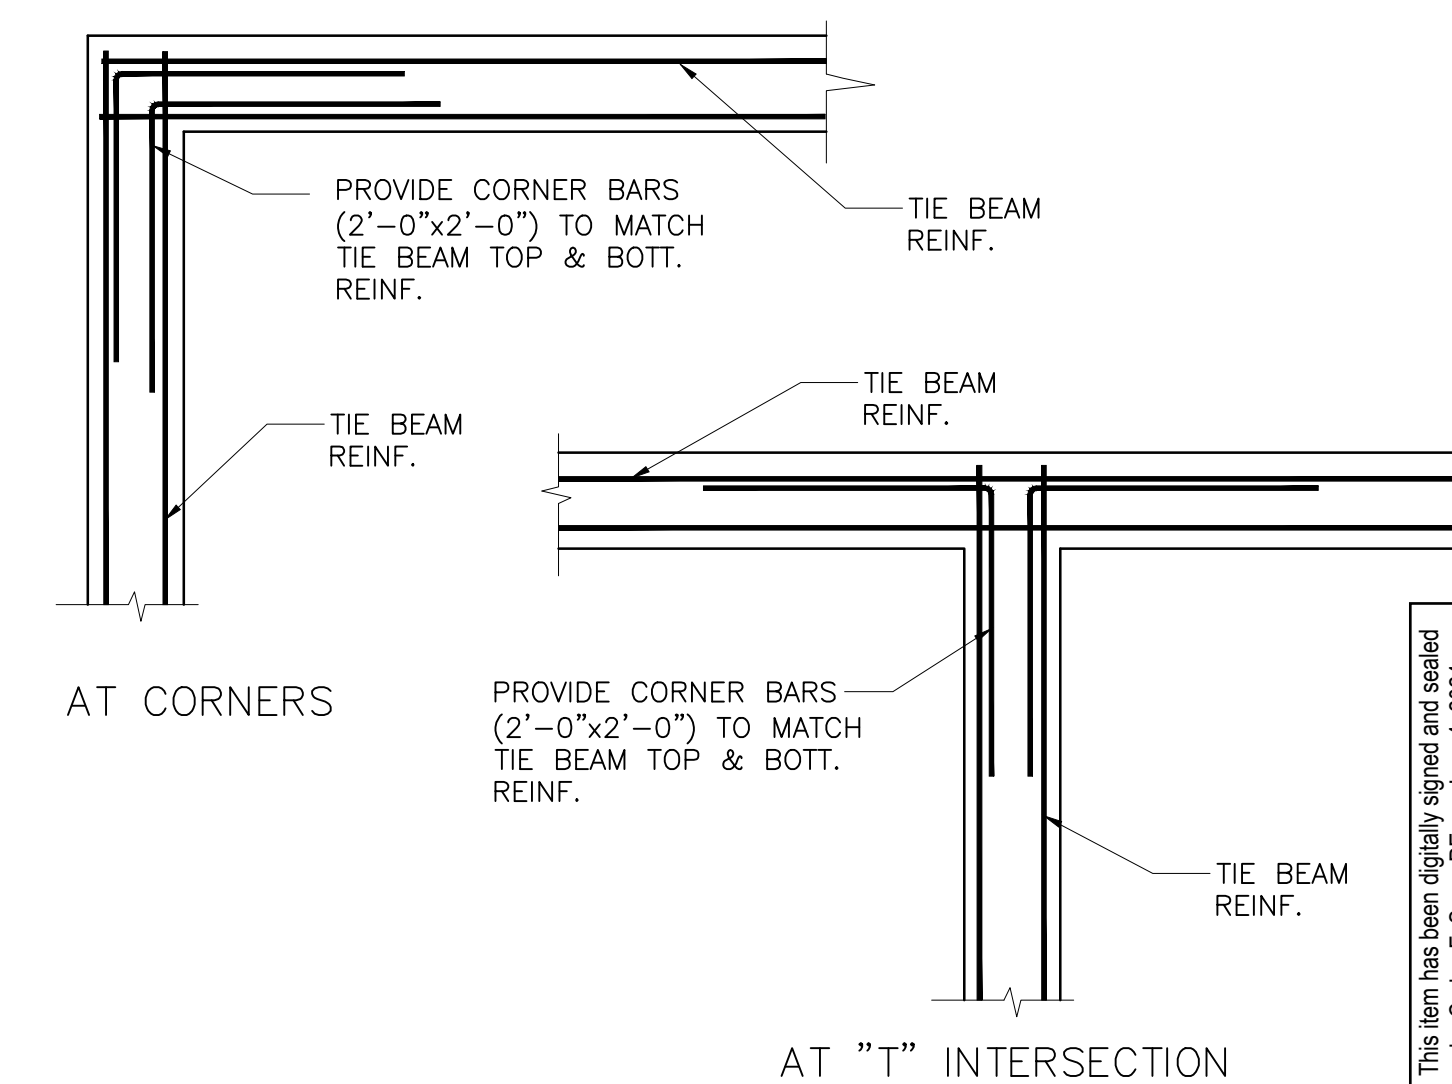

TYPICAL DETAIL
BAR PLACEMENT AT TIE BEAMS
CMU WALLS

(3)