


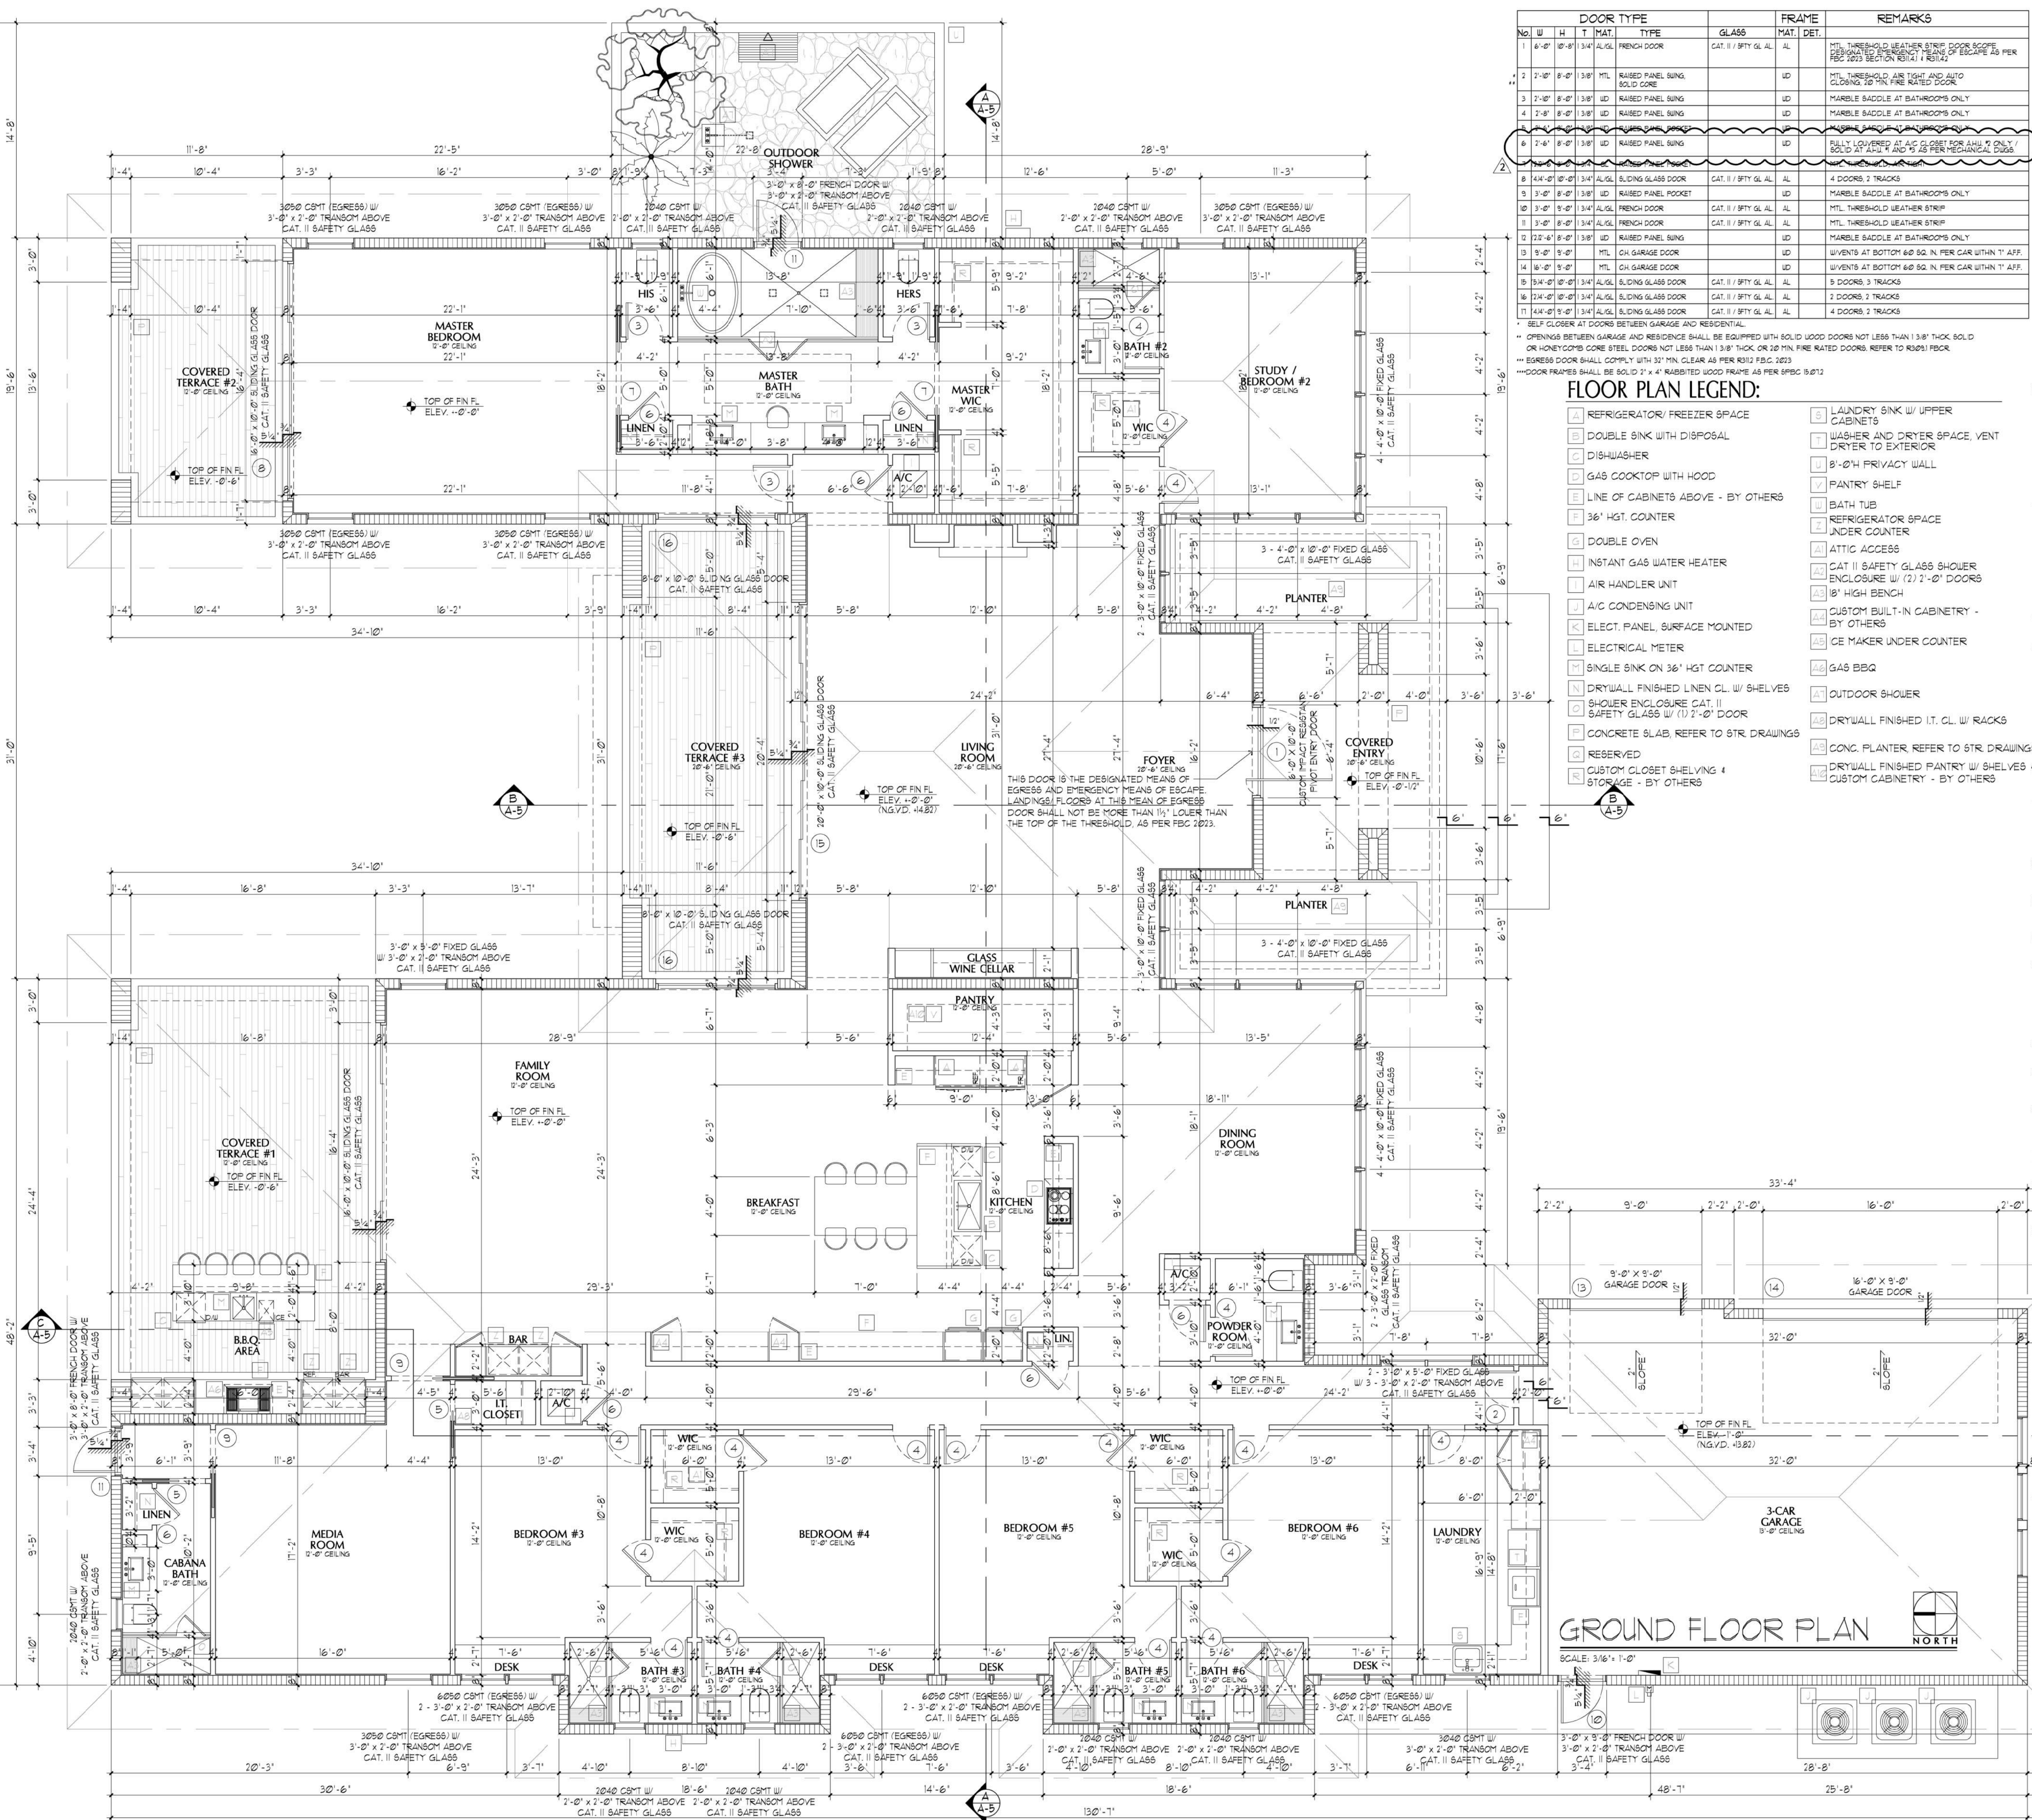

DOOR TYPE						FRAME		REMARKS
NO	W	H	T	MAT	TYPE	GLASS	MAT DET.	
1	6'-0"	10'-0"	1'-0"	1/4"	FRENCH DOOR	CAT. II / 80% GL	AL	MTL THRESHOLD WEATHER STRIP DOOR SCOPE PER 2023 SECTION R302.1 / R302.2 ESCAPE AS PER
2	2'-10"	8'-0"	1'-0"	1/4"	RAISED PANEL SLING SOLID CORE		UD	MTL THRESHOLD WEATHER STRIP AND AUTO CLOSING 10 MIN FIRE RATED DOOR
3	2'-10"	8'-0"	1'-0"	1/4"	RAISED PANEL SLING		UD	MARBLE SADDLE AT BATHROOMS ONLY
4	2'-8"	8'-0"	1'-0"	1/4"	RAISED PANEL SLING		UD	MARBLE SADDLE AT BATHROOMS ONLY
5	2'-6"	8'-0"	1'-0"	1/4"	RAISED PANEL SLING		UD	MARBLE SADDLE AT BATHROOMS ONLY
6	2'-6"	8'-0"	1'-0"	1/4"	RAISED PANEL SLING		UD	BULLY LOVERED AT A/C UNIT FOR A/C UNIT ONLY / 10 MIN FIRE RATED DOOR
7	2'-6"	8'-0"	1'-0"	1/4"	RAISED PANEL SLING		UD	MARBLE SADDLE AT BATHROOMS ONLY
8	4'-4"	10'-0"	1'-0"	1/4"	SLIDING GLASS DOOR	CAT. II / 80% GL	AL	4 DOORS 2 TRACKS
9	3'-0"	8'-0"	1'-0"	1/4"	RAISED PANEL DOOR		UD	MARBLE SADDLE AT BATHROOMS ONLY
10	3'-0"	8'-0"	1'-0"	1/4"	FRENCH DOOR	CAT. II / 80% GL	AL	MTL THRESHOLD WEATHER STRIP
11	3'-0"	8'-0"	1'-0"	1/4"	FRENCH DOOR	CAT. II / 80% GL	AL	MTL THRESHOLD WEATHER STRIP
12	2'-6"	8'-0"	1'-0"	1/4"	RAISED PANEL SLING		UD	MARBLE SADDLE AT BATHROOMS ONLY
13	9'-0"	9'-0"	1'-0"	1/4"	MTL CH GARAGE DOOR		UD	W/VENTS AT BOTTOM 600 SQ. IN. PER CAR WITHIN 1' AFF.
14	14'-0"	9'-0"	1'-0"	1/4"	MTL CH GARAGE DOOR		UD	W/VENTS AT BOTTOM 600 SQ. IN. PER CAR WITHIN 1' AFF.
15	3'-0"	8'-0"	1'-0"	1/4"	SLIDING GLASS DOOR	CAT. II / 80% GL	AL	5 DOORS 3 TRACKS
16	2'-6"	8'-0"	1'-0"	1/4"	SLIDING GLASS DOOR	CAT. II / 80% GL	AL	2 DOORS 2 TRACKS
17	4'-4"	9'-0"	1'-0"	1/4"	SLIDING GLASS DOOR	CAT. II / 80% GL	AL	4 DOORS 2 TRACKS

FLOOR PLAN LEGEND:

- A

REFRIGERATOR / FREEZER SPACE
- B

DOUBLE SINK WITH DISPOSAL
- C

DISHWASHER
- D

GAS COOKTOP WITH HOOD
- E

LINE OF CABINETS ABOVE - BY OTHERS
- F

36" HGT. COUNTER
- G

DOUBLE OVEN
- H

INSTANT GAS WATER HEATER
- I

AIR HANDLER UNIT
- J

A/C CONDENSING UNIT
- K

ELECT. PANEL, SURFACE MOUNTED
- L

ELECTRICAL METER
- M

SINGLE SINK ON 36" HGT COUNTER
- N

DRYWALL FINISHED LINEN CL. W/ SHELVES
- O

SHOWER ENCLOSURE CAT. II SAFETY GLASS W/ (1) 2'-0" DOOR
- P

CONCRETE SLAB, REFER TO STR. DRAWINGS
- Q

RESERVED
- R

CUSTOM CLOSET SHELVING & STORAGE - BY OTHERS

S

LAUNDRY SINK W/ UPPER CABINETS

T

WASHER AND DRYER SPACE, VENT DRYER TO EXTERIOR

U

8'-0" H PRIVACY WALL

V

PANTRY SHELF

W

BATH TUB

X

REFRIGERATOR SPACE UNDER COUNTER

Y

ATTIC ACCESS

Z

CAT II SAFETY GLASS SHOWER ENCLOSURE W/ (2) 2'-0" DOORS

AA

18" HIGH BENCH

AB

CUSTOM BUILT-IN CABINETRY - BY OTHERS

AC

CE MAKER UNDER COUNTER

AD

GAS BBQ

AE

OUTDOOR SHOWER

AF

DRYWALL FINISHED I.T. CL. W/ RACKS

AG

CONC. PLANTER, REFER TO STR. DRAWINGS

AH

DRYWALL FINISHED PANTRY W/ SHELVES & CUSTOM CABINETRY - BY OTHERS

GENERAL NOTES:

- PRIOR TO START OF CONSTRUCTION, THE CONTRACTOR AND ALL THE SUBCONTRACTORS SHALL VERIFY ALL GRADES, LINES, LEVELS, DIMENSIONS AND COORDINATE EXISTING CONDITIONS AT THE JOB SITE WITH THE PLANS AND SPECIFICATIONS. THEY SHALL REPORT ANY ON CONSIDERATIONS OR ERRORS IN THE ABOVE TO THE ARCHITECT/ENGINEER BEFORE COMMENCING WORK FROM ESTABLISHED REFERENCE POINTS AND BE RESPONSIBLE FOR ALL LINES, ELEVATIONS AND MEASUREMENTS IN CONNECTION WITH THEIR WORK.
- IF ANY ERRORS OR OMISSIONS APPEAR IN THE DRAWINGS, GENERAL NOTES OR OTHER DOCUMENTS, THE CONTRACTOR SHALL NOTIFY THE ARCHITECT/ENGINEER IN WRITING OF SUCH OMISSION OR ERROR PRIOR TO PROCEEDING WITH ANY WORK WHICH APPEARS IN QUESTION. IN THE EVENT OF THE CONTRACTOR'S FAILURE TO GIVE SUCH AN ADVANCED NOTICE, HE SHALL BE RESPONSIBLE FOR THE RESULTS OF ANY SUCH ERRORS OR OMISSIONS AND THE COST OF RECTIFYING THE SAME.
- ALL DIMENSIONS SHALL BE CONSIDERED NOMINAL, UNLESS OTHERWISE NOTED. DIMENSIONS ON LARGE SCALE DRAWINGS OR DETAILS WILL PREVAIL OVER SMALLER SCALED DRAWINGS.
- DO NOT SCALE DIMENSIONS. USE FIGURED DIMENSIONS ONLY. VERIFY ALL DIMENSIONS & CONDITIONS, IN THE EVENT OF CONFLICT, NOTIFY THE ARCHITECT BEFORE PROCEEDING.
- SHOWER/BATH-TUB COMPARTMENTS SHALL HAVE FLOORS AND WALLS CONSTRUCTED OF SMOOTH, CORROSION RESISTANT AND NONABSORBENT WATER-RESISTANT MATERIAL (GREEN BOARD NOT ACCEPTABLE) TO HEIGHT OF NOT LESS THAN 12" INCHES ABOVE THE COMPARTMENT FLOOR AT THE DRAIN BY SECTION R-302.1 FEB 2023.
- EVERY SLEEPING ROOM SHALL HAVE AT LEAST ONE EMERGENCY ESCAPE AND RESCUE OPENING OPERABLE FROM THE INSIDE. THE MODE OF OPERATION SHALL NOT REQUIRE THE USE OF A KEY, TOOL, SPECIAL KNOWLEDGE OR EFFORT. SUCH CLEAR OPENING SHALL BE NOT LESS THAN 20" IN WIDTH AND 24" IN HEIGHT (57.9" IN AREA). THE BOTTOM OF THE CLEAR OPENING SHALL NOT BE MORE THAN 44" ABOVE THE FINISHED FLOOR. NO PART OF THE OPERATING MECHANISM SHALL BE PLACED HIGHER THAN 54" ABOVE FINISHED FLOOR AS PER F.B.C. 2023 SECTION R302.1 THRU R302.4.
- NUMBERS OF ADDRESS SHALL BE PLACED VISIBLE AND READABLE FROM THE STREET FRONTING THE PROPERTY AND SHALL BE 4 INCHES MIN. IN HEIGHT AS PER F.B.C. 2023 R303.
- REFER TO FOUNDATION PLAN FOR CONCRETE FILLED BLOCK CELL LOCATION, SIZE & REINF.
- ALL FIXED GLASS PANELS SHALL BE 3/4" SAFETY GLASS CAT. II MINIMUM.
- CAT. II SAFETY GLASS SHALL BE USED AT ALL SHOWER/TUB ENCLOSURES INCLUDING ANY GLAZING WITHIN 60" OF THE FINISH FLOOR SURFACE IN WALLS SURROUNDING ANY TUB OR SHOWER ENCLOSURE AS PER TABLE R-308.4.5 FEB 2023.
- EVERY CLOSET DOOR LATCH SHALL BE SUCH THAT CHILDREN CAN OPEN THE DOOR FROM THE INSIDE OF THE CLOSET NFPA 21-2.4.4.
- EVERY BATHROOM DOOR LOCK SHALL BE DESIGNED TO PERMIT THE OPENING OF THE LOCKED DOOR FROM THE OUTSIDE IN AN EMERGENCY. NFPA 21-2.4.5.
- ATTICS NOT USED FOR HABITATION PURPOSES SHALL HAVE PROVISIONS FOR THE EMISSION OF EXCESS HEAT. F.B.C. 2023-1029.2.
- TERMITE PROTECTION SHALL BE PROVIDED BY REGISTERED TERMITICIDES, INCLUDING SOIL APPLIED PESTICIDES, BAITING SYSTEMS, AND PESTICIDES APPLIED TO WOOD, OR OTHER APPROVED METHODS OF TERMITE PROTECTION LABELED FOR USE AS A PREVENTATIVE TREATMENT TO NEW CONSTRUCTION. SEE SECTION 1029.2 REGISTERED TERMITICIDE UPON COMPLETION OF THE APPLICATION OF THE TERMITE PROTECTIVE TREATMENT, A CERTIFICATE OF COMPLIANCE SHALL BE ISSUED TO THE BUILDING DEPARTMENT BY THE LICENSED PEST CONTROL COMPANY THAT CONTAINS THE FOLLOWING STATEMENT: "THE BUILDING HAS RECEIVED A COMPLETE TREATMENT FOR THE PREVENTION OF SUBTERRANEAN TERMITES. TREATMENT IS IN ACCORDANCE WITH RULES AND LAWS ESTABLISHED BY THE FLORIDA DEPARTMENT OF AGRICULTURE AND CONSUMER SERVICES AS PER F.B.C. 2023 R303."
- HEIGHT OF WINDOW SILL AT 2ND FLOOR EGRESS WINDOWS SHALL BE A MIN OF 36" ABOVE THE FINISH FLOOR AND SHALL NOT EXCEED A MAX OF 44" ABOVE THE FINISH FLOOR.
- SHUTTERS USED TO PROTECT OPENINGS ABOVE THE FIRST STORY OF ANY BUILDING MUST BE PERMANENTLY INSTALLED AND CLOSABLE FROM THE INSIDE OF THE BUILDING AS PER SECTION 2419.6.1 FEB 2023.
- FLAME SPREAD AND SMOKE DENSITY: WALL AND CEILING FINISHES SHALL HAVE A FLAME-SPREAD CLASSIFICATION OF NOT GREATER THAN 200 AND A SMOKE-DEVELOPED INDEX OF NOT GREATER THAN 450 AS PER F.B.C. 2023 SECTION R302.9 INSULATION MATERIALS, INCLUDING FACINGS, SUCH AS VAPOR RETARDERS OR VAPOR PERMEABLE MEMBRANES INSTALLED WITHIN FLOOR-CEILING ASSEMBLIES, ROOF-CEILING ASSEMBLIES, WALL-ASSEMBLY WALL SPACES AND ATTICS SHALL HAVE A FLAME-SPREAD INDEX NOT TO EXCEED 25 WITH AN ACCOMPANYING SMOKE-DEVELOPED INDEX NOT TO EXCEED 450 AS PER F.B.C. 2023 SECTION R302.10.
- ALL EGRESS DOORS SHALL BE READILY OPENABLE FROM THE SIDE FROM WHICH EGRESS IS TO BE MADE WITHOUT THE USE OF A KEY OR SPECIAL KNOWLEDGE OR EFFORT AS PER F.B.C. 2023 R302.7.
- GLAZING INSTALLED IN HAZARDOUS LOCATIONS SHALL BE PROVIDED WITH A MANUFACTURER'S OR INSTALLER'S LABEL, DESIGNATING TYPE AND THICKNESS OF GLASS AND THE SAFETY GLAZING STANDARD TO WHICH IT COMPLIES. THE LABEL SHALL BE VISIBLE IN THE FINAL INSTALLATION AS PER F.B.C. R308.1. OPERATIVE WINDOW AND DOOR ASSEMBLIES SHALL BE TESTED IN ACCORDANCE WITH THE REQUIREMENTS OF SECTION F.B.C. 2023 2413.1.6.
- IN BUILDINGS WITH COMBUSTIBLE CEILING OR ROOF CONSTRUCTION, AN ATTIC ACCESS OPENING SHALL BE PROVIDED WITH THE ROUGH-FRAMED OPENING NOT LESS THAN 22" BY 30" AS PER R302.1 FEB 2023. A 30" MIN UNOBSTRUCTED SPACE SHALL BE PROVIDED IN THE ATTIC ACCESS AS PER F.B.C. R308.1.
- ENCLOSED ACCESSIBLE SPACE UNDER STAIRS SHALL HAVE WALLS, UNDER STAIR SURFACE AND ANY EGRESS PROTECTED ON THE ENCLOSED SIDE WITH 1/2" GYPSUM BOARD IN ACCORDANCE WITH SECTION R302.1 FEB 2023.
- PROTECTION FROM DECAY SHALL BE PROVIDED IN THE LOCATIONS IN ACCORDANCE WITH SECTION R302.9 FEB 2023.
- HABITABLE ROOMS, HALLWAYS, CORRIDORS, BATHROOMS, TOILET ROOMS, LAUNDRY ROOMS, LAUNDRY ROOMS, AND BASEMENTS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7'-6" AS PER F.B.C. 2023 SECTION 1029.2 FOR ROOMS WITH A CEILING HEIGHT OF AT LEAST 8'-0" OF THE REQUIRED FLOOR AREA OF THE ROOM MUST HAVE A CEILING HEIGHT OF AT LEAST 7' FEET AND NO PORTION OF THE REQUIRED FLOOR AREA MAY HAVE A CEILING HEIGHT OF LESS THAN 5 FEET. PER F.B.C. 2023 SECTION 1029.2 (EXCEPTION 2). BATHROOMS SHALL HAVE A MIN. CEILING HEIGHT OF 6'-8" AS PER F.B.C. 2023 SECTION 1029.2 (EXCEPTION 1).
- COMBUSTIBLE INSULATION SHALL BE SEPARATED A MINIMUM OF 3 INCHES (76 MM) FROM RECEASED LUMINAIRES, FAN MOTORS AND OTHER HEAT-PRODUCING DEVICES. F.B.C. 2023 SECTION R302.13.
- ALL ELECTRICAL EQUIPMENT SHALL BE INSTALLED ABOVE BASE FLOOR ELEVATION AS PER F.B.C. 2023 R302.2 OF THE FLORIDA MECHANICAL CODE, OR AT AN ELEVATION EQUAL TO THE FINISHED FLOOR OF THE HOUSE / BUILDING.
- DESIGNATE MEANS OF EGRESS AND EMERGENCY MEANS OF ESCAPE, LANDINGS OR FINISHED FLOORS AT THE REQUIRED EGRESS DOOR SHALL NOT BE MORE THAN 18" (458 MM) LOWER THAN THE TOP OF THE THRESHOLD AS PER F.B.C. 2023 R302.13. ALSO THE LANDING OR FLOOR ON THE EXTERIOR SIDE SHALL NOT BE MORE THAN 13/4 INCHES (36 MM) BELOW THE TOP OF THE THRESHOLD.
- BUILDING IS TO BE BUILT ABOVE MINIMUM BASE FLOOR ELEVATION IN ACCORDANCE WITH SECTION R302.1 FEB 2023. PLEASE SEE PLOT PLAN FOR BASE FLOOR HEIGHT AND FINISH FLOOR ELEVATION.
- IN BUILDINGS WITH STONE APPLICATION, PRE-FABRICATED WOOD BRACKETS, AND/OR PRE-FABRICATED TRIMS, A STUCCO SCRATCH COAT SHALL BE PROVIDED ON THE MASONRY BLOCK WITH A WATERPROOFING SEALER (SUPER THOROSEAL OR APPROVED EQUIVALENT) ON TOP OF THE SCRATCH COAT PRIOR TO THE STONE/PRE-FABRICATED TRIM OR BRACKET INSTALLATION.
- STUCCO APPLIED TO CONCRETE OR MASONRY SHALL COMPLY WITH FLORIDA BUILDING CODE 2023 - BUILDING, FIFTH EDITION SECTION 290.01 AND SECTION 290.9, AND SHALL CONSIST OF AT LEAST TWO COATS AND THE TOTAL THICKNESS SHALL NOT BE LESS THAN 1/2".

AREA CALCULATIONS

TOTAL A/C SPACE	6,791 SQUARE FEET
GARAGE	829 SQUARE FEET
COVERED ENTRY	149 SQUARE FEET
COVERED TERRACE #1	534 SQUARE FEET
COVERED TERRACE #2	228 SQUARE FEET
PRIVATE SHOWER #3	36.1 SQUARE FEET
ACCESSORY STRUCTURE	332.01 SQUARE FEET
TOTAL	9,314.69 SQUARE FEET

WALL LEGEND:

- INDICATES 8"x8"x16" MASONRY UNITS
- INDICATES 3-5/8" METAL STUDS PARTITION 24" O.C. WITH 1/2" DRYWALL FINISH EACH SIDE
- NO. 25 GAUGE CHANNEL-SHAPED STUDS 16" O.C. WITH 1 FULL-LENGTH LAYERS OF 1/2" DRYWALL EACH SIDE AND R-15 INSULATION BETWEEN STUDS.

NOTE:

INTERIOR FINISHES SHALL MEET SPECIFIED VOC EMISSIONS LIMITS IN ACCORDANCE WITH GREENGUARD ENVIRONMENTAL INSTITUTE (GGI) STANDARD FOR FINISH FLOOR ELEVATION. REFER APPROVED SITE PLAN FOR GARAGE FLOOR ELEVATION.

ELEVATION NOTES:

- CONDENSING UNIT T.O.S. ELEVATION SHALL BE NOT LESS THAN F.F.E.
- REFER APPROVED SITE PLAN FOR FINISH FLOOR ELEVATION.
- REFER APPROVED SITE PLAN FOR GARAGE FLOOR ELEVATION.

PASCUAL PEREZ KILIDDJIAN STARR

ARCHITECTS + PLANNERS

LICENSE # AR 26001357
EDGARDO PEREZ, AIA
LICENSE NO.: AR 0015394
MARIO P. PASCUAL, AIA
LICENSE NO.: AR 0008254
PETER KILIDDJIAN, RA
LICENSE NO.: AR 0093067
ANDREW STARR, RA
LICENSE NO.: AR 0095130

AT THE BEACON CENTER
1330 NW 84th AVENUE
DORAL, FLORIDA 33126
TELEPHONE: (305) 592-1363
FACSIMILE: (305) 592-6865
http://www.ppkarch.com

COPYRIGHT © PASCUAL PEREZ, KILIDDJIAN & ASSOCIATES, PLANNERS
The architectural design and detail drawings of this building and/or overall project are the legal property of and all rights are reserved by the Architect. Their use for reproduction, construction or distribution is prohibited unless authorized in writing by the Architect.

REVISIONS:

Δ 08.10.23 BLDG. DEPT. REV.

OWNER:
HERITAGE HOME BUILDERS, LLC
9350 SOUTH DIXIE HIGHWAY
SUITE 1500
MIAMI, FL 33156
PHONE: 305.665.3077

NEW CONSTRUCTION AT PINECREST RESIDENCE
BY HERITAGE HOME BUILDERS, LLC.
7725 SOUTHWEST 114 STREET
VILLAGE OF PINECREST, FL 33156

Digitally signed by
Edgardo Perez
DN:
E=perez@ppkarch.com,
O=Edgardo Perez,
O=Pascual, Perez,
Kiliddjian, Starr &
Associates, L-Ltda.,
S=Florida, C=US
Date: 2023.10.19
10:44:10 -0400


STATE OF FLORIDA
BOARD OF PROFESSIONAL ENGINEERS
REGISTERED ARCHITECT
AR0015394

FIRST FLOOR PLAN

DATE: 01.16.2023
SCALE: AS SHOWN
DRAWN: JSP
CHECK BY: EP
JOB NO.: 22-22

SHEET NO.:

A-1

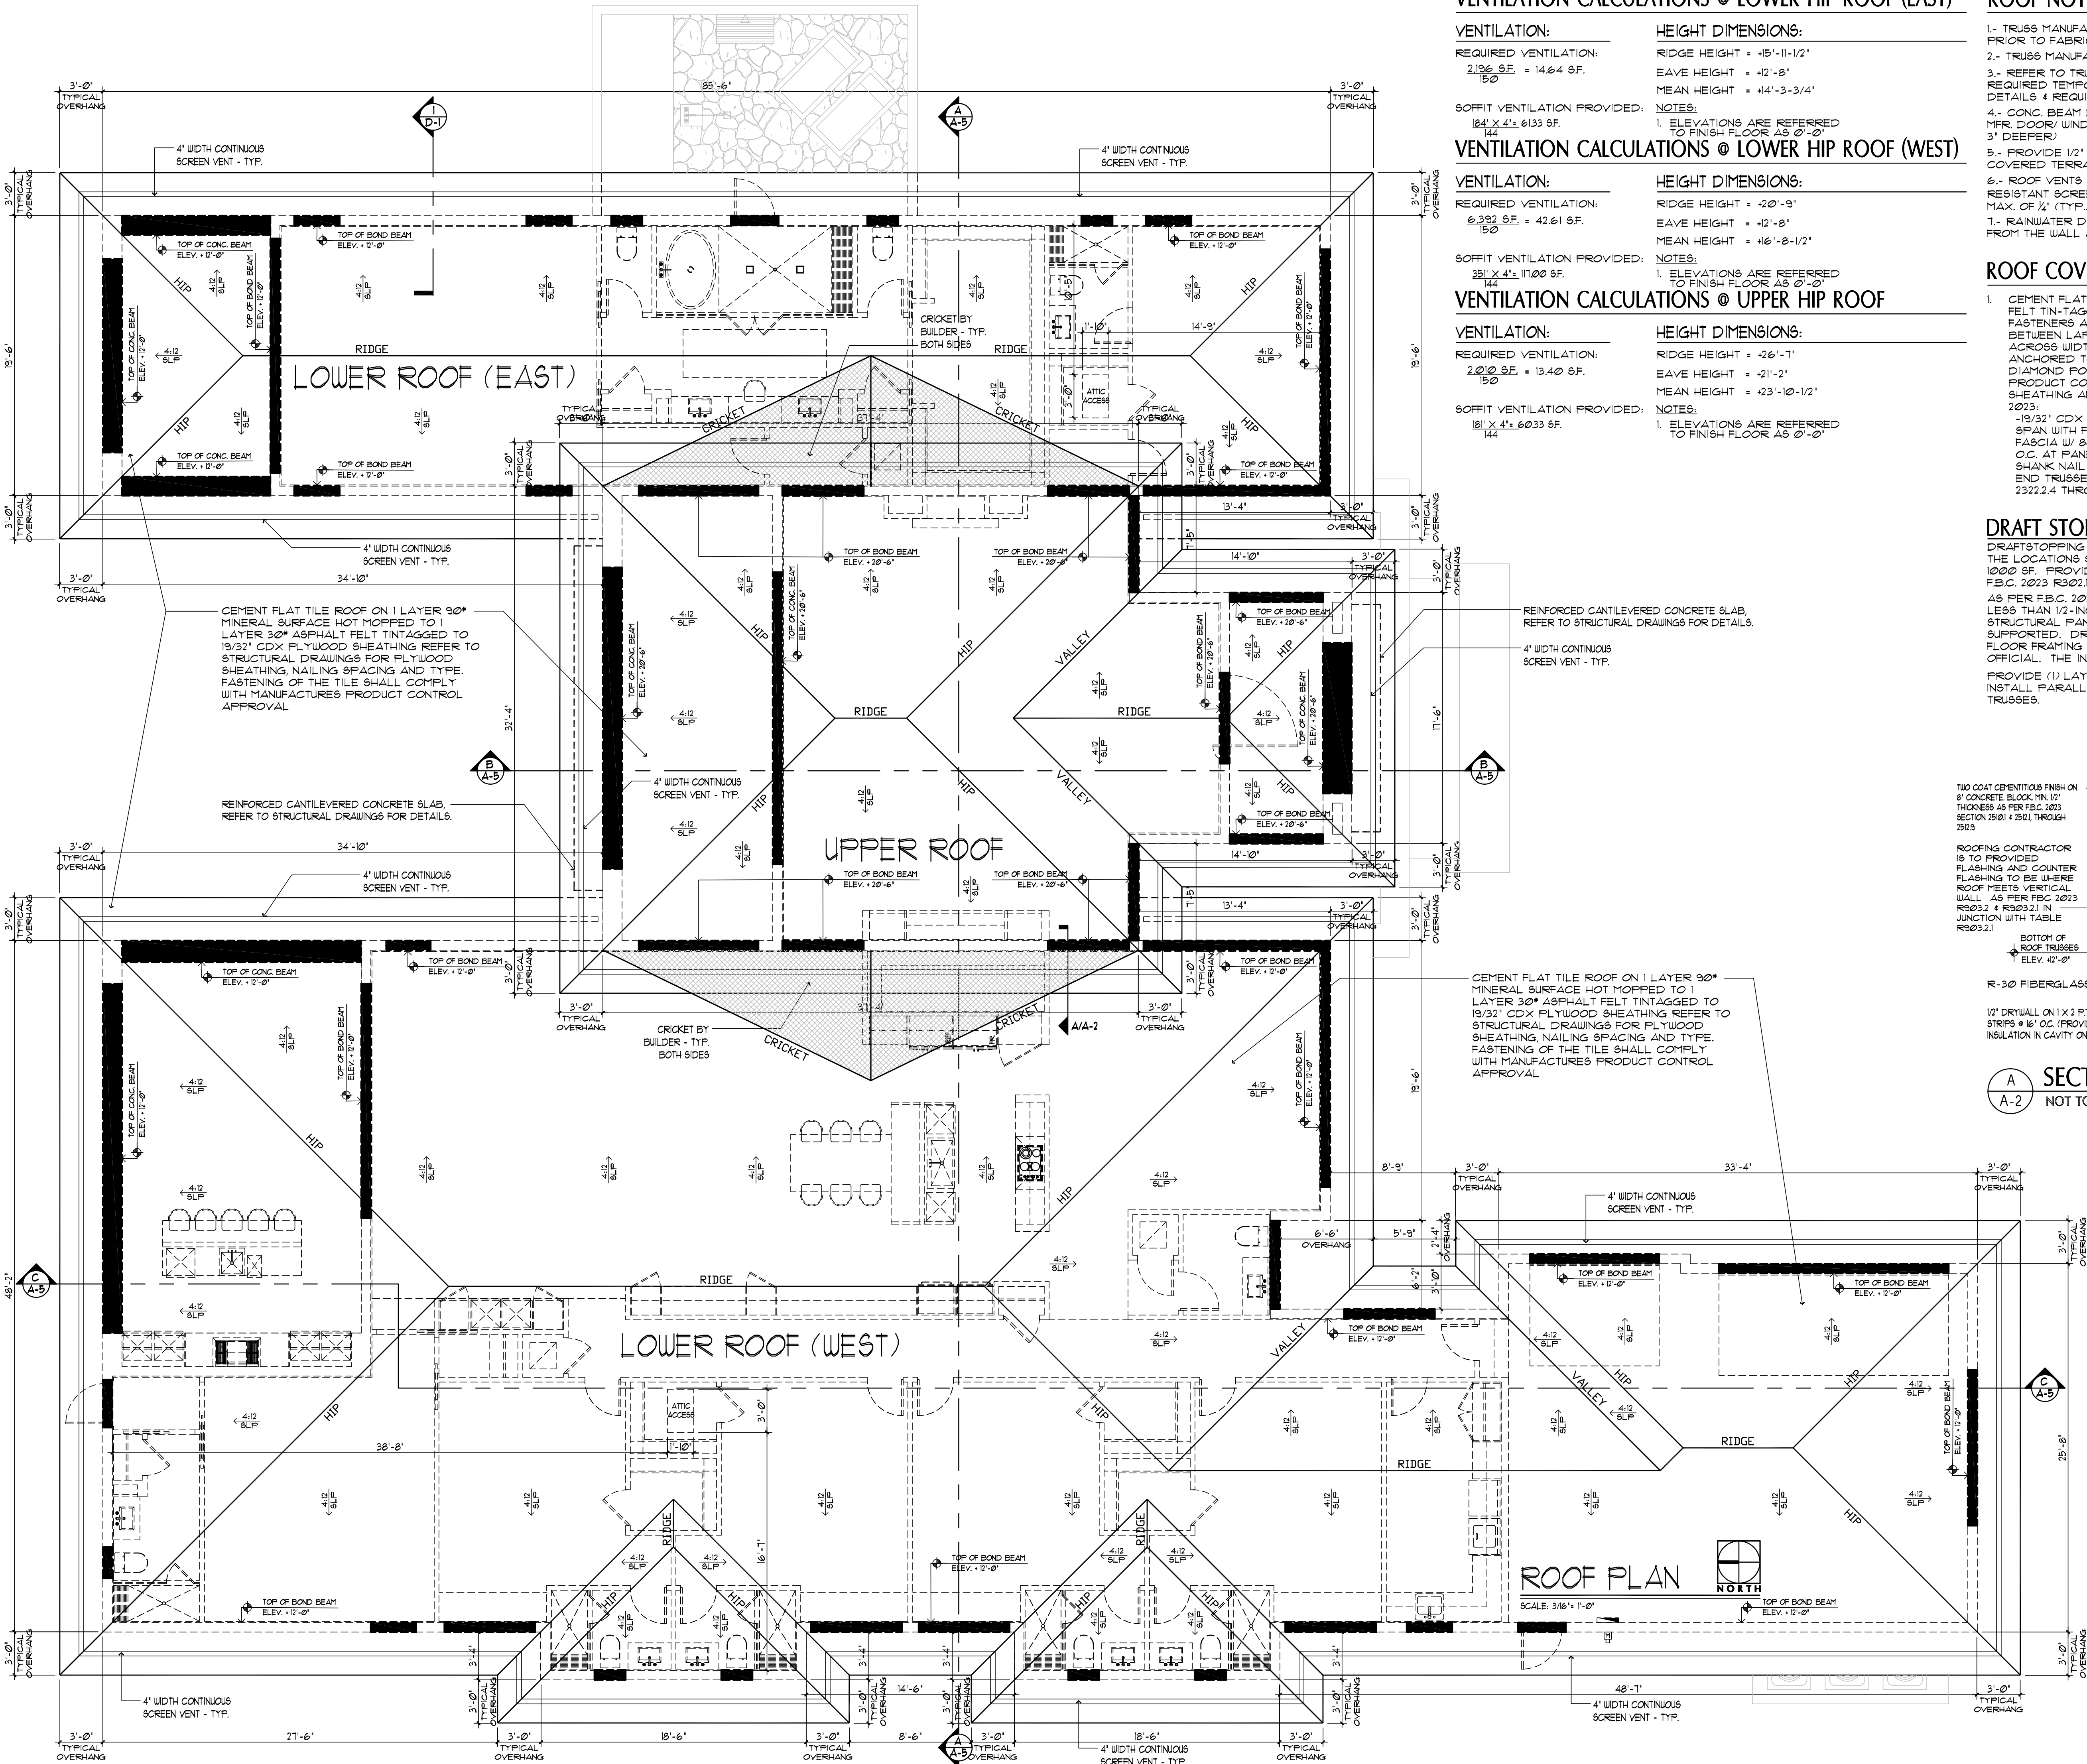

VENTILATION CALCULATIONS @ LOWER HIP ROOF (EAST)

VENTILATION:	HEIGHT DIMENSIONS:
REQUIRED VENTILATION: $2196 \text{ SF} = 14.64 \text{ SF}$	RIDGE HEIGHT = $+15'-11\frac{1}{2}"$ EAVE HEIGHT = $+12'-8"$ MEAN HEIGHT = $+14'-3\frac{3}{4}"$

SOFFIT VENTILATION PROVIDED:
 $184' \times 4' = 6133 \text{ SF}$

VENTILATION CALCULATIONS @ LOWER HIP ROOF (WEST)

VENTILATION:	HEIGHT DIMENSIONS:
REQUIRED VENTILATION: $6232 \text{ SF} = 42.61 \text{ SF}$	RIDGE HEIGHT = $+20'-9"$ EAVE HEIGHT = $+12'-8"$ MEAN HEIGHT = $+16'-8\frac{1}{2}"$

SOFFIT VENTILATION PROVIDED:
 $351' \times 4' = 1404 \text{ SF}$

VENTILATION CALCULATIONS @ UPPER HIP ROOF

VENTILATION:	HEIGHT DIMENSIONS:
REQUIRED VENTILATION: $2010 \text{ SF} = 13.40 \text{ SF}$	RIDGE HEIGHT = $+26'-1"$ EAVE HEIGHT = $+21'-2"$ MEAN HEIGHT = $+23'-10\frac{1}{2}"$

SOFFIT VENTILATION PROVIDED:
 $181' \times 4' = 6033 \text{ SF}$

ROOF NOTES:

- 1- TRUSS MANUFACTURER SHALL SUBMIT SHOP DWGS FOR ARCHITECT REVIEW PRIOR TO FABRICATION
- 2- TRUSS MANUFACTURER SHALL VERIFY ALL KNEE HEIGHTS
- 3- REFER TO TRUSS MANUFACTURER ENG. DRAWINGS FOR ALL ROOF TRUSSES REQUIRED TEMPORARY AND PERMANENT BRACING, GABLE END BRACING, DETAILS & REQUIRED GRAVITY BRACING.
- 4- CONC. BEAM DEPTH OVER DOOR/WINDOW OPENINGS MAY VARY AS PER MFR. DOOR/ WINDOW HGT. (FRENCH OR SLIDING DOORS AND WINDOWS UP TO 3' DEEPER)
- 5- PROVIDE 1/2" CDX. FLYWD. FELT MTL. LATH AND STUCCO FINISH AT ALL COVERED TERRACE AND ENTRY CEILING / SOFFITS (TYP.)
- 6- ROOF VENTS TO ATTIC SPACE MUST BE COVERED WITH CORROSION RESISTANT SCREENING. SCREEN OPENINGS TO BE BETWEEN A MIN. OF 1/8" & MAX. OF 1/4" (TYP.) AS PER F.B.C. 2023 SECTION R306.1
- 7- RAINWATER DOWNSPOUTS SHALL DISCHARGE A MINIMUM OF 12' AWAY FROM THE WALL AS PER F.B.C. 2023 SECTION R310.5

ROOF COVERING SPECIFICATION


1. CEMENT FLAT TILE ROOF ON PEEL AND STICK APPLICATION TO 1-30# FELT TIN-TAGGED TO 19/32" PLYWOOD SHEATHING. SPACING OF TIN-TAG FASTENERS ALONG THE LAP OF SHEETS, AND BOTH WAYS IN THE FIELD BETWEEN LAPS, SHALL BE 6" O.C. IN DIRECTION OF ROLL, 12" O.C. ACROSS WIDTH OF ROLL. AS PER F.B.C. 2023, THE 1-30# FELT IS ANCHORED TO THE PLYWOOD SHEATHING WITH SEMCO GALVANIZED DIAMOND POINTS, 1-1/4" X 120" DIAMETER. INSTALLATION SHALL BE PER PRODUCT CONTROL APPROVAL AND MANUFACTURER'S SPECS. WOOD SHEATHING ANCHORAGE SHALL BE NAILED IN ACCORDANCE WITH F.B.C. 2023.
2. 19/32" CDX PLYWOOD SHEATHING EXPOSURE 1 OVER TWO OR MORE SPAN WITH FACE GRAIN PERPENDICULAR TO SUPPORT ANCHORED TO FASCIA W/ 8d RING SHANK NAILS AT 4" O.C. ALL AROUND PERIMETER, 6" O.C. AT PANEL EDGES AND INTERMEDIATE SUPPORTS AND 8d RING SHANK NAIL OR 10d COMMON NAILS THROUGHOUT AND 4" O.C. AT GABLE END TRUSSES AND DIAPHRAGM BOUND. AS PER F.B.C. 2023 SECTION 2322.2.4 THROUGH 2322.2.5.2

DRAFT STOP:

DRAFTSTOPPING SHALL BE PROVIDED IN WOOD FRAME CONSTRUCTION IN THE LOCATIONS SPECIFIED IN SECTIONS R310.1 & R302.12 AND NOT EXCEED 1000 SF. PROVIDE (1) LAYER OF ANY DRAFTSTOP MATERIAL DESCRIBED IN F.B.C. 2023 R302.12

AS PER F.B.C. 2023 R302.12.1 DRAFTSTOPPING MATERIALS SHALL NOT BE LESS THAN 1/2-INCH (12.1 MM) GYPSUM BOARD, 3/8-INCH (9.5MM) WOOD STRUCTURAL PANELS OR OTHER APPROVED MATERIALS ADEQUATELY SUPPORTED. DRAFTSTOPPING SHALL BE INSTALLED PARALLEL TO THE FLOOR FRAMING MEMBERS UNLESS OTHERWISE APPROVED BY THE BUILDING OFFICIAL. THE INTEGRITY OF THE DRAFTSTOP SHALL BE MAINTAINED.

PROVIDE (1) LAYER OF ANY ABOVE MENTIONED DRAFTSTOP MATERIAL AND INSTALL PARALLEL TO AND NAILED TO TOP AND BOTTOM CHORD OF TRUSSES.

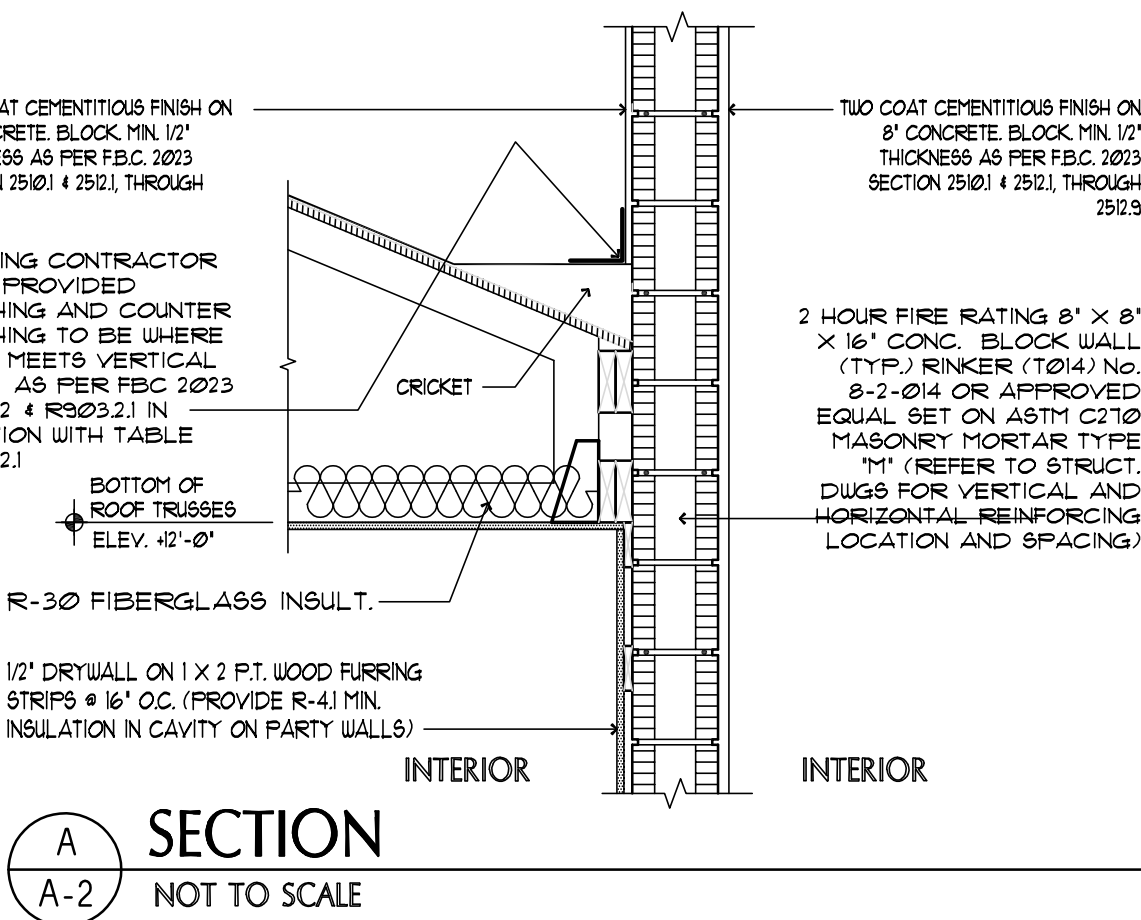

**PASQUAL
PEREZ
KILIDDJIAN
STARR**
ARCHITECTS + PLANNERS

LICENSE # AA 26001357
EDGARDO PEREZ, AIA
LICENSE NO.: AR 0015394
MARIO P. PASQUAL, AIA
LICENSE NO.: AR 0008254
PETER KILIDDJIAN, RA
LICENSE NO.: AR 0093067
ANDREW STARR, RA
LICENSE NO.: AR 0095130

AT THE BEACON CENTER
1330 NW 84th AVENUE
DORAL, FLORIDA 33126
TELEPHONE: (305) 592-1363
FACSIMILE: (305) 592-6845
http://www.ppkarch.com

COPYRIGHT © PASQUAL, PEREZ, KILIDDJIAN & ASSOCIATES - ARCHITECTS - PLANNERS

The architectural design and detail drawings of this building and/or overall project are the legal property of and all rights are reserved by the Architect. Their use for reproduction, construction or distribution is prohibited unless authorized in writing by the Architect.

REVISIONS:

OWNER:
HERITAGE HOME BUILDERS, LLC
9350 SOUTH DIXIE HIGHWAY
SUITE 1500
MIAMI, FL 33156
PHONE: 305.665.3077

NEW CONSTRUCTION AT PINECREST RESIDENCE:
BY HERITAGE HOME BUILDERS, LLC.
7725 SOUTHWEST 114 STREET
VILLAGE OF PINECREST, FL 33156

SEAL: Digitally signed by Edgardo Perez
DN: cn=Edgardo Perez, o=Pasqual, Perez, Kiliddjian, Starr & Associates, ll=Doral, FL-Florida, c=US
email=edgardo@pkarch.com, serial=2023.04.13 17:58:20-0400

ROOF PLAN	
DATE:	01/16/2023
SCALE:	AS SHOWN
DRAWN BY:	SJP
CHECK BY:	EP
JOB NO.:	22-22

COPYRIGHT © 2023 PASQUAL, PEREZ, KILIDDJIAN & ASSOCIATES - ARCHITECTS - PLANNERS
The architectural design and detail drawings for this building and / or overall project are the legal property of and all rights are reserved by the Architect. Their use for reproduction, construction or distribution is prohibited unless authorized in writing by Architect.

GENERAL NOTES

1. THIS STRUCTURE SHALL HAVE ALL EXTERIOR GLAZED OPENINGS INCLUDING GLASS BLOCK, SLIDING GLASS DOORS, AND FRENCH DOORS IMPACT GLASS RESISTANT. SEE ATTACHED MFR. AS PART OF THIS SET.
2. ALL WINDOWS GLASS SHALL BE SHGC = 0.31 & U-FACTOR 1.05
3. FRONT DOOR GARAGE DOOR AND ANY SIDE SERVICE EXTERIOR DOOR SHALL BE IMPACT RESISTANT.
4. IN BUILDINGS WITH STONE APPLICATION, PRE-FABRICATED WOOD BRACKETS, AND/OR PRE-FABRICATED TRIMS, A STUCCO SCRATCH COAT SHALL BE PROVIDED ON THE MASONRY BLOCK WITH A WATERPROOFING SEALER (SUPER THOROSEAL OR APPROVED EQUIVALENT) ON TOP OF THE SCRATCH COAT, PRIOR TO THE STONE/PRE-FABRICATED TRIM OR BRACKET INSTALLATION.
5. STUCCO APPLIED TO CONCRETE OR MASONRY SHALL COMPLY WITH FLORIDA BUILDING CODE 2011 - BUILDING, FIFTH EDITION, SECTION 25101 AND SECTION 2512.9, AND SHALL CONSIST OF AT LEAST TWO COATS AND THE TOTAL THICKNESS SHALL NOT BE LESS THAN 1/2".

ADDITIONAL NOTE:

* PROVIDE CAT. II LAMINATED GLASS WHERE THERE IS A DROP OF 4' OR MORE WITH A WINDOW SILL LESS THAN 36" AFF.

* AS PER VILLAGE OF PINECREST ZONING DEPARTMENT, THE MINIMUM FFE OF RESIDENCE MUST BE 1033' NGVD. (HIGHEST CROWN OF ROAD + 0.61') WITH ALL BUILDING HEIGHTS BEING MEASURED FROM HIGHEST CROWN OF ROAD, 1134' NGVD, AS PER SURVEY.


GARAGE (LOWEST HABITABLE FLOOR) FFE IS 1033' NGVD. PLEASE SEE ELEVATIONS ON THIS SHEET FOR BUILDING HEIGHTS AS PER VILLAGE OF ZONING CRITERIA.

ROOF NOTES


1. TRUSS MANUFACTURER SHALL SUBMIT SHOP DWGS FOR ARCHITECT REVIEW PRIOR TO FABRICATION
2. TRUSS MANUFACTURER SHALL VERIFY ALL KNEE HEIGHTS
3. REFER TO TRUSS MANUFACTURER ENG. DRAWINGS FOR ALL ROOF TRUSSES REQUIRED TEMPORARY AND PERMANENT BRACING, GABLE END BRACING, DETAILS & REQUIRED GRAVITY BRACING.
4. CONC. BEAM DEPTH OVER DOOR/WINDOW OPENINGS MAY VARY AS PER MFR. DOOR/ WINDOW HGT. (FRENCH OR SLIDING DOORS AND WINDOWS UP TO 3' DEEPER)
5. PROVIDE 1/2" CDX PLYWD. FELT MTL. LATH AND STUCCO FINISH AT ALL COVERED TERRACE AND ENTRY CEILING / SOFFITS (TYP).
6. ROOF VENTS TO ATTIC SPACE MUST BE COVERED WITH CORROSION RESISTANT SCREENING. SCREEN OPENINGS TO BE BETWEEN A MIN. OF 1/8" & MAX. OF 1/4" (TYP.) AS PER F.B.C. 2023 SECTION R206.1
7. RAINWATER DOWNSPOUTS SHALL DISCHARGE A MINIMUM OF 12" AWAY FROM THE WALL AS PER F.B.C. 2023 SECTION R310.5

ROOF COVERING SPECIFICATION

1. CEMENT FLAT TILE ROOF ON PEEL AND STICK APPLICATION TO 1-3/8" FELT TIN-TAGGED TO 19/32" PLYWOOD SHEATHING. SPACING OF TIN-TAG FASTENERS ALONG THE LAP OF SHEETS, AND BOTH WAYS IN THE FIELD BETWEEN LAPS, SHALL BE 6" O.C. IN DIRECTION OF ROLL, 12" O.C. ACROSS WIDTH OF ROLL, AS PER F.B.C. 2023. THE 1-3/8" FELT IS ANCHORED TO THE PLYWOOD SHEATHING WITH SEMCO GALVANIZED, DIAMOND POINTS, 1-1/4" X 120" DIAMETER. INSTALLATION SHALL BE PER PRODUCT CONTROL APPROVAL AND MANUFACTURER'S SPECS. WOOD SHEATHING ANCHORAGE SHALL BE NAILED IN ACCORDANCE WITH F.B.C. 2023.2:
19/32" CDX PLYWOOD SHEATHING EXPOSURE 1 OVER TWO OR MORE SPAN WITH FACE GRAIN PERPENDICULAR TO SUPPORT ANCHORED TO FASCIA W/ 20 RING SHANK NAILS AT 4" O.C. ALL AROUND PERIMETER. 6" O.C. AT PANEL EDGES AND INTERMEDIATE SUPPORTS AND 20 RING SHANK NAIL OR 10d COMMON NAILS THROUGHOUT AND 4" O.C. AT GABLE END TRUSSES AND DIAPHRAGM BOUND. AS PER F.B.C. 2023 SECTION 2322.2.4 THROUGH 2322.2.5.2

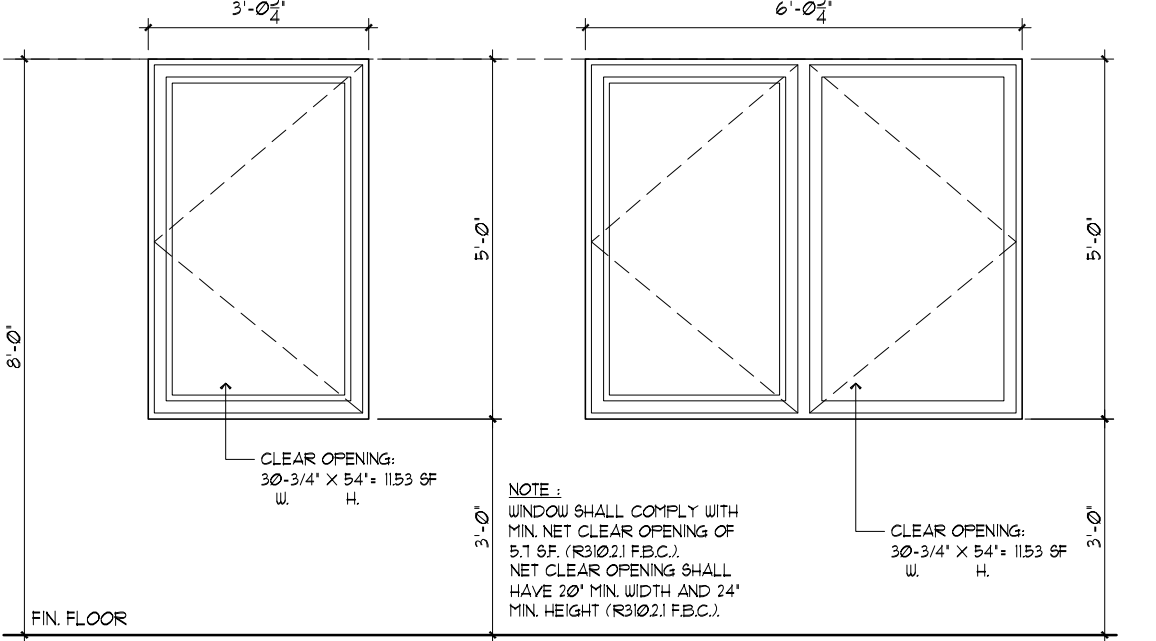


TYP. EGRESS WINDOWS DETL.
NOT TO SCALE

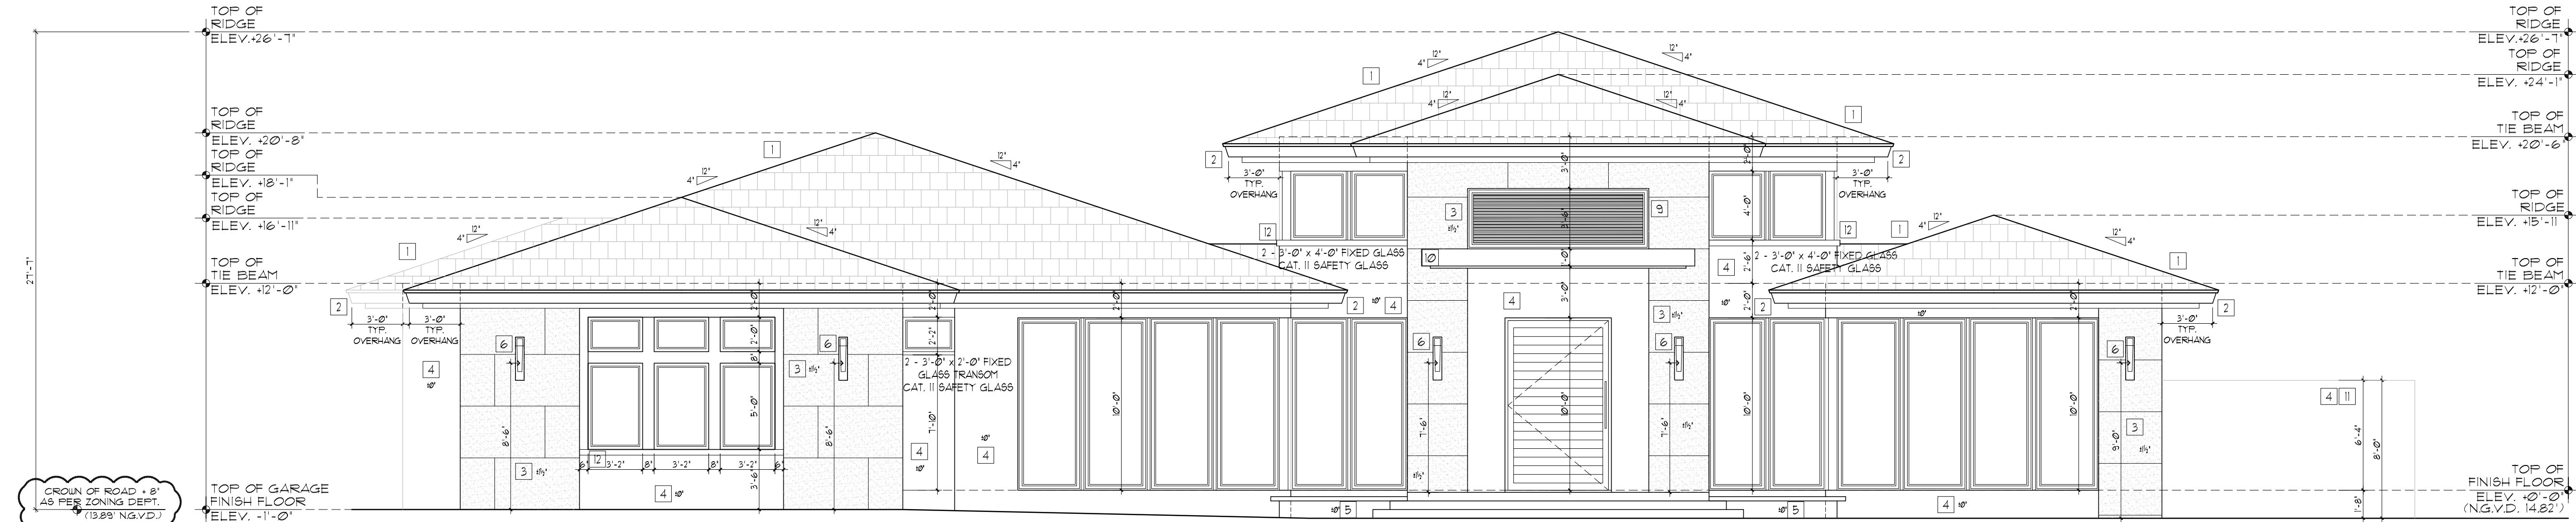

SOUTH ELEVATION

SCALE: 3/16" = 1'-0"

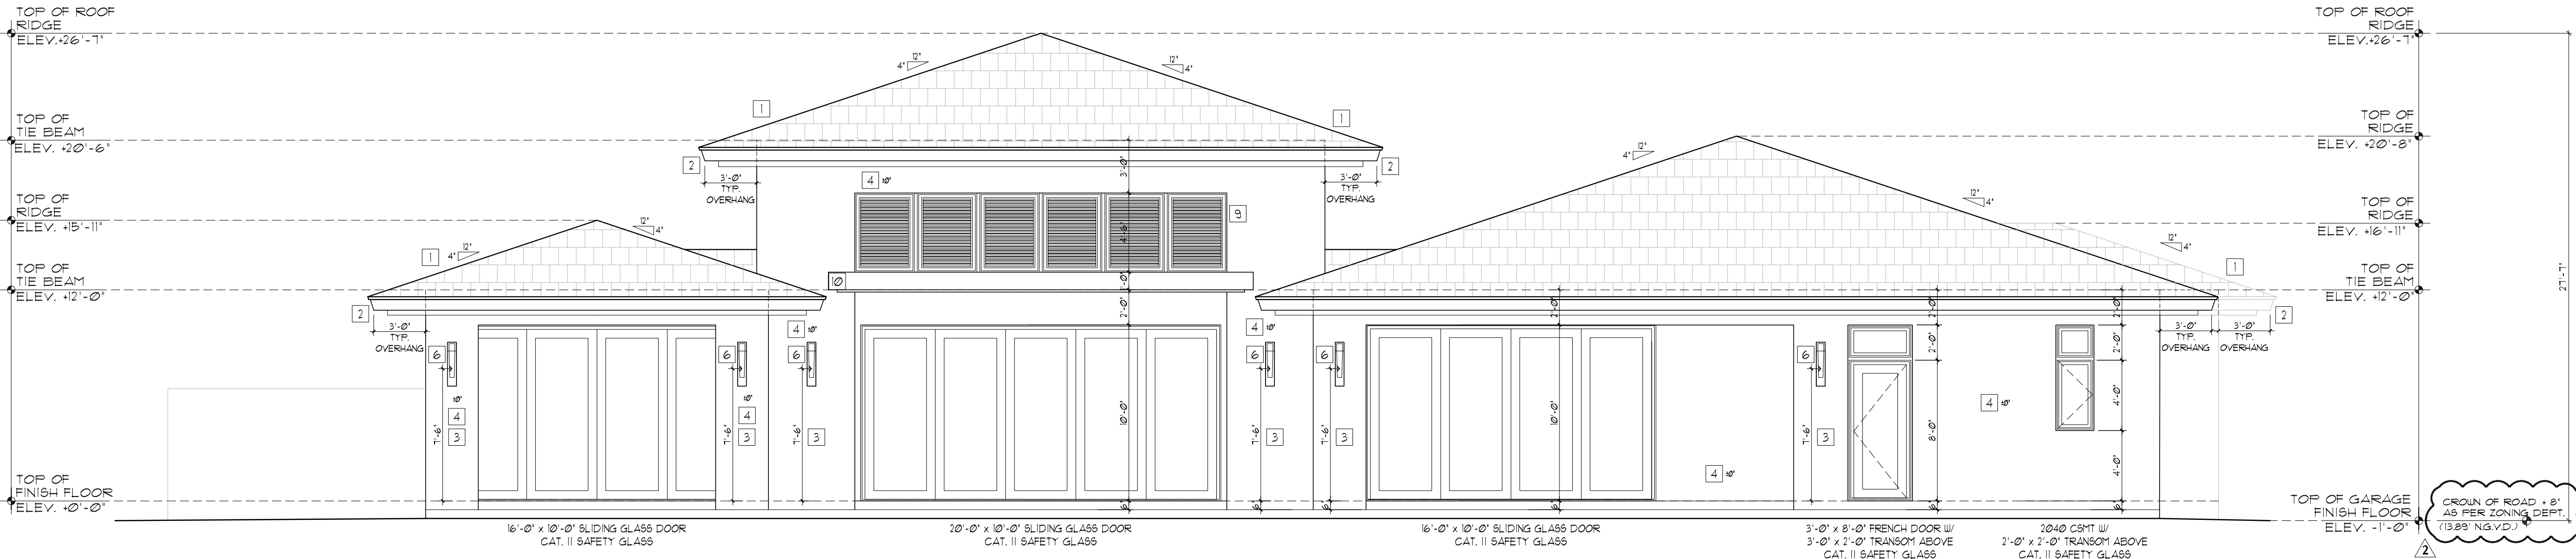

NORTH ELEVATION

SCALE: 3/16" = 1'-0"

LEGEND:

- 1 CEMENT FLAT TILE ROOF - SEE ROOF COVERING NOTE ON THIS SHEET
- 2 2" X 8" SMOOTH FINISH WOOD FASCIA
- 3 DECORATIVE STONE VENEER
- 4 SMOOTH STUCCO FINISH
- 5 CONCRETE PLANTER, REFER TO STRUCTURAL DRAWINGS
- 6 COACH LIGHT
- 7 REINFORCED CONCRETE BEAM, REFER TO STRUCTURAL DRAWINGS FOR DETAILS.
- 8 REINFORCED CONCRETE SLAB AND FOUNDATION, REFER TO STRUCTURAL DRAWINGS FOR DETAILS.
- 9 PRE-FABRICATED ALUMINUM LOUVER - BY OTHERS
- 10 REINFORCED CANTILEVERED CONCRETE SLAB, REFER TO STRUCTURAL DRAWINGS FOR DETAILS.
- 11 CONCRETE PRIVACY WALL, REFER TO STRUCTURAL DRAWINGS
- 12 1/2" THICK STUCCO BAND - SEE ELEV. FOR WIDTHS

PASCUAL
PEREZ
KILIDDJIAN
STARR
ARCHITECTS + PLANNERS

LICENSE # AA 26001357
EDGARDO PEREZ, AIA
LICENSE NO.: AR 0015394
MARIO P. PASQUAL, AIA
LICENSE NO.: AR 0008254
PETER KILIDDJIAN, RA
LICENSE NO.: AR 0093067
ANDREW STARR, RA
LICENSE NO.: AR 0095130

AT THE BEACON CENTER
1330 NW 84TH AVENUE
DORAL, FLORIDA 33126
TELEPHONE: (305) 592-1363
FACSIMILE: (305) 592-6865
http://www.ppkarch.com


COPYRIGHT © PASQUAL, PEREZ, KILIDDJIAN
& STARR, ARCHITECTS - PLANNERS
The architectural design and detail drawings
of this building and/or overall project are the
legal property of and all rights are reserved
by the Architect. Their use for reproduction,
construction or distribution is prohibited unless
authorized in writing by the Architect.

REVISIONS:

2. 08.10.23 BLDG. DEPT. REV.

OWNER:
HERITAGE HOME BUILDERS, LLC
9350 SOUTH DIXIE HIGHWAY
SUITE 1500
MIAMI, FL 33156
PHONE: 305.665.3077

NEW CONSTRUCTION AT PINECREST RESIDENCE
BY HERITAGE HOME BUILDERS, LLC.
7725 SOUTHWEST 114 STREET
VILLAGE OF PINECREST, FL 33156



Digitally signed by Edgardo
Perez
DN:
E=ed_perez@ppkarch.com,
CN=Edgardo Perez,
O=Pascual, Perez,
Kiliddjian, Starr &
Associates, L.L.C., L=Doral,
S=Florida, C=US
Date: 2023.08.23
09:57:22-04'00'

ELEVATIONS

DATE: 0116.2023
SCALE: AS SHOWN
DRAWN: SJF
CHECK BY: EP
JOB NO.: 22-22

A-3

SHEET NO.:

COPYRIGHT © 2023 PASCUAL, PEREZ, KILIDDJIAN & ASSOCIATES - ARCHITECTS - PLANNERS
The architectural design and detail drawings for this building and / or overall project are the legal property of and all rights are reserved by the Architect. Their use for reproduction, construction or distribution is prohibited unless authorized in writing by Architect.

GENERAL NOTES

1. THIS STRUCTURE SHALL HAVE ALL EXTERIOR GLAZED OPENINGS INCLUDING GLASS BLOCK, SLIDING GLASS DOORS, AND FRENCH DOORS IMPACT GLASS RESISTANT. SEE ATTACHED MFR. AS PART OF THIS SET.
2. ALL WINDOWS GLASS SHALL BE SHGC = 0.31 & U-FACTOR 1.05
3. FRONT DOOR GARAGE DOOR AND ANY SIDE SERVICE EXTERIOR DOOR SHALL BE IMPACT RESISTANT.
4. IN BUILDINGS WITH STONE APPLICATION, PRE-FABRICATED WOOD BRACKETS, AND/OR PRE-FABRICATED TRIMS, A STUCCO SCRATCH COAT SHALL BE PROVIDED ON THE MASONRY BLOCK WITH A WATERPROOFING SEALER (SUPER THOROSEAL OR APPROVED EQUIVALENT) ON TOP OF THE SCRATCH COAT, PRIOR TO THE STONE/PRE-FABRICATED TRIM OR BRACKET INSTALLATION.
5. STUCCO APPLIED TO CONCRETE OR MASONRY SHALL COMPLY WITH FLORIDA BUILDING CODE 2011 - BUILDING, FIFTH EDITION, SECTION 2510.1 AND SECTION 2512.9, AND SHALL CONSIST OF AT LEAST TWO COATS AND THE TOTAL THICKNESS SHALL NOT BE LESS THAN 1/2".

ADDITIONAL NOTE:

* PROVIDE CAT. II LAMINATED GLASS WHERE THERE IS A DROP OF 4' OR MORE WITH A WINDOW SILL LESS THAN 36" AFF.

* AS PER VILLAGE OF PINECREST ZONING DEPARTMENT, THE MINIMUM FFE OF RESIDENCE MUST BE 10'33" NGVD. (HIGHEST CROWN OF ROAD + 0.61') WITH ALL BUILDING HEIGHTS BEING MEASURED FROM HIGHEST CROWN OF ROAD, 11'34" NGVD, AS PER SURVEY.


GARAGE (LOWEST HABITABLE FLOOR) FFE IS 10'33" NGVD. PLEASE SEE ELEVATIONS ON THIS SHEET FOR BUILDING HEIGHTS AS PER VILLAGE OF ZONING CRITERIA.

ROOF NOTES



1. TRUSS MANUFACTURER SHALL SUBMIT SHOP DWGS FOR ARCHITECT REVIEW PRIOR TO FABRICATION
2. TRUSS MANUFACTURER SHALL VERIFY ALL KNEE HEIGHTS
3. REFER TO TRUSS MANUFACTURER ENG. DRAWINGS FOR ALL ROOF TRUSSES, REQUIRED TEMPORARY AND PERMANENT BRACING, GABLE END BRACING, DETAILS & REQUIRED GRAVITY BRACING.
4. CONC. BEAM DEPTH OVER DOOR/WINDOW OPENINGS MAY VARY AS PER MFR. DOOR/WINDOW HGT. (FRENCH OR SLIDING DOORS AND WINDOWS UP TO 3' DEEPER)
5. PROVIDE 1/2" CDX PLYWD. FELT MTL. LATH AND STUCCO FINISH AT ALL COVERED TERRACE AND ENTRY CEILING / SOFFITS (TYP.)
6. ROOF VENTS TO ATTIC SPACE MUST BE COVERED WITH CORROSION RESISTANT SCREENING. SCREEN OPENINGS TO BE BETWEEN A MIN. OF 1/8" & MAX. OF 1/4" (TYP.) AS PER F.B.C. 2023 SECTION R806.1
7. RAINWATER DOWNSPOUTS SHALL DISCHARGE A MINIMUM OF 12' AWAY FROM THE WALL AS PER F.B.C. 2023 SECTION R310.5

ROOF COVERING SPECIFICATION

1. CEMENT FLAT TILE ROOF ON PEEL AND STICK APPLICATION TO 1-3/8" FELT TIN-TAGGED TO 19/32" PLYWOOD SHEATHING. SPACING OF TIN-TAG FASTENERS ALONG THE LAP OF SHEETS, AND BOTH WAYS IN THE FIELD BETWEEN LAPS, SHALL BE 6" O.C. IN DIRECTION OF ROLL, 12" O.C. ACROSS WIDTH OF ROLL, AS PER F.B.C. 2023. THE 1-3/8" FELT IS ANCHORED TO THE PLYWOOD SHEATHING WITH SEMCO GALVANIZED, DIAMOND POINT, 1-1/4" X 120" DIAMETER. INSTALLATION SHALL BE PER PRODUCT CONTROL APPROVAL AND MANUFACTURER'S SPECS. WOOD SHEATHING ANCHORAGE SHALL BE NAILED IN ACCORDANCE WITH F.B.C. 2023:

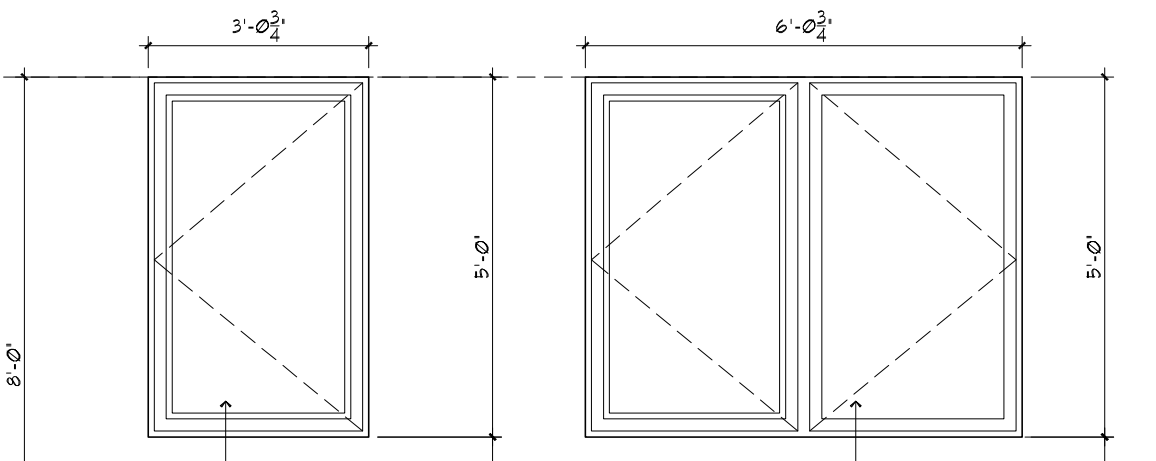

CSMT 3050 (EGRESS) CSMT 6050 (EGRESS)
TYP. EGRESS WINDOWS DTL.
NOT TO SCALE

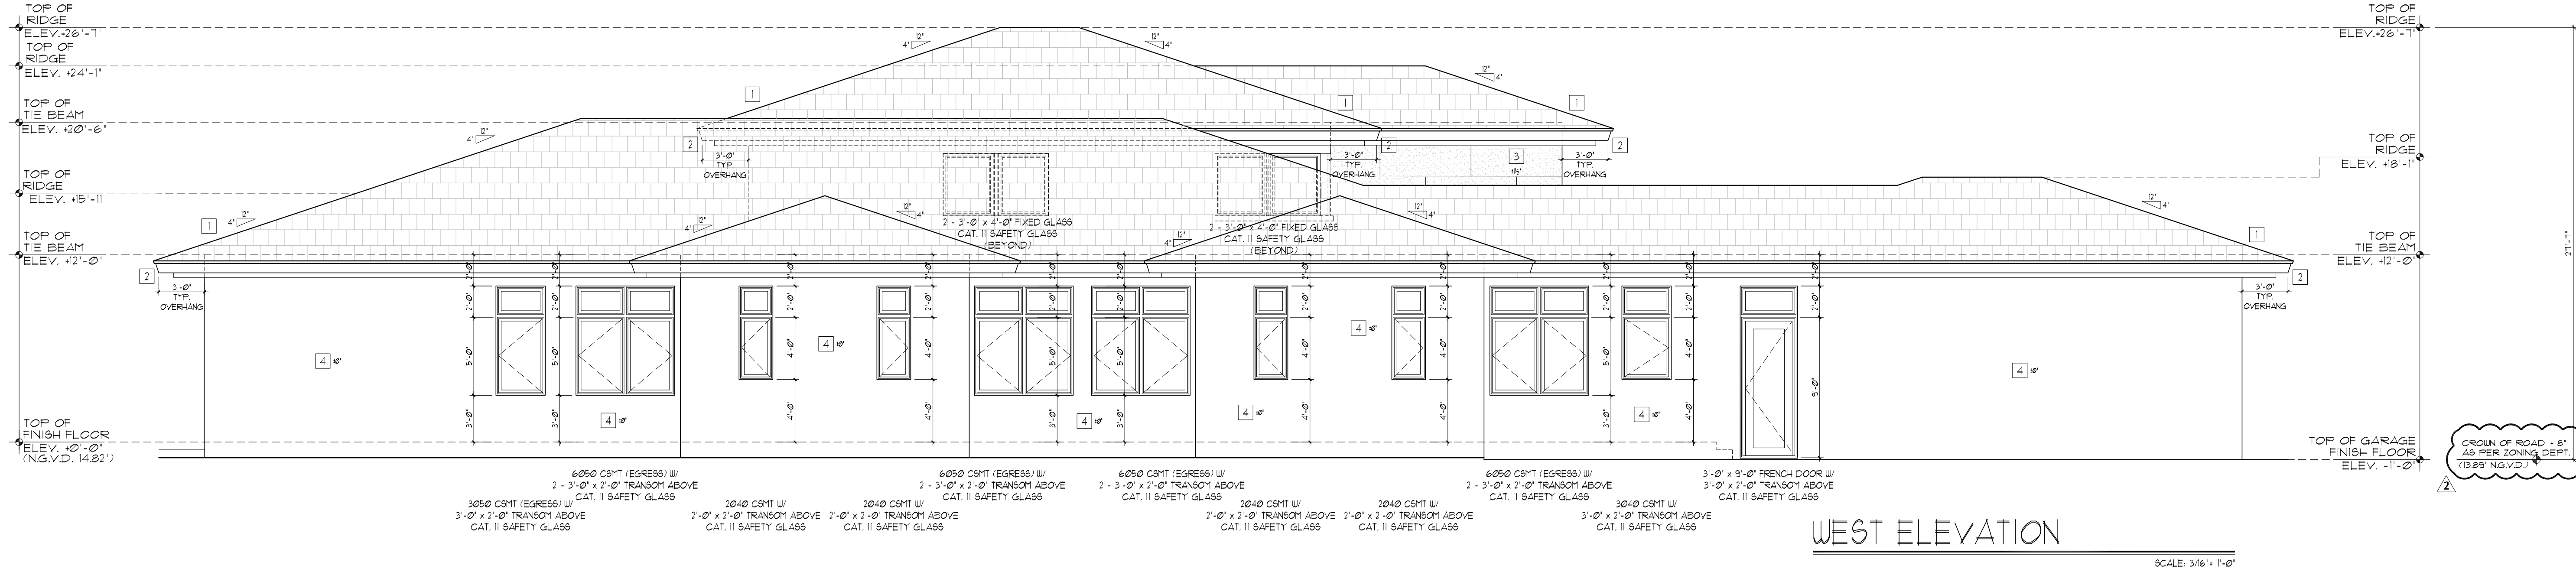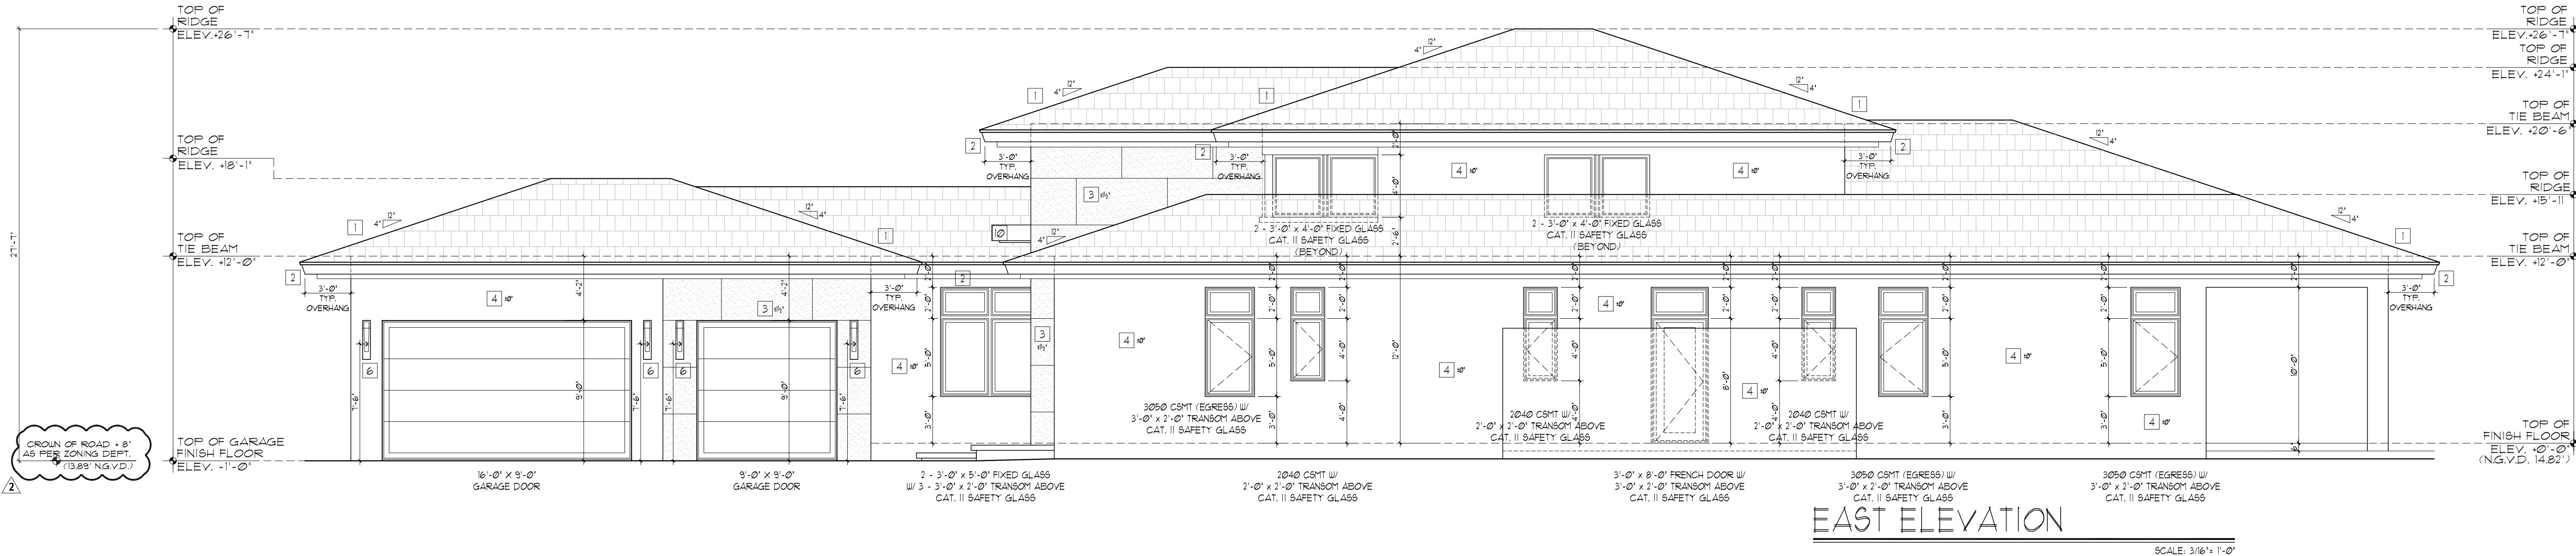

LEGEND:

- 1 CEMENT FLAT TILE ROOF - SEE ROOF COVERING NOTE ON THIS SHEET
- 2 2' X 8' SMOOTH FINISH WOOD FASCIA
- 3 DECORATIVE STONE VENEER
- 4 SMOOTH STUCCO FINISH
- 5 CONCRETE PLANTER, REFER TO STRUCTURAL DRAWINGS
- 6 COACH LIGHT
- 7 REINFORCED CONCRETE BEAM, REFER TO STRUCTURAL DRAWINGS FOR DETAILS.
- 8 REINFORCED CONCRETE SLAB AND FOUNDATION, REFER TO STRUCTURAL DRAWINGS FOR DETAILS.
- 9 PRE-FABRICATED ALUMINUM LOUVER - BY OTHERS
- 10 REINFORCED CANTILEVERED CONCRETE SLAB, REFER TO STRUCTURAL DRAWINGS FOR DETAILS.
- 11 CONCRETE PRIVACY WALL, REFER TO STRUCTURAL DRAWINGS
- 12 1/2" THICK STUCCO BAND - SEE ELEV. FOR WIDTHS

PASCUAL PEREZ KILIDDJIAN STARR

ARCHITECTS + PLANNERS

LICENSE # AA 26001357
EDGARDO PEREZ, AIA
LICENSE NO.: AR 0015394
MARIO P. PASCUAL, AIA
LICENSE NO.: AR 0008254
PETER KILIDDJIAN, RA
LICENSE NO.: AR 0093067
ANDREW STARR, RA
LICENSE NO.: AR 0095130

AT THE BEACON CENTER
1330 NW 84TH AVENUE
DORAL, FLORIDA 33126
TELEPHONE: (305) 592-1363
FACSIMILE: (305) 592-6865
http://www.ppkarch.com

COPYRIGHT © PASCUAL, PEREZ, KILIDDJIAN
STARR, ARCHITECTS - PLANNERS
The architectural design and detail drawings
of this building and/or overall project are the
legal property of and all rights are reserved
by the Architect. Their use for reproduction,
construction or distribution is prohibited unless
authorized in writing by the Architect.

REVISIONS:

2 08.10.23 BLDG. DEPT. REV.

OWNER:
HERITAGE HOME BUILDERS, LLC
9350 SOUTH DIXIE HIGHWAY
SUITE 1500
MIAMI, FL 33156
PHONE: 305.665.3077

NEW CONSTRUCTION AT PINECREST RESIDENCE:
BY HERITAGE HOME BUILDERS, LLC.
7725 SOUTHWEST 114 STREET
VILLAGE OF PINECREST, FL 33156

SEAL:
STATE OF FLORIDA
REGISTERED ARCHITECT
AR0015394
Digitally signed by Edgardo
Perez
DN:
E=edgardo.perez@ppkarch.com,
CN=Edgardo Perez,
O=Pascual, Perez,
Kiliddjian, Starr &
Associates, L=L-Doral,
S=Florida, C=US
Date: 2023.08.23
09:57:14-0400

ELEVATIONS
DATE: 0116.2023
SCALE: AS SHOWN
DRAWN: SJF
CHECK BY: EP
JOB NO.: 22-22

SHEET NO.:

A-4

GENERAL NOTES:

- PRIOR TO START OF CONSTRUCTION, THE CONTRACTOR AND ALL THE SUBCONTRACTORS SHALL VERIFY ALL GRADES, LINES, LEVELS, DIMENSIONS AND COORDINATE EXISTING CONDITIONS AT THE JOB SITE WITH THE PLANS AND SPECIFICATIONS. THEY SHALL REPORT ANY ON CONSIDERATIONS OR ERRORS IN THE ABOVE TO THE ARCHITECT/ENGINEER BEFORE COMMENCING WORK FROM ESTABLISHED REFERENCE POINTS AND BE RESPONSIBLE FOR ALL LINES, ELEVATIONS AND MEASUREMENTS IN CONNECTION WITH THEIR WORK.
- IF ANY ERRORS OR OMISSIONS APPEAR IN THE DRAWINGS, GENERAL NOTES OR OTHER DOCUMENTS, THE CONTRACTOR SHALL NOTIFY THE ARCHITECT/ENGINEER IN WRITING OF SUCH OMISSION OR ERROR PRIOR TO PROCEEDING WITH ANY WORK WHICH APPEARS IN QUESTION. IN THE EVENT OF THE CONTRACTORS FAILING TO GIVE SUCH AN ADVANCED NOTICE, HE SHALL BE RESPONSIBLE FOR THE RESULTS OF ANY SUCH ERRORS OR OMISSIONS AND THE COST OF RECTIFYING THE SAME.
- ALL DIMENSIONS SHALL BE CONSIDERED "NOMINAL" UNLESS OTHERWISE NOTED. DIMENSIONS ON LARGE SCALE DRAWINGS OR DETAILS WILL PREVAIL OVER SMALLER SCALE DRAWINGS.
- DO NOT SCALE DIMENSIONS. USE FIGURED DIMENSIONS ONLY. VERIFY ALL DIMENSIONS & CONDITIONS IN THE EVENT OF CONFLICT, NOTIFY THE ARCHITECT BEFORE PROCEEDING.
- SHOWER/BATHING COMPARTMENTS SHALL HAVE FLOORS AND WALLS CONSTRUCTED OF SMOOTH, CORROSION RESISTANT AND NONABSORBENT WATER-RESISTANT MATERIALS (GREEN BOARD NOT ACCEPTABLE) TO HEIGHT OF NOT LESS THAN 12 INCHES ABOVE THE COMPARTMENT FLOOR AT THE DRAIN BY SECTION R-302.2 FBC 2023.
- EVERY SLEEPING ROOM SHALL HAVE AT LEAST ONE EMERGENCY ESCAPE AND RESCUE OPENING OPERABLE FROM THE INSIDE. THE MODE OF OPERATION SHALL NOT REQUIRE THE USE OF A KEY, TOOL, SPECIAL KNOWLEDGE OR EFFORT. SUCH CLEAR OPENING SHALL BE NOT LESS THAN 20" IN WIDTH, AND 24" IN HEIGHT (51.5" IN AREA). THE BOTTOM OF THE CLEAR OPENING SHALL NOT BE MORE THAN 44" ABOVE THE FINISHED FLOOR. NO PART OF THE OPERATING MECHANISM SHALL BE PLACED HIGHER THAN 54" ABOVE FINISHED FLOOR. AS PER FBC 2023 SECTION R302.1 THRU R302.4.
- NUMBERS OF ADDRESS SHALL BE PLACED VISIBLE AND LEGIBLE FROM THE STREET FRONTING THE PROPERTY AND SHALL BE 4 INCHES MIN. IN HEIGHT. AS PER FBC 2023 R303.
- REFER TO FOUNDATION PLAN FOR CONCRETE FILLED BLOCK CELL LOCATION, SIZE & REINF.
- ALL FIXED GLASS PANELS SHALL BE ¾" SAFETY GLASS CAT. II MINIMUM.
- CAT. II SAFETY GLASS SHALL BE USED AT ALL SHOWER/TUB ENCLOSURES INCLUDING ANY GLAZING WITHIN 60" OF THE FINISH FLOOR SURFACE IN WALLS SURROUNDING ANY TUB OR SHOWER ENCLOSURE AS PER TABLE R-308.4.5 FBC 2023.
- EVERY CLOSET DOOR LATCH SHALL BE SUCH THAT CHILDREN CAN OPEN THE DOOR FROM THE INSIDE OF THE CLOSET. NFPA 21-2.4.4.
- EVERY BATHROOM DOOR LOCK SHALL BE DESIGNED TO PERMIT THE OPENING OF THE LOCKED DOOR FROM THE OUTSIDE IN AN EMERGENCY. NFPA 21-2.4.5.
- ATTICS NOT USED FOR HABITATION PURPOSES SHALL HAVE PROVISIONS FOR THE EMISSION OF EXCESS HEAT. FBC 2023 2023.
- TERMITE PROTECTION SHALL BE PROVIDED BY REGISTERED TERMITICIDES, INCLUDING SOIL APPLIED PESTICIDES, BAITING SYSTEMS, AND PESTICIDES APPLIED TO WOOD, OR OTHER APPROVED METHODS OF TERMITE PROTECTION LABELED FOR USE AS A PREVENTATIVE TREATMENT TO NEW CONSTRUCTION. SEE SECTION 202, REGISTERED TERMITE TREATMENT. UPON COMPLETION OF THE APPLICATION OF THE TERMITE PROTECTANT TREATMENT, A CERTIFICATE OF COMPLIANCE SHALL BE ISSUED TO THE BUILDING DEPARTMENT BY THE LICENSED PEST CONTROL COMPANY THAT CONTAINS THE FOLLOWING STATEMENT: "THE BUILDING HAS RECEIVED A COMPLETE TREATMENT FOR THE PREVENTION OF SUBTERRANEAN TERMITES. TREATMENT IS IN ACCORDANCE WITH RULES AND LAWS ESTABLISHED BY THE FLORIDA DEPARTMENT OF AGRICULTURE AND CONSUMER SERVICES AS PER R301."
- HEIGHT OF WINDOW SILL AT AND FLOOR EGRESS. WINDOWS SHALL BE A MIN. OF 36" ABOVE THE FINISH FLOOR AND SHALL NOT EXCEED A MAX. OF 44" ABOVE THE FINISH FLOOR.
- SHUTTERS USED TO PROTECT OPENINGS ABOVE THE FIRST STORY OF ANY BUILDING MUST BE PERMANENTLY INSTALLED AND CLOSABLE FROM THE INSIDE OF THE BUILDING AS PER SECTION 2413.6 FBC 2023.
- FLAME SPREAD AND SMOKE DENSITY:
WALL AND CEILING FINISHES SHALL HAVE A FLAME-SPREAD CLASSIFICATION OF NOT GREATER THAN 200 AND A SMOKE-DEVELOPED INDEX OF NOT GREATER THAN 450 AS PER FBC 2023 SECTION R302.3. INSULATION MATERIALS INCLUDING FACINGS, SUCH AS VAPOR RETARDERS OR VAPOR PERMEABLE MEMBRANES INSTALLED WITH FLOOR-CEILING ASSEMBLIES, ROOF-CEILING ASSEMBLIES SHALL ASSEMBLIES BE CLASSIFIED AS CLASS 1. CLASS 1 SHALL HAVE A FLAME SPREAD INDEX NOT TO EXCEED 25 WITH AN ACCOMPANYING SMOKE-DEVELOPED INDEX NOT TO EXCEED 450 AS PER FBC 2023 SECTION R302.10.
- ALL EGRESS DOORS SHALL BE READILY OPENABLE FROM THE SIDE FROM WHICH EGRESS IS TO BE MADE WITHOUT THE USE OF A KEY OR SPECIAL KNOWLEDGE OR EFFORT. AS PER FBC 2023 R302.2.
- GLAZING INSTALLED IN HAZARDOUS LOCATIONS SHALL BE PROVIDED WITH A MANUFACTURER'S OR INSTALLER'S LABEL DESIGNATING TYPE AND THICKNESS OF GLASS AND THE SAFETY GLAZING STANDARD WITH WHICH IT COMPLIES AND IS VISIBLE IN THE FINAL INSTALLATION AS PER FBC R309.1. OPERATIVE WINDOW AND DOOR ASSEMBLIES SHALL BE TESTED IN ACCORDANCE WITH THE REQUIREMENTS OF SECTION FBC 2023 2413.1.6.
- IN BUILDINGS WITH COMBUSTIBLE CEILING OR ROOF CONSTRUCTION, AN ATTIC ACCESS OPENING SHALL BE PROVIDED WITH THE ROUGH-FRAMED OPENING NOT LESS THAN 22" BY 30" AS PER R302.1 FBC 2023. A 30" MIN. UNOBSTRUCTED HEADROOM IN THE ATTIC SHALL BE PROVIDED.
- ENCLOSED ACCESSIBLE SPACE UNDER STAIRS SHALL HAVE WALLS UNDER STAIR SURFACE AND ANY EGRESS PROTECTED ON THE ENCLOSED SIDE WITH 1/2" GYPSUM BOARD IN ACCORDANCE WITH SECTION R302.1 FBC 2023.
- PROTECTION FROM DECAY SHALL BE PROVIDED IN THE LOCATIONS IN ACCORDANCE WITH SECTION R302.5 FBC 2023.
- HABITABLE ROOMS, HALLWAYS, CORRIDORS, BATHROOMS, TOILET ROOMS, LAUNDRY ROOMS, LAUNDRY ROOMS AND BATHS SHALL HAVE A CEILING HEIGHT OF NOT LESS THAN 7'-6" AS PER FBC 2023 SECTION 1009.1. FOR ROOMS WITH SLOPED CEILING, AT LEAST 50% OF THE REQUIRED FLOOR AREA OF THE ROOM MUST HAVE A CEILING HEIGHT OF AT LEAST 7 FEET AND NO PORTION OF THE REQUIRED FLOOR AREA MAY HAVE A CEILING HEIGHT OF LESS THAN 5 FEET. PER FBC 2023 SECTION 1009.2 (EXCEPTION 2) BATHROOMS SHALL HAVE A MIN. CEILING HEIGHT OF 6'-8" AS PER FBC 2023 SECTION 1009.2 (EXP. 4).
- COMBUSTIBLE INSULATION SHALL BE SEPARATED A MINIMUM OF 3 INCHES (76 MM) FROM RECESSED LUMINAIRES, FAN MOTORS AND OTHER HEAT-PRODUCING DEVICES. FBC 2023 SECTION R302.13.
- ALL ELECTRICAL EQUIPMENT SHALL BE INSTALLED ABOVE BASE FLOOR ELEVATION AS PER FBC 2023 R322 OF THE FLORIDA MECHANICAL CODE, OR AT AN ELEVATION EQUAL TO THE FINISHED FLOOR OF THE HOUSE / BUILDING.
- DESIGNATE MEANS OF EGRESS AND EMERGENCY MEANS OF ESCAPE, LANDINGS OR FINISHED FLOORS AT THE REQUIRED MINIMUM 12 INCHES (305 MM) LOWER THAN THE TOP OF THE THRESHOLD AS PER FBC 2023 R301.3. ALSO THE LANDING OR FLOOR ON THE EXTERIOR SIDE SHALL NOT BE MORE THAN 13/4 INCHES (196 MM) BELOW THE TOP OF THE THRESHOLD.
- BUILDING IS TO BE BUILT ABOVE MINIMUM BASE FLOOR ELEVATION IN ACCORDANCE WITH SECTION R322 FBC 2023. PLEASE SEE PLOT PLAN FOR BASE FLOOR HEIGHT AND FINISH FLOOR ELEVATION.
- IN BUILDINGS WITH STONE APPLICATION, PRE-FABRICATED WOOD BRACKETS, AND/OR PRE-FABRICATED TRIMS & STUCCO SCRATCH COAT SHALL BE PROVIDED ON THE MASONRY BLOCK WITH A WATERPROOFING SEALER (SUPER THOROSEAL OR APPROVED EQUIVALENT) ON TOP OF THE SCRATCH COAT, PRIOR TO THE STONE/PRE-FABRICATED TRIM OR BRACKET INSTALLATION.
- STUCCO APPLIED TO CONCRETE OR MASONRY SHALL COMPLY WITH FLORIDA BUILDING CODE 2023 - BUILDING FIFTH EDITION, SECTION 2510.1 AND SECTION 2512.3, AND SHALL CONSIST OF AT LEAST TWO COATS AND THE TOTAL THICKNESS SHALL NOT BE LESS THAN 1/2".

FLOOR PLAN LEGEND:

- | | |
|---|--|
| REFRIGERATOR / FREEZER SPACE | LAUNDRY SINK W/ UPPER CABINETS |
| DOUBLE SINK WITH DISPOSAL | WASHER AND DRYER SPACE, VENT DRYER TO EXTERIOR |
| DISHWASHER | 8'-0" H PRIVACY WALL |
| GAS COOKTOP WITH HOOD | PANTRY SHELF |
| LINE OF CABINETS ABOVE - BY OTHERS | BATH TUB |
| 36" HGT. COUNTER | REFRIGERATOR SPACE UNDER COUNTER |
| DOUBLE OVEN | ATTIC ACCESS |
| INSTANT GAS WATER HEATER | CAT. II SAFETY GLASS SHOWER ENCLOSURE W/ (2) 2'-0" DOORS |
| AIR HANDLER UNIT | 18" HIGH BENCH |
| A/C CONDENSING UNIT | CUSTOM BUILT-IN CABINERY - BY OTHERS |
| ELECT. PANEL, SURFACE MOUNTED | ICE MAKER UNDER COUNTER |
| ELECTRICAL METER | CONCRETE SLAB, REFER TO STR. DRAWINGS |
| SINGLE SINK ON 36" HGT COUNTER | GAS BBQ |
| DRYWALL FINISHED LINEN CL. W/ SHELVES | OUTDOOR SHOWER |
| SHOWER ENCLOSURE CAT. II SAFETY GLASS W/ (1) 2'-0" DOOR | DRYWALL FINISHED I.T. CL. W/ RACKS |
| CONCRETE SLAB, REFER TO STR. DRAWINGS | CONG. PLANTER, REFER TO STR. DRAWINGS |
| RESERVED | DRYWALL FINISHED PANTRY W/ SHELVES & STORAGE - BY OTHERS |
| CUSTOM CLOSET SHELVING & STORAGE - BY OTHERS | |

DOOR TYPE					GLASS	FRAME	REMARKS
No.	W	H	T	MAT.	TYPE	MAT. DET.	
1	6'-0"	10'-0"	13'-4"	ALU.	FRENCH DOOR	CAT. II SFTY GL. AL.	MTL THRESHOLD, LEATHER STRIP DOOR SCOTTE, RESISTANT, 20 MIN. FIRE RATED DOOR.
2	2'-0"	6'-0"	13'-8"	MTL	RAISED PANEL BUNG	WD	MTL THRESHOLD, AIR TIGHT AND AUTO CLOSING, 20 MIN. FIRE RATED DOOR.
3	2'-0"	6'-0"	13'-8"	WD	RAISED PANEL BUNG	WD	MARBLE SADDLE AT BATHROOMS ONLY
4	2'-0"	6'-0"	13'-8"	WD	RAISED PANEL BUNG	WD	MARBLE SADDLE AT BATHROOMS ONLY
5	2'-0"	6'-0"	13'-8"	WD	RAISED PANEL POCKET	WD	MARBLE SADDLE AT BATHROOMS ONLY
6	2'-0"	6'-0"	13'-8"	WD	RAISED PANEL BUNG	WD	FULL LOWERED AT A/C CLOSET ONLY
7	12'-0"	4'-0"	13'-4"	GL	RAISED PANEL POCKET		MTL THRESHOLD, AIR TIGHT
8	4'-0"	6'-0"	13'-4"	ALU.	SLIDING GLASS DOOR	CAT. II SFTY GL. AL.	4 DOORS, 2 TRACKS
9	3'-0"	6'-0"	13'-8"	WD	RAISED PANEL POCKET		
10	3'-0"	6'-0"	13'-4"	ALU.	FRENCH DOOR	CAT. II SFTY GL. AL.	MTL THRESHOLD, LEATHER STRIP
11	3'-0"	6'-0"	13'-4"	ALU.	FRENCH DOOR	CAT. II SFTY GL. AL.	MTL THRESHOLD, LEATHER STRIP
12	12'-0"	4'-0"	13'-8"	WD	RAISED PANEL BUNG		MARBLE SADDLE AT BATHROOMS ONLY
13	5'-0"	9'-0"		MTL	OH GARAGE DOOR	WD	W/VENTS AT BOTTOM 6/8 SQ. IN. PER GAR. WITHIN 2' AFF.
14	8'-0"	9'-0"		MTL	OH GARAGE DOOR	WD	W/VENTS AT BOTTOM 6/8 SQ. IN. PER GAR. WITHIN 2' AFF.
15	19'-4"	6'-0"	13'-4"	ALU.	SLIDING GLASS DOOR	CAT. II SFTY GL. AL.	5 DOORS, 3 TRACKS
16	12'-0"	4'-0"	13'-4"	ALU.	SLIDING GLASS DOOR	CAT. II SFTY GL. AL.	2 DOORS, 2 TRACKS
17	14'-0"	9'-0"	13'-4"	ALU.	SLIDING GLASS DOOR	CAT. II SFTY GL. AL.	4 DOORS, 2 TRACKS

* SELF CLOSER AT DOORS BETWEEN GARAGE AND RESIDENTIAL.

** OPENINGS BETWEEN GARAGE AND RESIDENCE SHALL BE EQUIPPED WITH SOLID WOOD DOORS NOT LESS THAN 1 3/8" THICK, SOLID OR HONEYCOMB CORE STEEL DOORS NOT LESS THAN 1 3/8" THICK, OR 10 MIN. FIRE RATED DOORS, REFER TO R309.1 FBC.

*** EGRESS DOOR SHALL COMPLY WITH 37 MIN. CLEAR AS PER R302.2 FBC 2023.

**** DOOR FRAMES SHALL BE SOLID 2" X 4" KILN DRIED WOOD FRAME AS PER 9FBC 2023.

ELEVATION NOTES

- THIS STRUCTURE SHALL HAVE ALL EXTERIOR GLAZED OPENINGS INCLUDING GLASS BLOCK, SLIDING GLASS DOORS, AND FRENCH DOORS IMPACT GLASS RESISTANT. SEE ATTACHED MFR. AS PART OF THIS SET.
- ALL WINDOWS GLASS SHALL BE SHGC = 0.31 & U-FACTOR 1.05
- FRONT DOOR, GARAGE DOOR AND ANY SIDE SERVICE EXTERIOR DOOR SHALL BE IMPACT RESISTANT.
- IN BUILDINGS WITH STONE APPLICATION, PRE-FABRICATED WOOD BRACKETS, AND/OR PRE-FABRICATED TRIMS, A STUCCO SCRATCH COAT SHALL BE PROVIDED ON THE MASONRY BLOCK WITH A WATERPROOFING SEALER (SUPER THOROSEAL OR APPROVED EQUIVALENT) ON TOP OF THE SCRATCH COAT, PRIOR TO THE STONE/PRE-FABRICATED TRIM OR BRACKET INSTALLATION.
- STUCCO APPLIED TO CONCRETE OR MASONRY SHALL COMPLY WITH FLORIDA BUILDING CODE 2011 - BUILDING FIFTH EDITION, SECTION 2510.1 AND SECTION 2512.3, AND SHALL CONSIST OF AT LEAST TWO COATS AND THE TOTAL THICKNESS SHALL NOT BE LESS THAN 1/2".

- THIS STRUCTURE SHALL HAVE ALL EXTERIOR GLAZED OPENINGS INCLUDING GLASS BLOCK, SLIDING GLASS DOORS, AND FRENCH DOORS IMPACT GLASS RESISTANT. SEE ATTACHED MFR. AS PART OF THIS SET.
- ALL WINDOWS GLASS SHALL BE SHGC = 0.31 & U-FACTOR 1.05
- FRONT DOOR, GARAGE DOOR AND ANY SIDE SERVICE EXTERIOR DOOR SHALL BE IMPACT RESISTANT.
- IN BUILDINGS WITH STONE APPLICATION, PRE-FABRICATED WOOD BRACKETS, AND/OR PRE-FABRICATED TRIMS, A STUCCO SCRATCH COAT SHALL BE PROVIDED ON THE MASONRY BLOCK WITH A WATERPROOFING SEALER (SUPER THOROSEAL OR APPROVED EQUIVALENT) ON TOP OF THE SCRATCH COAT, PRIOR TO THE STONE/PRE-FABRICATED TRIM OR BRACKET INSTALLATION.
- STUCCO APPLIED TO CONCRETE OR MASONRY SHALL COMPLY WITH FLORIDA BUILDING CODE 2011 - BUILDING FIFTH EDITION, SECTION 2510.1 AND SECTION 2512.3, AND SHALL CONSIST OF AT LEAST TWO COATS AND THE TOTAL THICKNESS SHALL NOT BE LESS THAN 1/2".

ADDITIONAL NOTE:

* PROVIDE CAT. II LAMINATED GLASS WHERE THERE IS A DROP OF 4' OR MORE WITH A WINDOW SILL LESS THAN 36" AFF.

* AS PER VILLAGE OF PINECREST ZONING DEPARTMENT, THE MINIMUM FFE OF RESIDENCE MUST BE 1033' NGVD. (HIGHEST CROWN OF ROAD + 0.61') WITH ALL BUILDING HEIGHTS BEING MEASURED FROM HIGHEST CROWN OF ROAD, 1134' NGVD, AS PER SURVEY.

GARAGE (LOWEST HABITABLE FLOOR) FFE IS 1033' NGVD. PLEASE SEE ELEVATIONS ON THIS SHEET FOR BUILDING HEIGHTS AS PER VILLAGE OF ZONING CRITERIA.

ROOF NOTES

- TRUSS MANUFACTURER SHALL SUBMIT SHOP DWGS FOR ARCHITECT REVIEW PRIOR TO FABRICATION.
- TRUSS MANUFACTURER SHALL VERIFY ALL KNEE HEIGHTS.
- REFER TO TRUSS MANUFACTURER ENG. DRAWINGS FOR ALL ROOF TRUSSES REQUIRED TEMPORARY AND PERMANENT BRACING, GABLE END BRACING, DETAILS & REQUIRED GRAVITY BRACING.
- CONC. BEAM DEPTH OVER DOOR/WINDOW OPENINGS MAY VARY AS PER MFR. DOORS/ WINDOW HGT. (FRENCH OR SLIDING DOORS AND WINDOWS UP TO 3' DEEPER).
- PROVIDE 1/2" CDX PLYWOOD, FELT, MTL. LATH AND STUCCO FINISH AT ALL COVERED TERRACE AND ENTRY CEILING / SOFFITS (TYP).
- ROOF VENTS TO ATTIC SPACE MUST BE COVERED WITH CORROSION RESISTANT SCREENING. SCREEN OPENINGS TO BE BETWEEN A MIN. OF 1/8" & MAX. OF 1/4" (TYP.) AS PER F.B.C. 2023 SECTION R806.1.
- RAINWATER DOWNSPOUTS SHALL DISCHARGE A MINIMUM OF 12" AWAY FROM THE WALL AS PER F.B.C. 2023 SECTION R318.5.

ROOF COVERING SPECIFICATION

- CEMENT FLAT TILE ROOF ON PEEL AND STICK APPLICATION TO 1-30° FELT TIN-TAGGED TO 19/32" PLYWOOD SHEATHING. SPACING OF TIN-TAG FASTENERS ALONG THE LAP OF SHEETS, AND BOTH WAYS IN THE FIELD BETWEEN LAPS, SHALL BE 6" O.C. IN DIRECTION OF ROLL, 12" O.C. AT CORNERS, EDGES AND INTERMEDIATE SUPPORTS. THE 1-30° FELT IS ANCHORED TO THE PLYWOOD SHEATHING WITH 5/16" GALVANIZED DIAMOND POINTS, 1-1/4" X 1/2" DIAMETER. INSTALLATION SHALL BE PER PRODUCT CONTROL APPROVAL AND MANUFACTURER'S SPEC. WOOD SHEATHING ANCHORAGE SHALL BE NAILED IN ACCORDANCE WITH F.B.C. 2023 2322.2.4 THROUGH 2322.2.5.2.

LEGEND:

- CEMENT FLAT TILE ROOF - SEE ROOF COVERING NOTE ON THIS SHEET
- 2" X 8" SMOOTH FINISH WOOD FASCIA
- DECORATIVE STONE VENEER
- SMOOTH STUCCO FINISH
- CONCRETE PLANTER, REFER TO STRUCTURAL DRAWINGS
- COACH LIGHT
- REINFORCED CONCRETE BEAM, REFER TO STRUCTURAL DRAWINGS FOR DETAILS.
- REINFORCED CONCRETE SLAB AND FOUNDATION, REFER TO STRUCTURAL DRAWINGS FOR DETAILS.
- PRE-FABRICATED ALUMINUM LOUVER - BY OTHERS
- REINFORCED CANTILEVERED CONCRETE SLAB, REFER TO STRUCTURAL DRAWINGS FOR DETAILS.
- CONCRETE PRIVACY WALL, REFER TO STRUCTURAL DRAWINGS
- 1/2" THICK STUCCO BAND - SEE ELEV. FOR WIDTHS

AREA CALCULATIONS

TOTAL A/C SPACE 548.61 SQUARE FEET
OF ACCESSORY STRUCTURE

WALL LEGEND:

INDICATES 8"x8"x16" MASONRY UNITS

INDICATES 3-5/8" METAL STUDS PARTITION 24" O.C. WITH 1/2" DRYWALL FINISH EACH SIDE

No. 25 GAUGE CHANNEL-SHAPED STUDS 16" O.C. WITH 1 FULL-LENGTH LAYERS OF 1/2" DRYWALL EACH SIDE AND R-19 INSULATION BETWEEN STUDS.

NOTE:

INTERIOR FINISHES SHALL MEET SPECIFIED VOC EMISSIONS LIMITS IN ACCORDANCE WITH GREENGUARD ENVIRONMENTAL INSTITUTE GFGS.001 STANDARD FOR BUILDING MATERIAL AND FINISHES OR GREEN SEAL (R) STANDARD.

ELEVATION NOTES:

- CONDENSING UNIT T.O.S. ELEVATION SHALL BE NOT LESS THAN FFE.
- REFER APPROVED SITE PLAN FOR FINISH FLOOR ELEVATION.
- REFER APPROVED SITE PLAN FOR GARAGE FLOOR ELEVATION.

VENTILATION CALCS. @ ACCESSORY STRUCTURE

VENTILATION:

REQUIRED VENTILATION:
361 S.F. = 6.41 S.F.
150

SOFFIT VENTILATION PROVIDED:


52' X 4' = 173.3 S.F.
144

HEIGHT DIMENSIONS:

RIDGE HEIGHT = +11'-4"
EAVE HEIGHT = +14'-8"
MEAN HEIGHT = +16'-6"


NOTES:

- ELEVATIONS ARE REFERRED TO FINISH FLOOR AS 0'-0"

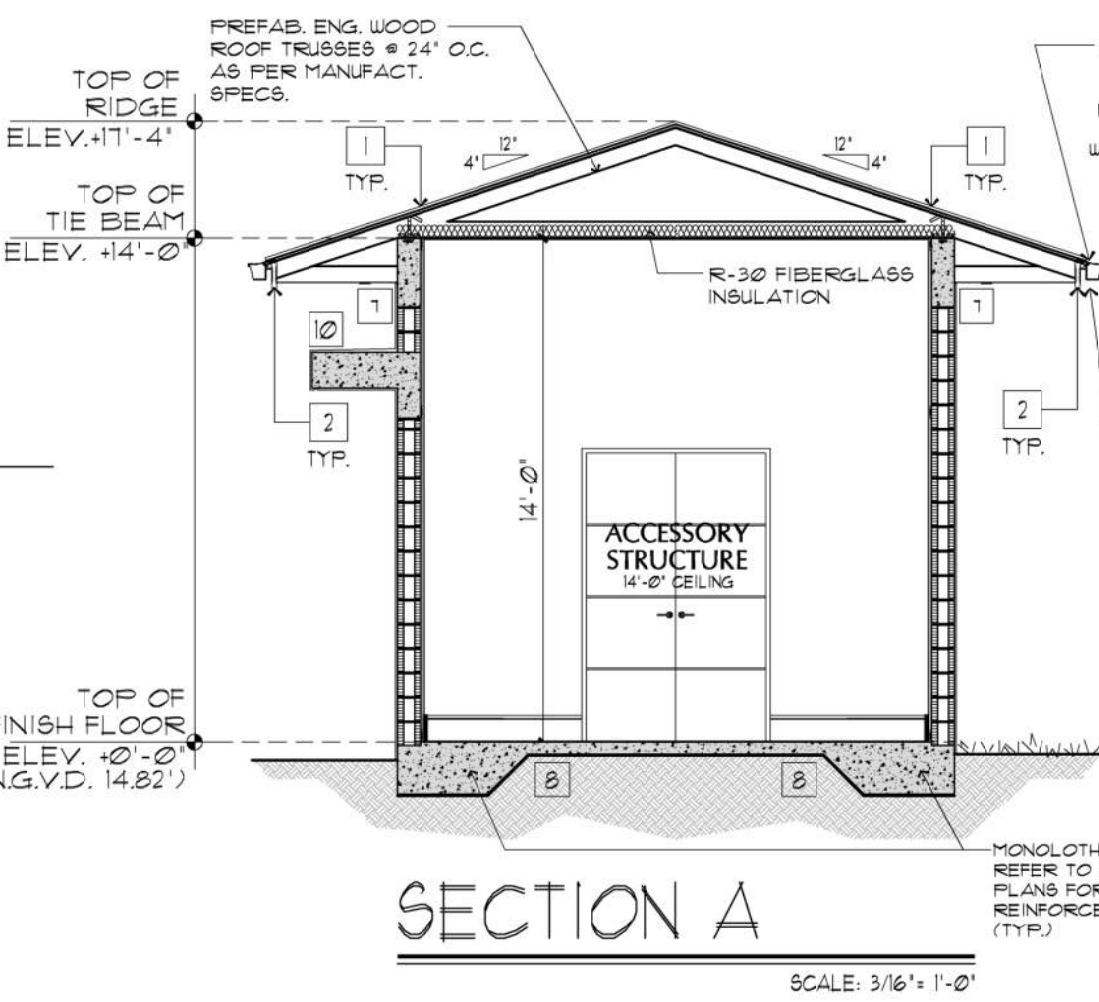


SECTION A

SCALE: 3/16" = 1'-0"

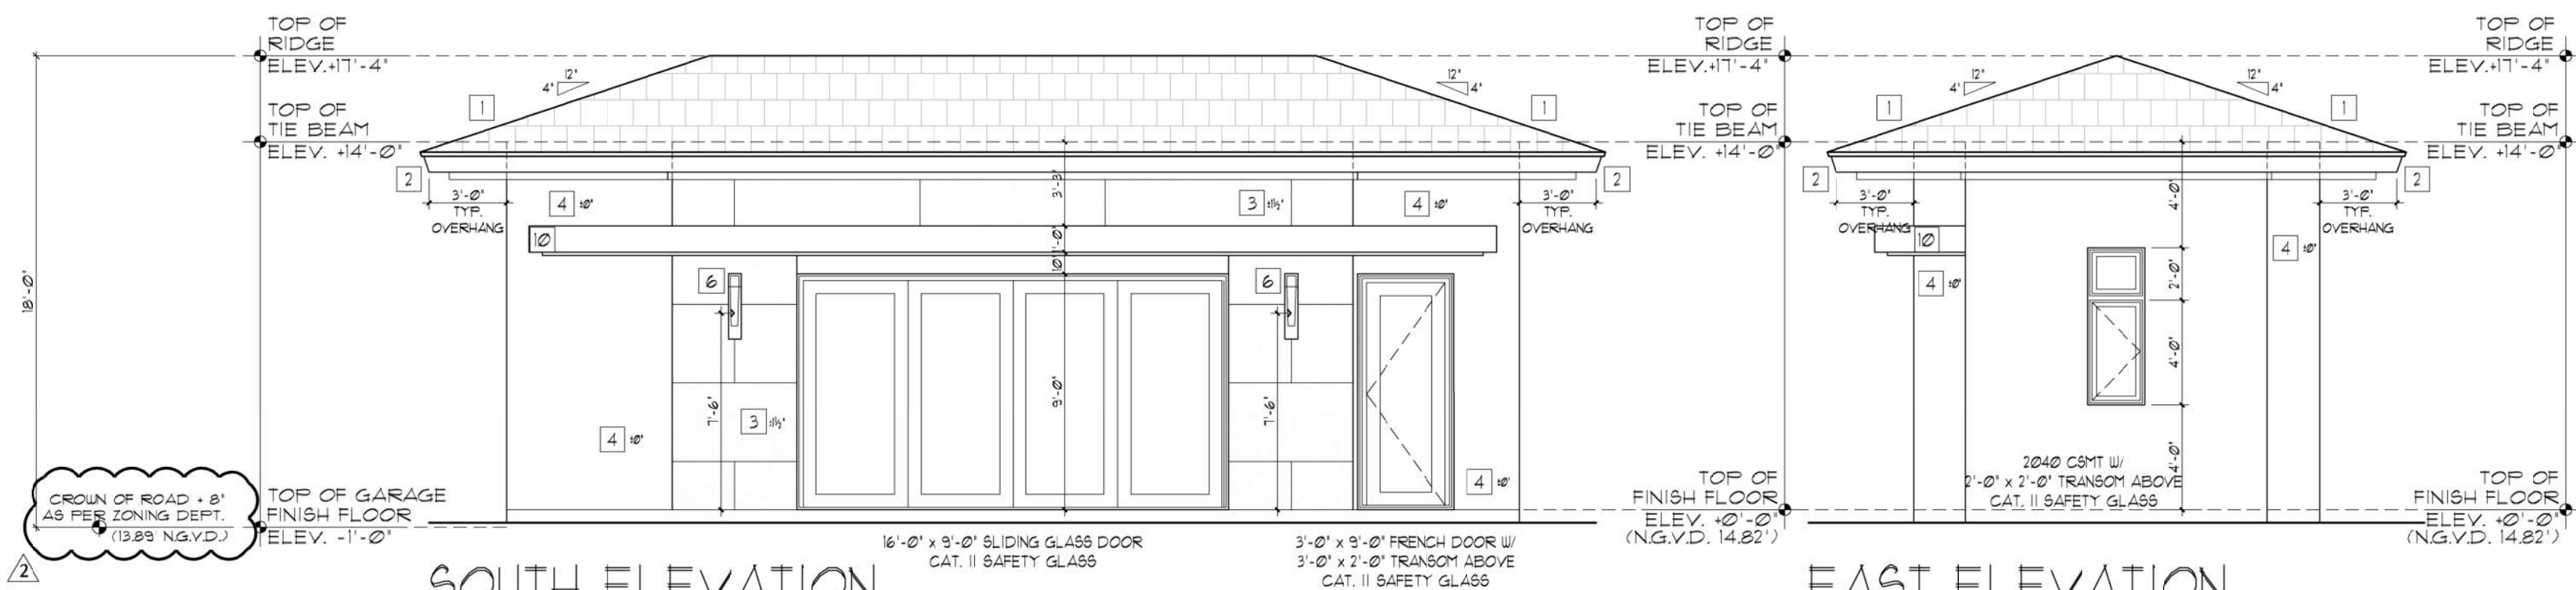


SOUTH ELEVATION

SCALE: 3/16" = 1'-0"

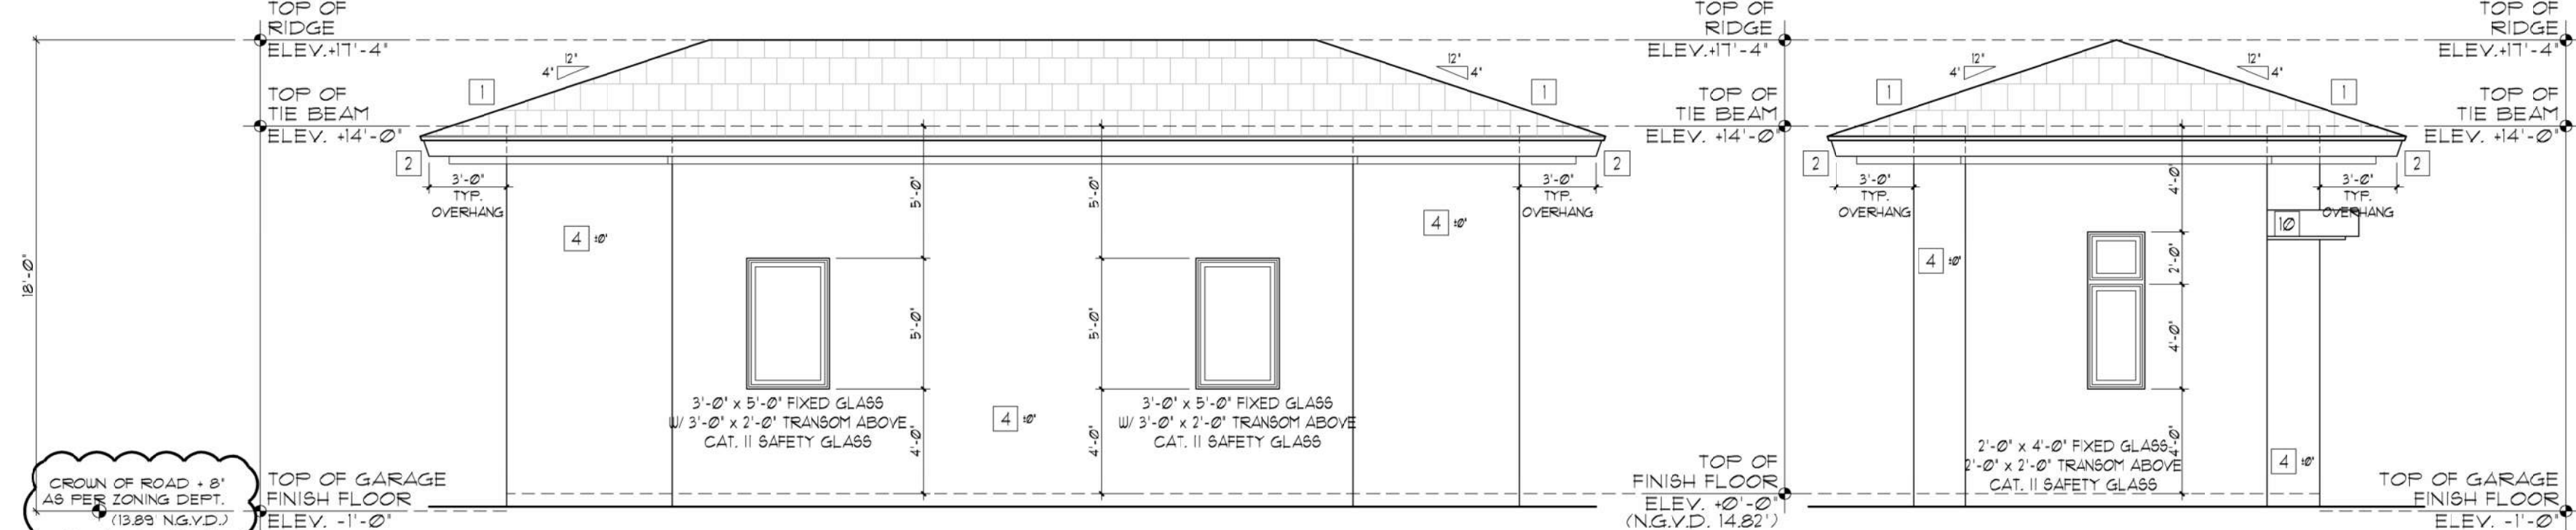


NORTH ELEVATION

SCALE: 3/16" = 1'-0"

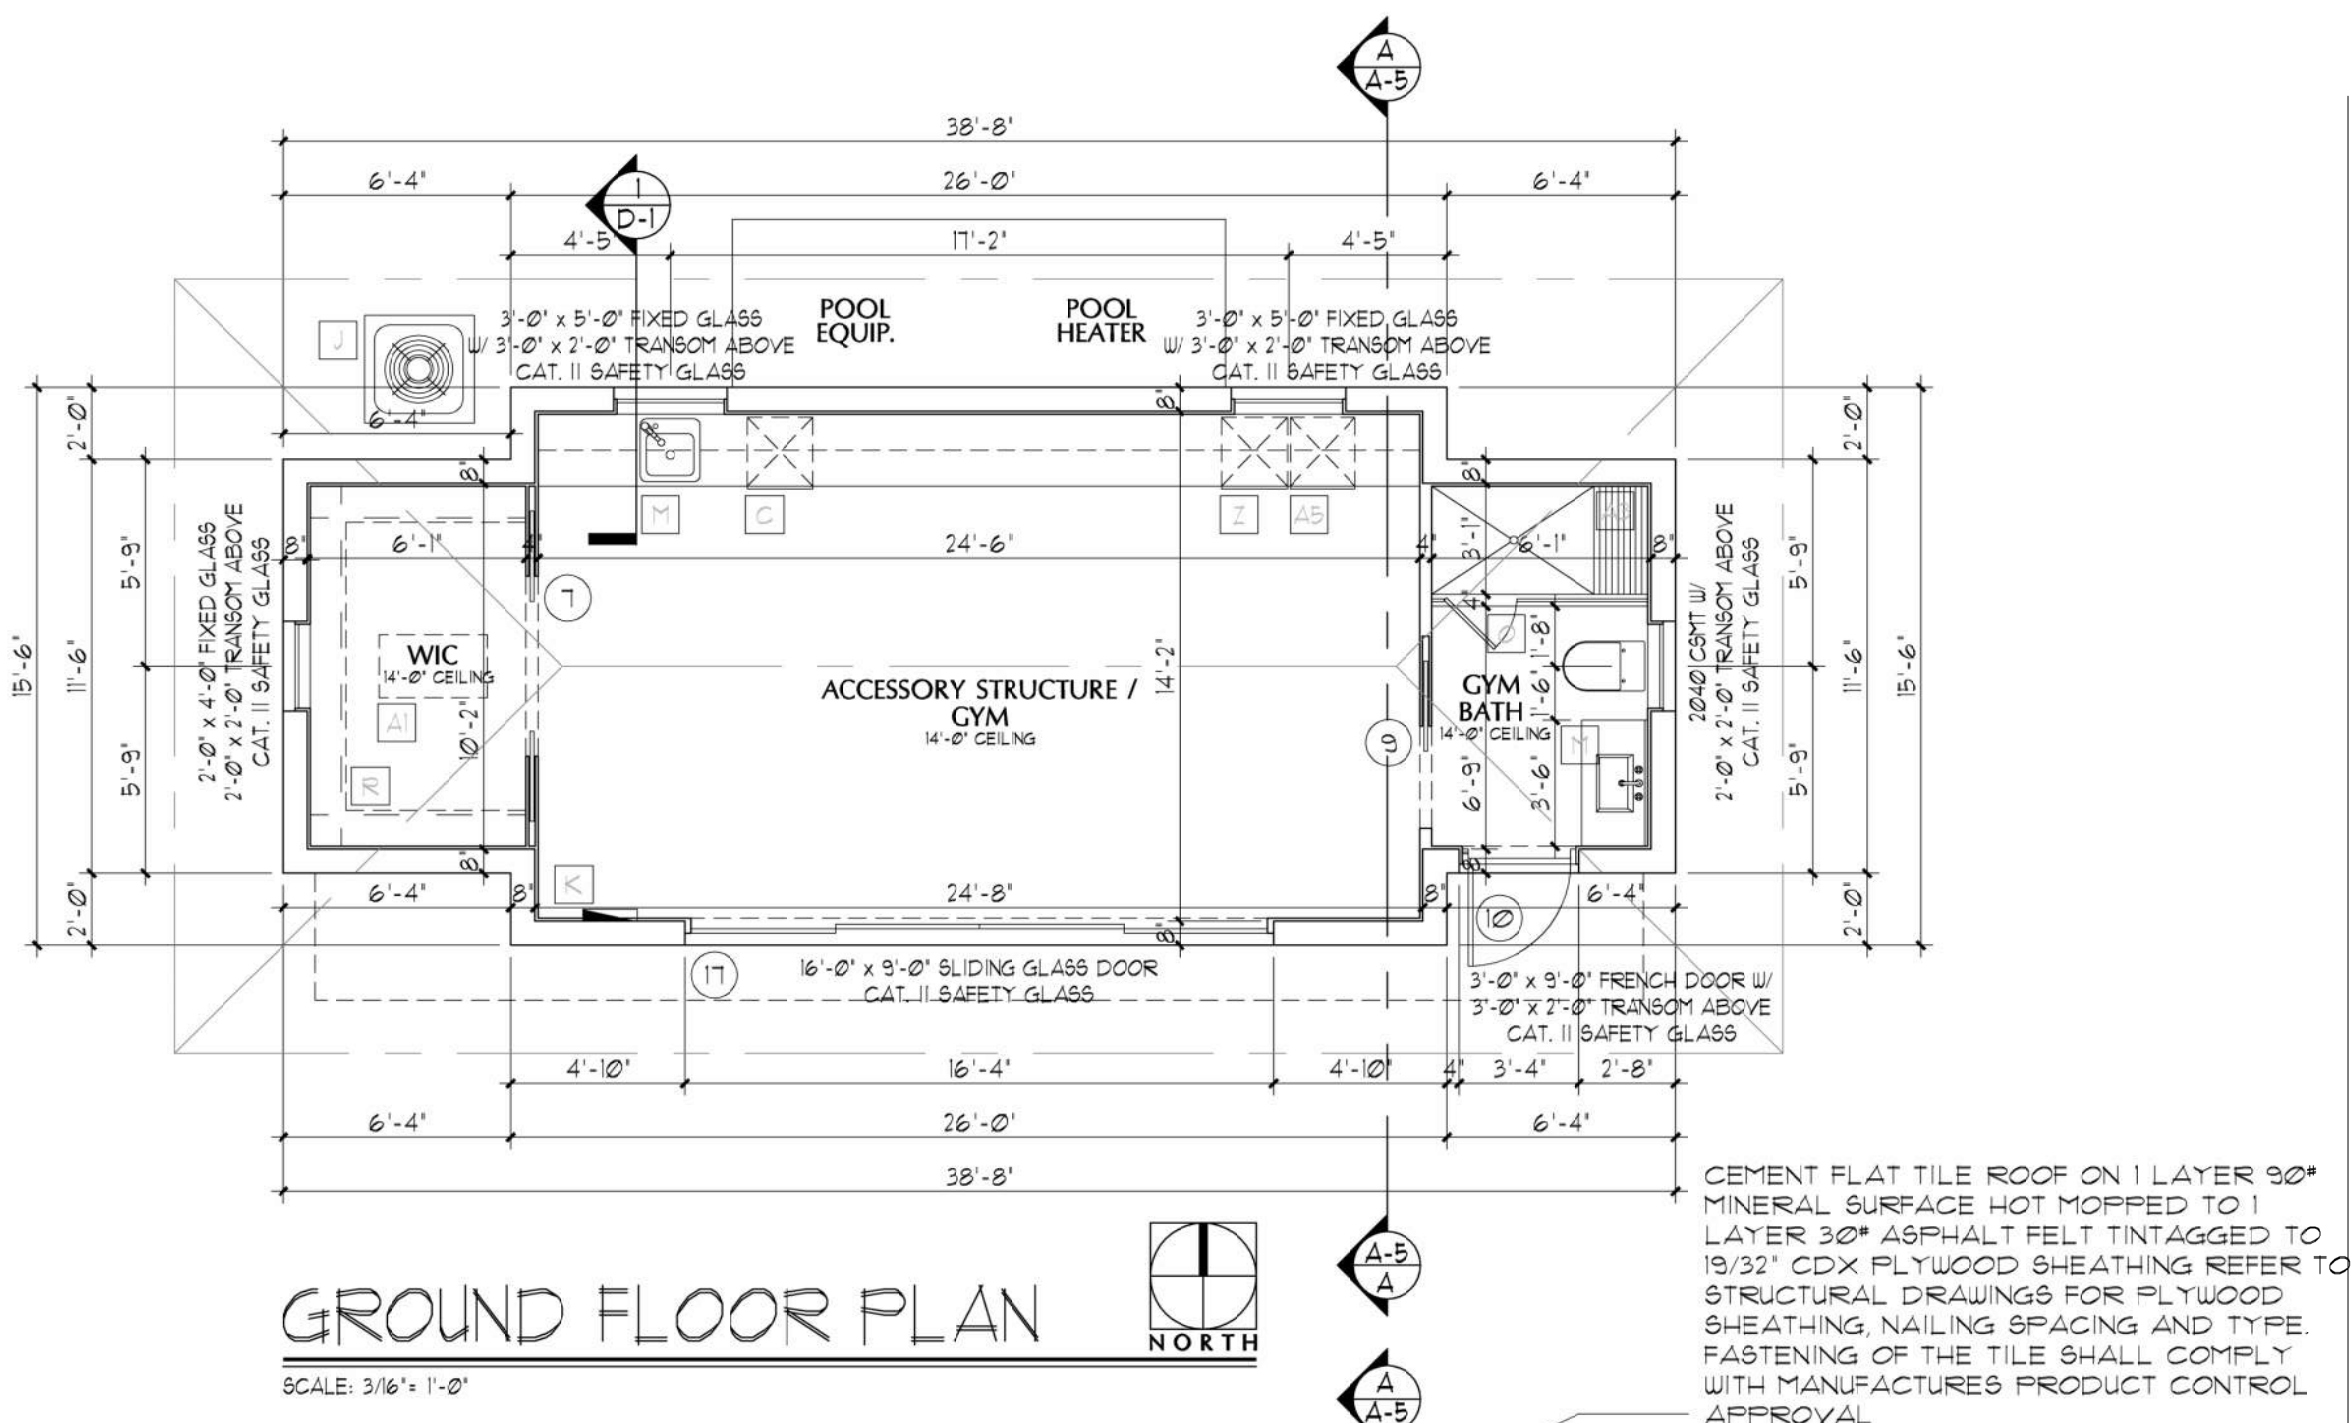

GROUND FLOOR PLAN

SCALE: 3/16" = 1'-0"

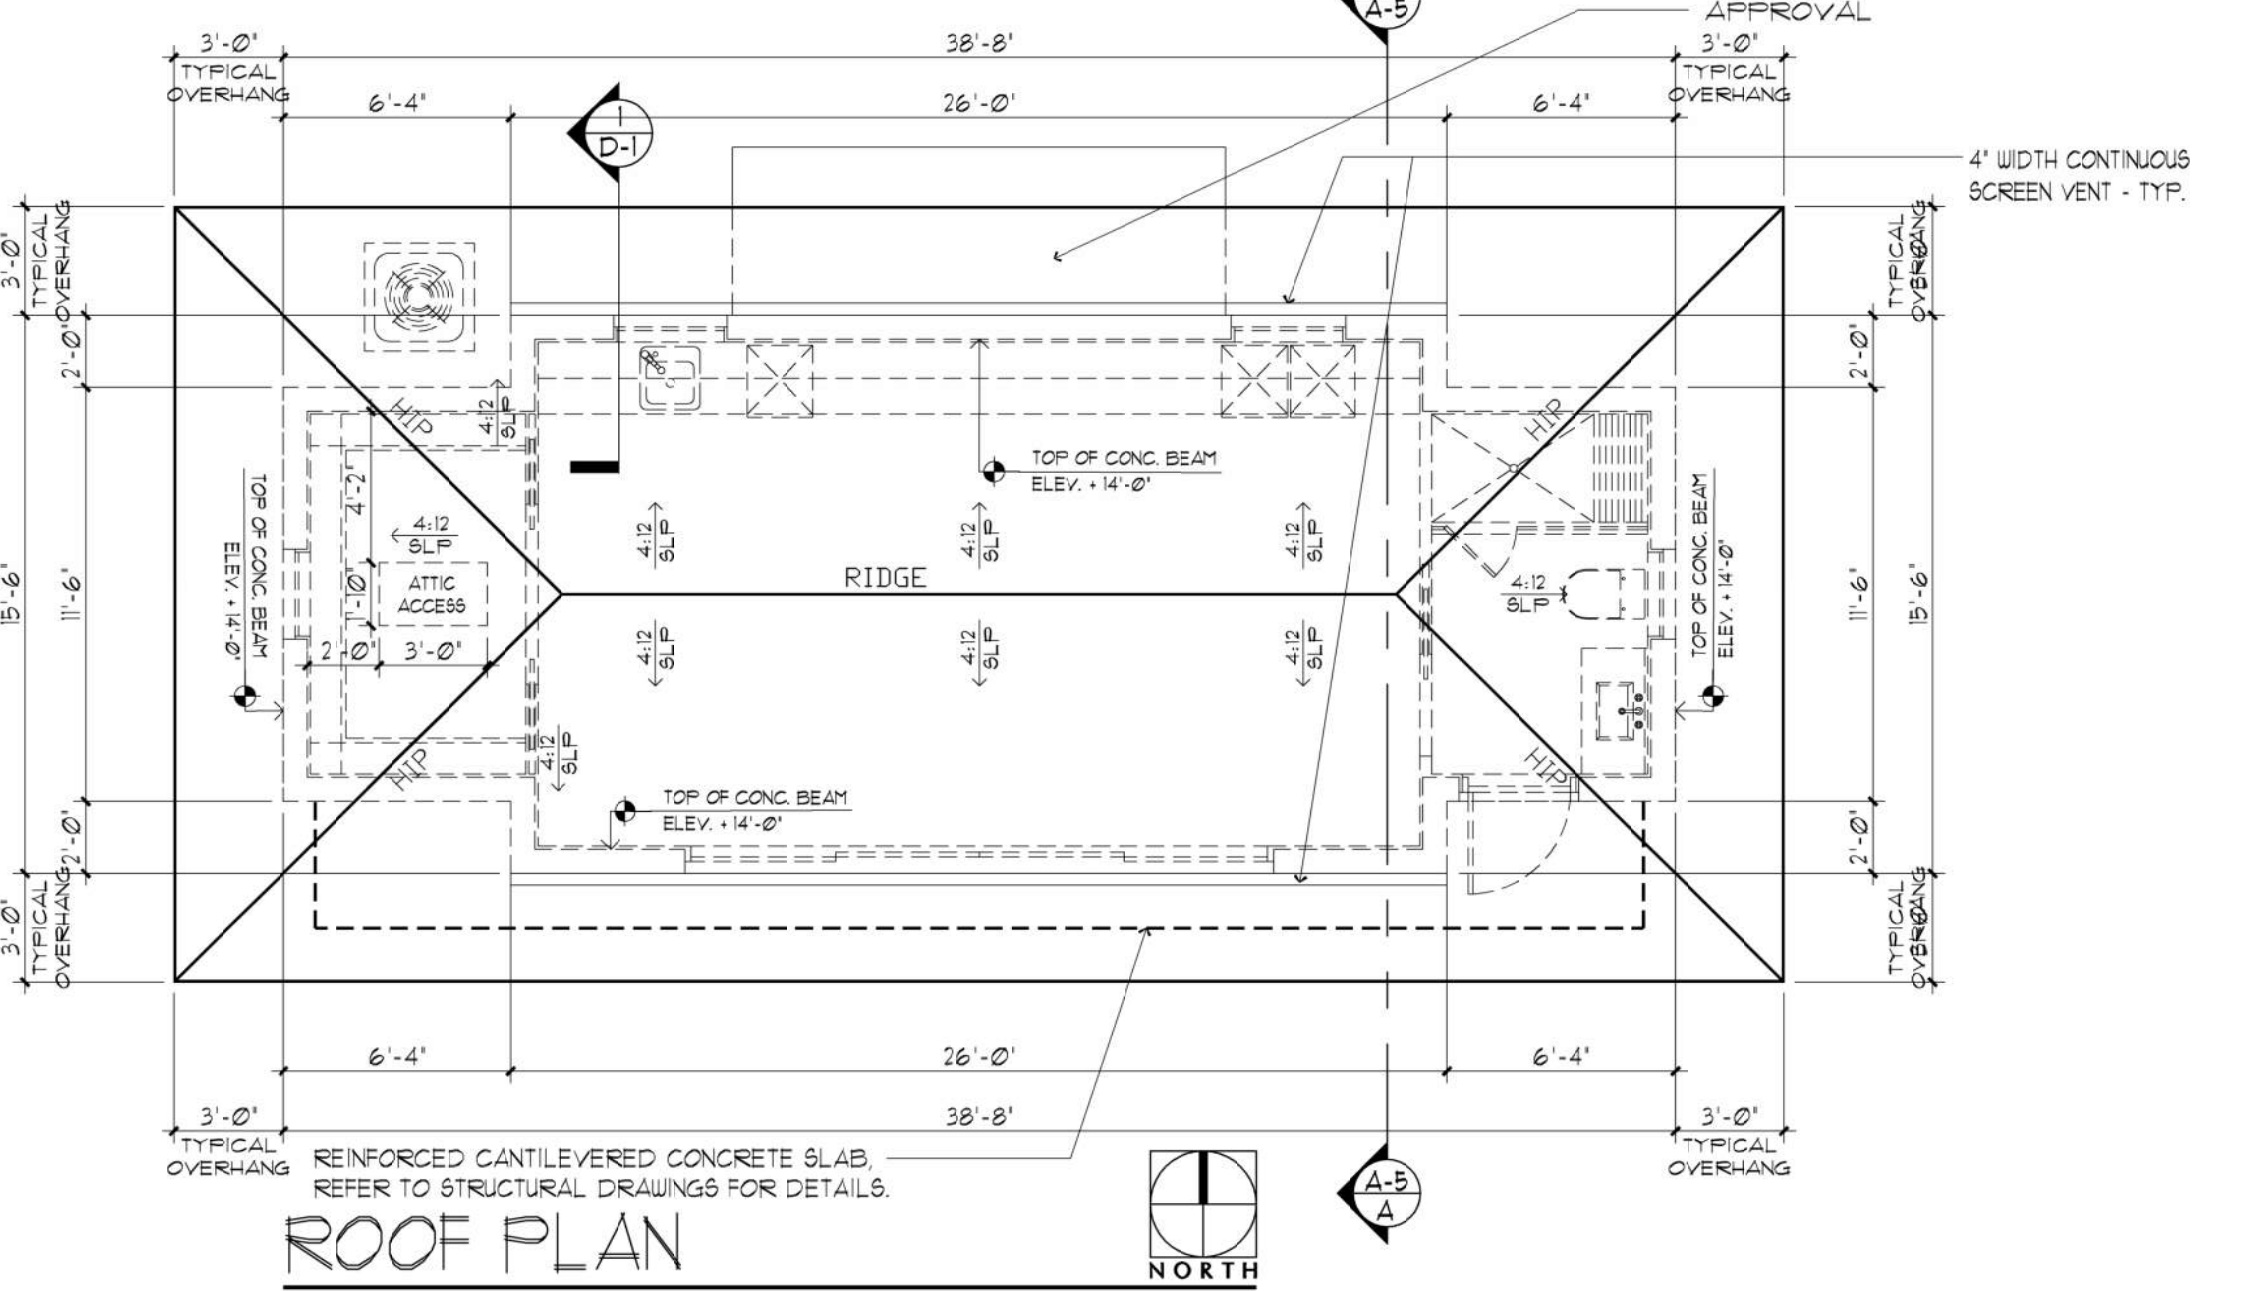

ROOF PLAN

SCALE: 3/16" = 1'-0"

PASCUAL PEREZ KILIDDJIAN STARR
ARCHITECTS + PLANNERS
LICENSE # AA 26001357
EDGARDO PEREZ, AIA
LICENSE NO.: AR 0015394
MARIO P. PASQUAL, AIA
LICENSE NO.: AR 0008254
PETER KILIDDJIAN, RA
LICENSE NO.: AR 0093067
ANDREW STARR, RA
LICENSE NO.: AR 0095130

AT THE BEACON CENTER
1330 NW 84TH AVENUE
DORAL, FLORIDA 33126
TELEPHONE: (305) 592-1363
FACSIMILE: (305) 592-6865
http://www.ppkarch.com


COPYRIGHT © PASQUAL, PEREZ, KILIDDJIAN & ASSOCIATES, ARCHITECTS - PLANNERS
The architectural design and detail drawings of this building and/or overall project are the legal property of and all rights are reserved by the Architect. They are to be reproduced, modified or distributed in any form without the written consent of the Architect.

REVISIONS:

08.10.23 BLDG. DEPT. REV.

OWNER:
HERITAGE HOME BUILDERS, LLC
9350 SOUTH DIXIE HIGHWAY
SUITE 1500
MIAMI, FL 33156
PHONE: 305.665.3077

NEW CONSTRUCTION AT PINECREST RESIDENCE:
BY HERITAGE HOME BUILDERS, LLC.
7725 SOUTHWEST 114 STREET
VILLAGE OF PINECREST, FL 33156

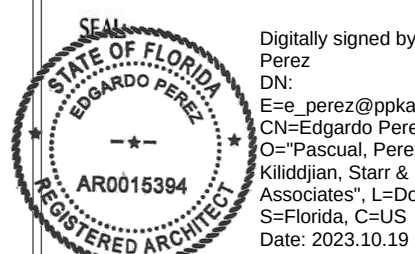

Digitally signed by Edgardo Perez
DN: cn=Edgardo Perez, o=Pascual, Perez, Kiliddjian, Starr & Associates, Ltd., ou=Florida, C=US
Date: 2023.10.19 10:43:58-0400

ACCESSORY STRUCTURE
DATE: 01.16.2023
SCALE: AS SHOWN
DRAWN: SJF
CHECK BY: EP
JOB NO.: 22-22

A-5

SHEET NO.:

GENERAL NOTES

1. THIS STRUCTURE SHALL HAVE ALL EXTERIOR GLAZED OPENINGS INCLUDING GLASS BLOCK, SLIDING GLASS DOORS, AND FRENCH DOORS IMPACT GLASS RESISTANT. SEE ATTACHED MFR. AS PART OF THIS SET.
2. ALL WINDOWS GLASS SHALL BE SHGC = 0.31 & U-FACTOR 1.05
3. FRONT DOOR, GARAGE DOOR AND ANY SIDE SERVICE EXTERIOR DOOR SHALL BE IMPACT RESISTANT.
4. IN BUILDINGS WITH STONE APPLICATION, PRE-FABRICATED/WOOD BRACKETS, AND/OR PRE-FABRICATED TRIMS, A STUCCO SCRATCH COAT SHALL BE PROVIDED ON THE MASONRY BLOCK WITH A WATERPROOFING SEALER (SUPER THOROSEAL OR APPROVED EQUIVALENT) ON TOP OF THE SCRATCH COAT, PRIOR TO THE STONE/PRE-FABRICATED TRIM OR BRACKET INSTALLATION.
5. STUCCO APPLIED TO CONCRETE OR MASONRY SHALL COMPLY WITH FLORIDA BUILDING CODE 2017 - BUILDING, FIFTH EDITION, SECTION 2510.1 AND SECTION 2512.9, AND SHALL CONSIST OF AT LEAST TWO COATS AND THE TOTAL THICKNESS SHALL NOT BE LESS THAN 1/2".

ROOF NOTES

- 1.- TRUSS MANUFACTURER SHALL SUBMIT SHOP DWGS FOR ARCHITECT REVIEW PRIOR TO FABRICATION
- 2.- TRUSS MANUFACTURER SHALL VERIFY ALL KNEE HEIGHTS
- 3.- REFER TO TRUSS MANUFACTURER ENG. DRAWINGS FOR ALL ROOF TRUSSES REQUIRED TEMPORARY AND PERMANENT BRACING, GABLE END BRACING, DETAILS & REQUIRED GRAVITY BRACING.
- 4.- CONC. BEAM DEPTH OVER DOOR/WINDOW OPENINGS MAY VARY AS PER MFR. DOOR/ WINDOW HGT. (FRENCH OR SLIDING DOORS AND WINDOWS UP TO 3" DEEPER)
- 5.- PROVIDE 1/2" CDX PLYWOOD FELT MTL. LATH AND STUCCO FINISH AT ALL COVERED TERRACE AND ENTRY CEILING / SOFFITS (TYP.)
- 6.- ROOF VENTS TO ATTIC SPACE MUST BE COVERED WITH CORROSION RESISTANT SCREENING, SCREEN OPENINGS TO BE BETWEEN A MIN. OF 1/8" & MAX. OF 1/4" (TYP.) AS PER F.B.C. 2023 SECTION R206.1
- 1.- RAINWATER DOWNSPOUTS SHALL DISCHARGE A MINIMUM OF 12" AWAY FROM THE WALL AS PER F.B.C. 2023 SECTION R318.5

ROOF COVERING SPECIFICATION

1. CEMENT FLAT TILE ROOF ON PEEL AND STICK APPLICATION TO 1-3/8" FELT TIN-TAGGED TO 19/32" PLYWOOD SHEATHING. SPACING OF TIN-TAG FASTENERS ALONG THE LAP OF SHEETS, AND BOTH WAYS IN THE FIELD BETWEEN LAPS, SHALL BE 6" O.C. IN DIRECTION OF ROLL, 12" O.C. ACROSS WIDTH OF ROLL, AS PER F.B.C. 2023. THE 1-3/8" FELT IS ANCHORED TO THE PLYWOOD SHEATHING WITH SEMCO GALVANIZED, DIAMOND POINTS, 1-1/4" X 1/20" DIAMETER. INSTALLATION SHALL BE PER PRODUCT CONTROL APPROVAL AND MANUFACTURER'S SPECS. WOOD SHEATHING ANCHORAGE SHALL BE NAILED IN ACCORDANCE WITH F.B.C. 2023.2: 19/32" CDX PLYWOOD SHEATHING EXPOSURE 1 OVER TWO OR MORE SPAN WITH FACE GRAIN PERPENDICULAR TO SUPPORT ANCHORED TO FASCIA W/ 8d RING SHANK NAILS AT 4" O.C. ALL AROUND PERIMETER. 6" O.C. AT PANEL EDGES AND INTERMEDIATE SUPPORTS AND 8d RING SHANK NAIL OR 10d COMMON NAILS THROUGHOUT AND 4" O.C. AT GABLE END TRUSSES AND DIAPHRAGM BOUND, AS PER F.B.C. 2023 SECTION 2322.2.4 THROUGH 2322.2.5.2




LEGEND:

- | | |
|--|--|
| 1 CEMENT FLAT TILE ROOF - SEE ROOF COVERING NOTE ON THIS SHEET | 7 REINFORCED CONCRETE BEAM, REFER TO STRUCTURAL DRAWINGS FOR DETAILS. |
| 2 2' X 8' SMOOTH FINISH WOOD FASCIA | 8 REINFORCED CONCRETE SLAB AND FOUNDATION, REFER TO STRUCTURAL DRAWINGS FOR DETAILS. |
| 3 DECORATIVE STONE VENEER | 9 PRE-FABRICATED ALUMINUM LOUVER - BY OTHERS |
| 4 SMOOTH STUCCO FINISH | 10 REINFORCED CANTILEVERED CONCRETE SLAB, REFER TO STRUCTURAL DRAWINGS FOR DETAILS. |
| 5 CONCRETE PLANTER, REFER TO STRUCTURAL DRAWINGS | 11 CONCRETE PRIVACY WALL, REFER TO STRUCTURAL DRAWINGS |
| 6 COACH LIGHT | 12 1/2" THICK STUCCO BAND - SEE ELEV. FOR WIDTHS |

ADDITIONAL NOTE:

- * PROVIDE CAT. II LAMINATED GLASS WHERE THERE IS A DROP OF 4' OR MORE WITH A WINDOW SILL LESS THAN 36" AFF.
- * AS PER VILLAGE OF PINECREST ZONING DEPARTMENT, THE MINIMUM F.F.E. OF RESIDENCE MUST BE 1033' NGVD. (HIGHEST CROWN OF ROAD + 0.61') WITH ALL BUILDING HEIGHTS BEING MEASURED FROM HIGHEST CROWN OF ROAD, 1134' NGVD, AS PER SURVEY.

GARAGE (LOWEST HABITABLE FLOOR) F.F.E. IS 1033' NGVD. PLEASE SEE ELEVATIONS ON THIS SHEET FOR BUILDING HEIGHTS AS PER VILLAGE OF ZONING CRITERIA.

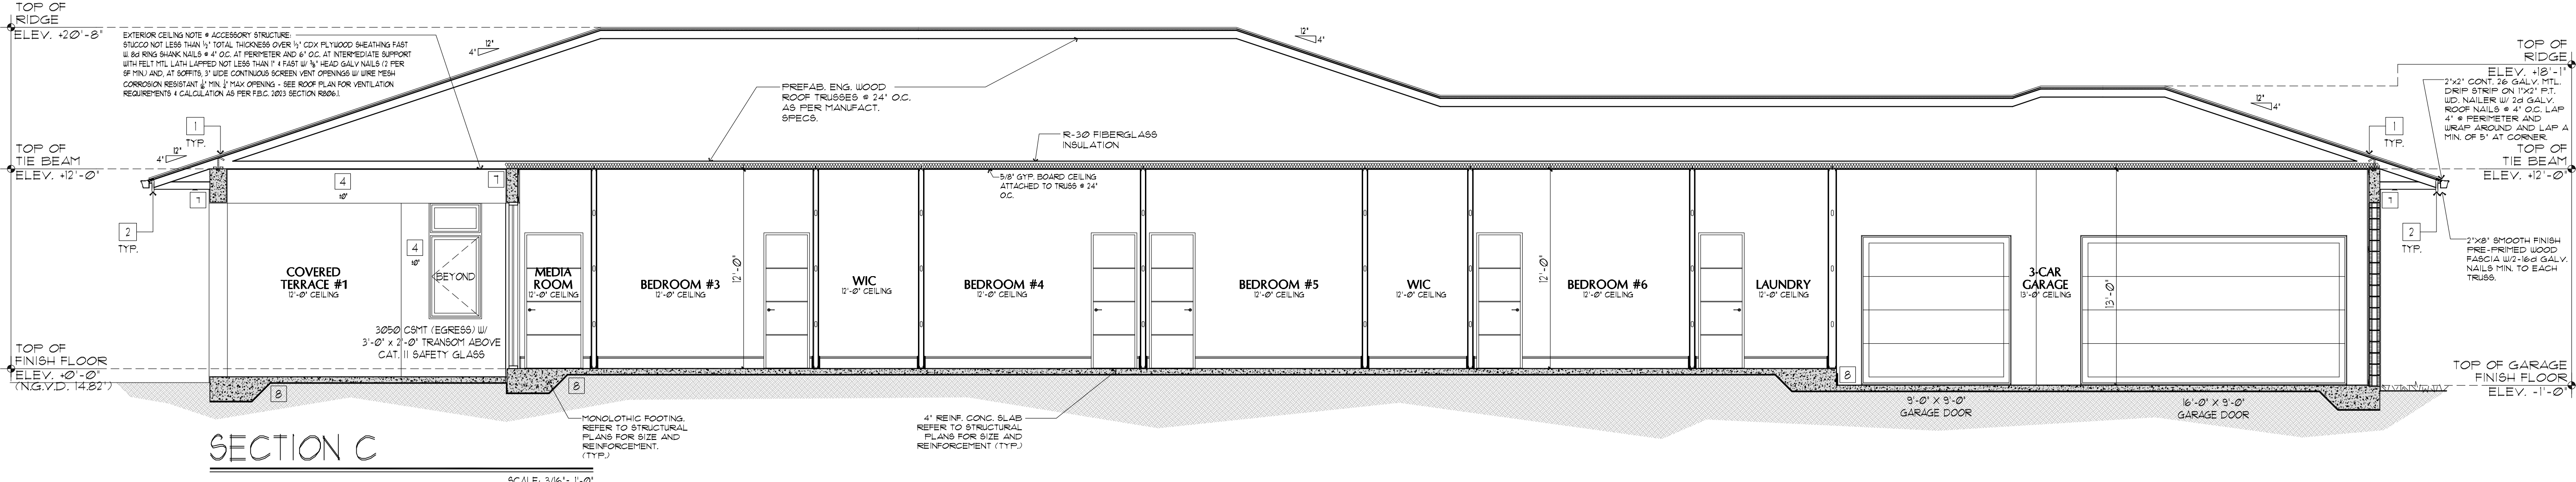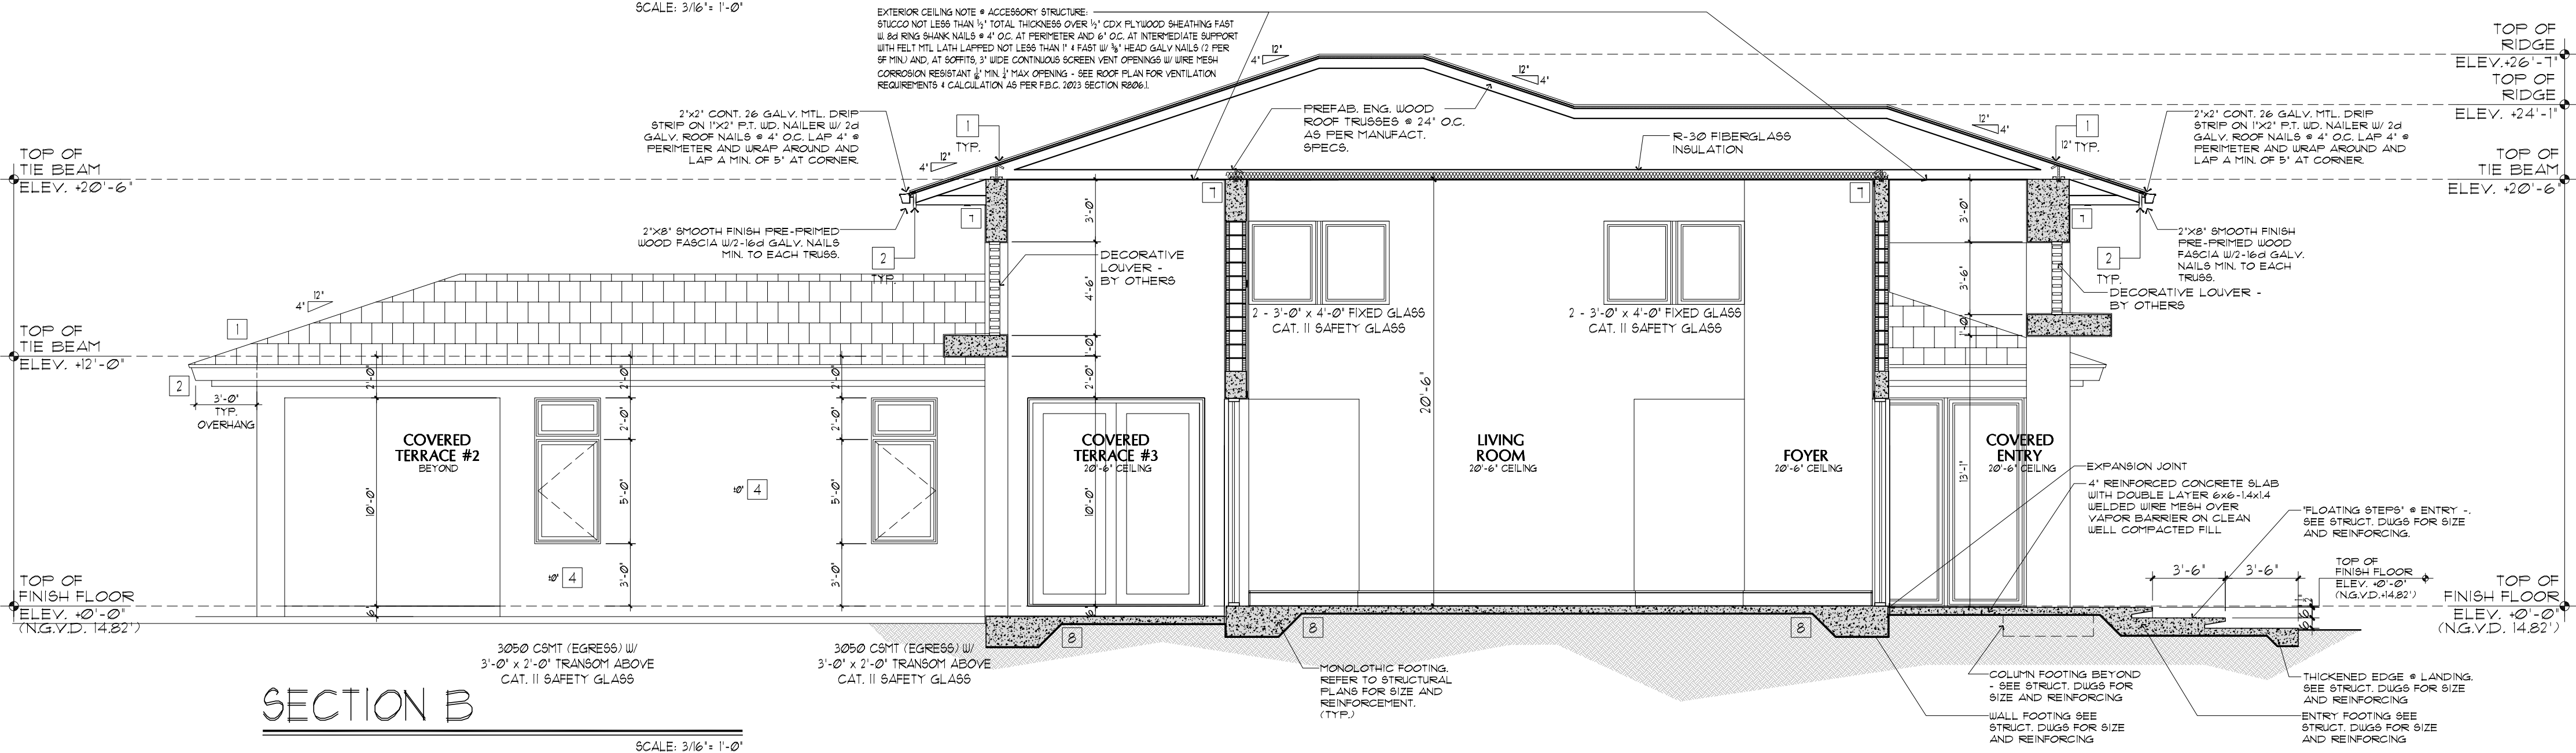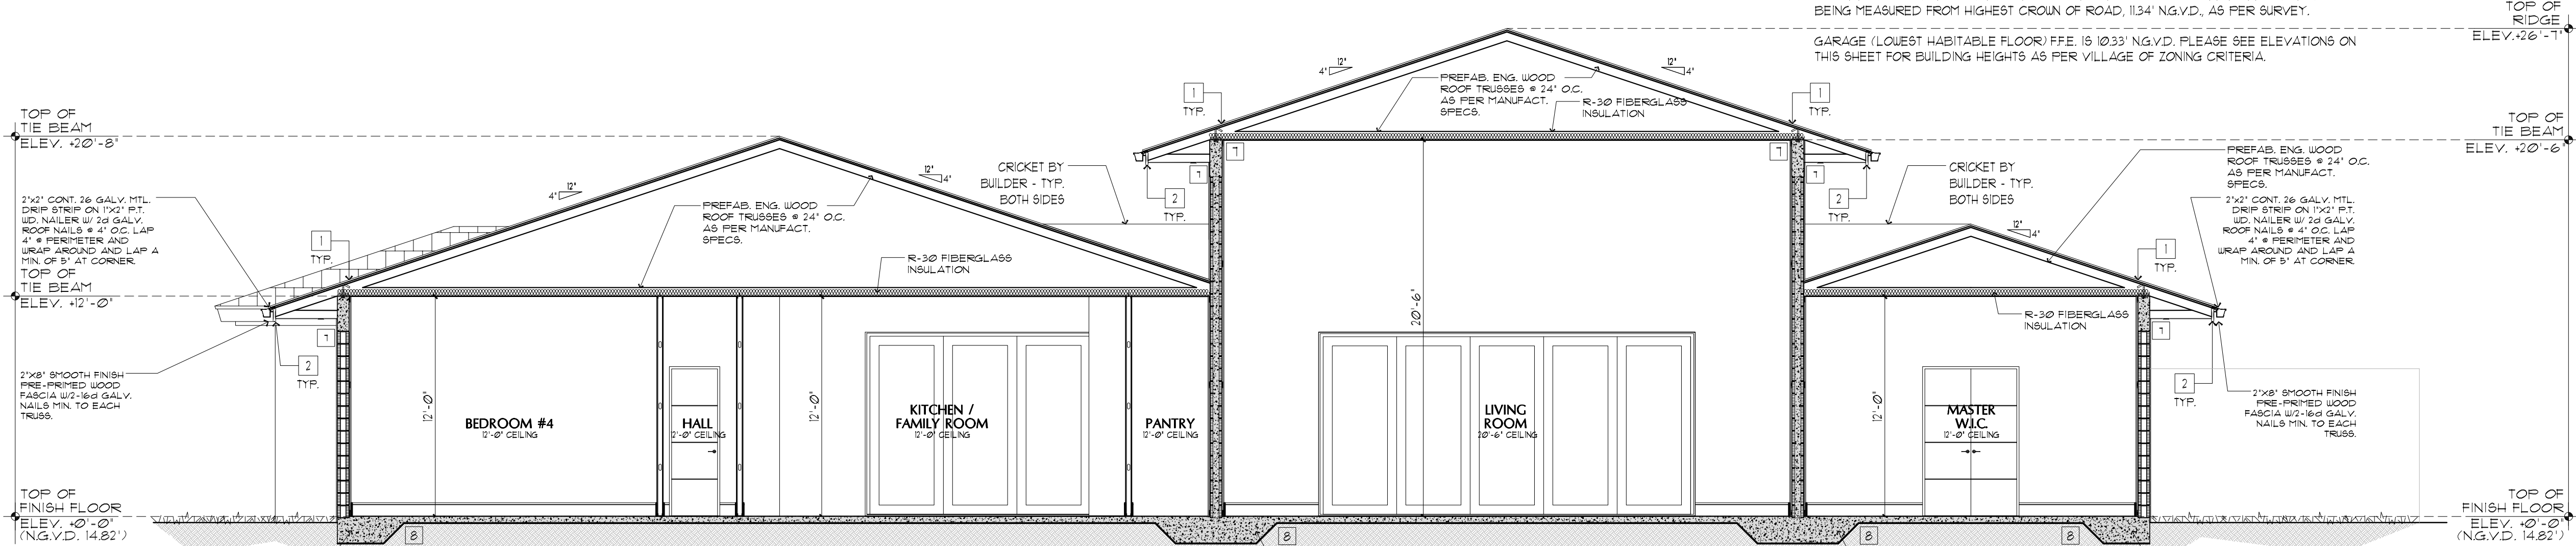

REVISIONS: