

2' - 0"

1' - 4"

16" x 16" x 8" CONC. CAP
W/ #5 EACH WAY

3/4" SMOOTH STUCCO
FINISH

16" x 16" CMU BLOCK
PILASTER W/ #5 VERT.
IN CONC. FILLED CELLS
W/ #3 TIES @ EVERY OTHER
COURSE

4' x 4' x 12" CONCRETE FTG.
W/ #5 @ 12" T & B EA. WAY

SELF LATCHING DEVICE

2"x2" ALUM. TOP RAIL

2"x2" ALUM. POST @ 4'-0" O.C. MAX.

2"x1" ALUM. BOTT. RAIL

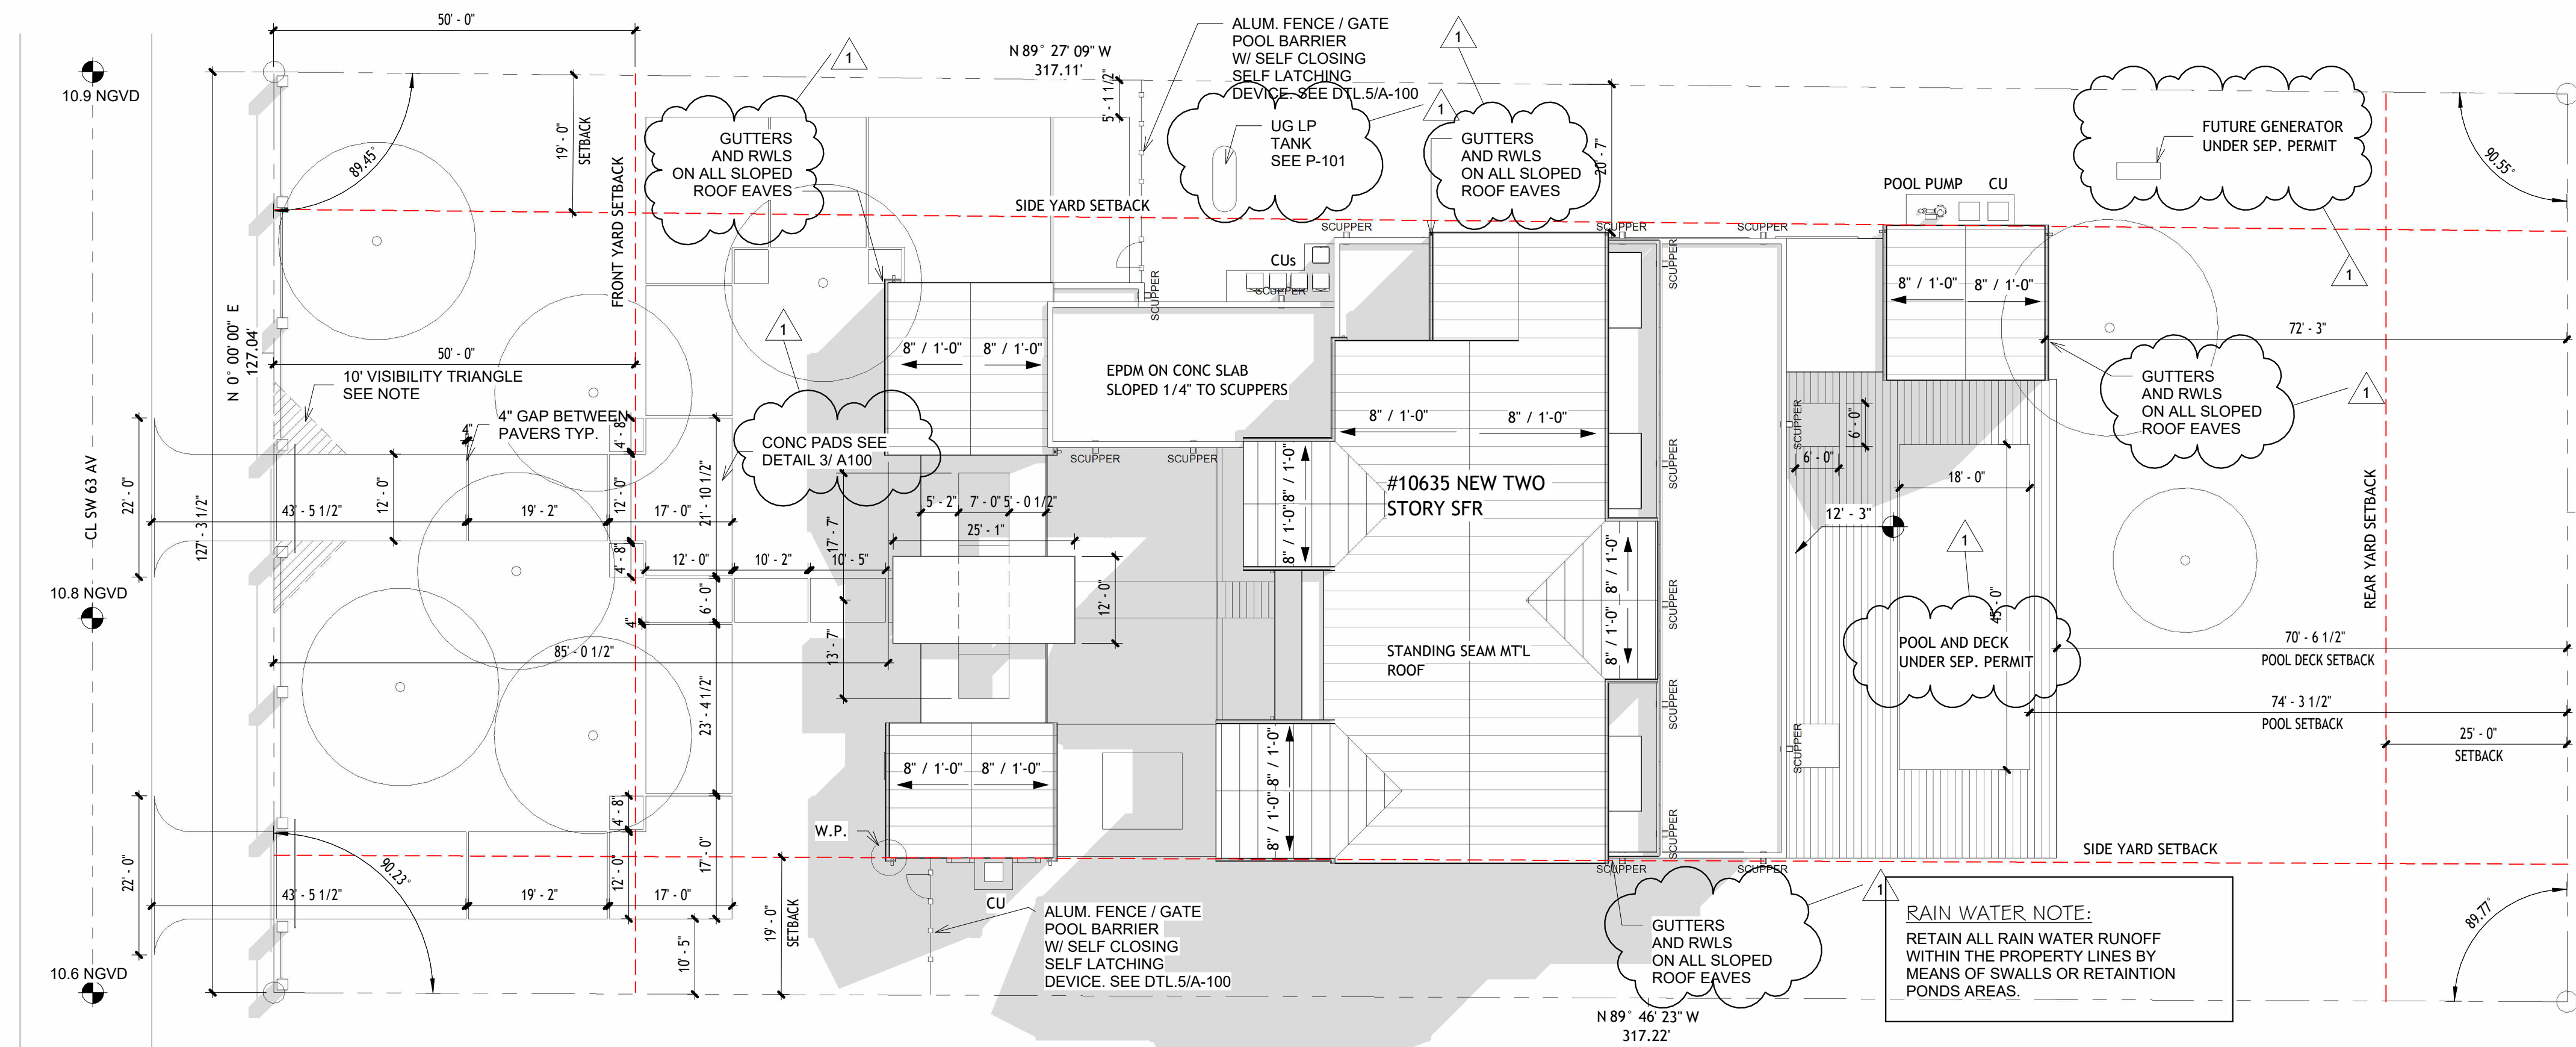
ALUM. PICKET FENCE / GATE CONTRACTOR TO SUBMIT SHOP DWGS. FOR ARCHITECT REVIEW / APPROVAL

3/4"x3/4" ALUM. PICKETS @ 4" O.C. MAX. TO REJECT A 4" DIA. OBJECT.

FINISH GRADE

6'-0"

COR
 -1' - 6"
 TOF
 -2' - 0"

[illegible]

TOP SOIL

1'-0"

CONCRETE THICKENED
EDGE SEE STRUCT.
PLANS FOR DETAILS

DRIVEWAY DETAIL
1'-0"

8"

4" CONCRETE SLAB ON GRADE
SEE STRUCTURAL PLANS FOR
REINFORCEMENT

4" WELL COMPACTED FILL

VAPOR BARRIER

UNDISTURBED SOIL

1

2

Figure 10.10 shows the section and plan views of a parapet wall. The section view on the left indicates a wall height of 10" and a base width of 1'-0". The plan view on the right shows a wall width of 8" and a height of 4". Labels indicate the top of the parapet, the top of the roofing at the parapet, and the top of the slab.

Diagram illustrating a roof edge detail. The roof is sloped to the scupper. The scupper is 10 inches high. The parapet wall is 10 inches thick. The roof is 10 inches wide at the scupper. The roof is sloped to the scupper. The scupper is 10 inches high. The parapet wall is 10 inches thick. The roof is 10 inches wide at the scupper.

CONTRACTOR TO PROVIDE SEPARATE PERMITS AND SHOP DRAWINGS FOR THE FOLLOWING ITEMS:

- GENERATOR AND GAS TANK
- PRE-FAB CHIMNEY
- EXTERIOR DOORS AND WINDOWS
- RAILINGS AND FENCES
- POOL AND POOL DECK
- ALUM. TRELLIS
- DRIVEWAYS
- ROOF WATERPROOFING
- GLASS RAILINGS
- METAL STAIRS
- EXTERIOR LOUVERS
- SEPTIC TANK
- FOUNTAIN

THESE PLANS COMPLY TO THE
BEST OF MY KNOWLEDGE WITH
ALL APPLICABLE BUILDING AND
ZONING CODES.

FENCE / GATE NOTE:
VERTICAL BARS ALONG PROPERTY LINES
SHALL HAVE A CLEAR SPACING OF MINIMUM 3.5"
WITH A TRANSPARENCY REQUIREMENT OF 50%