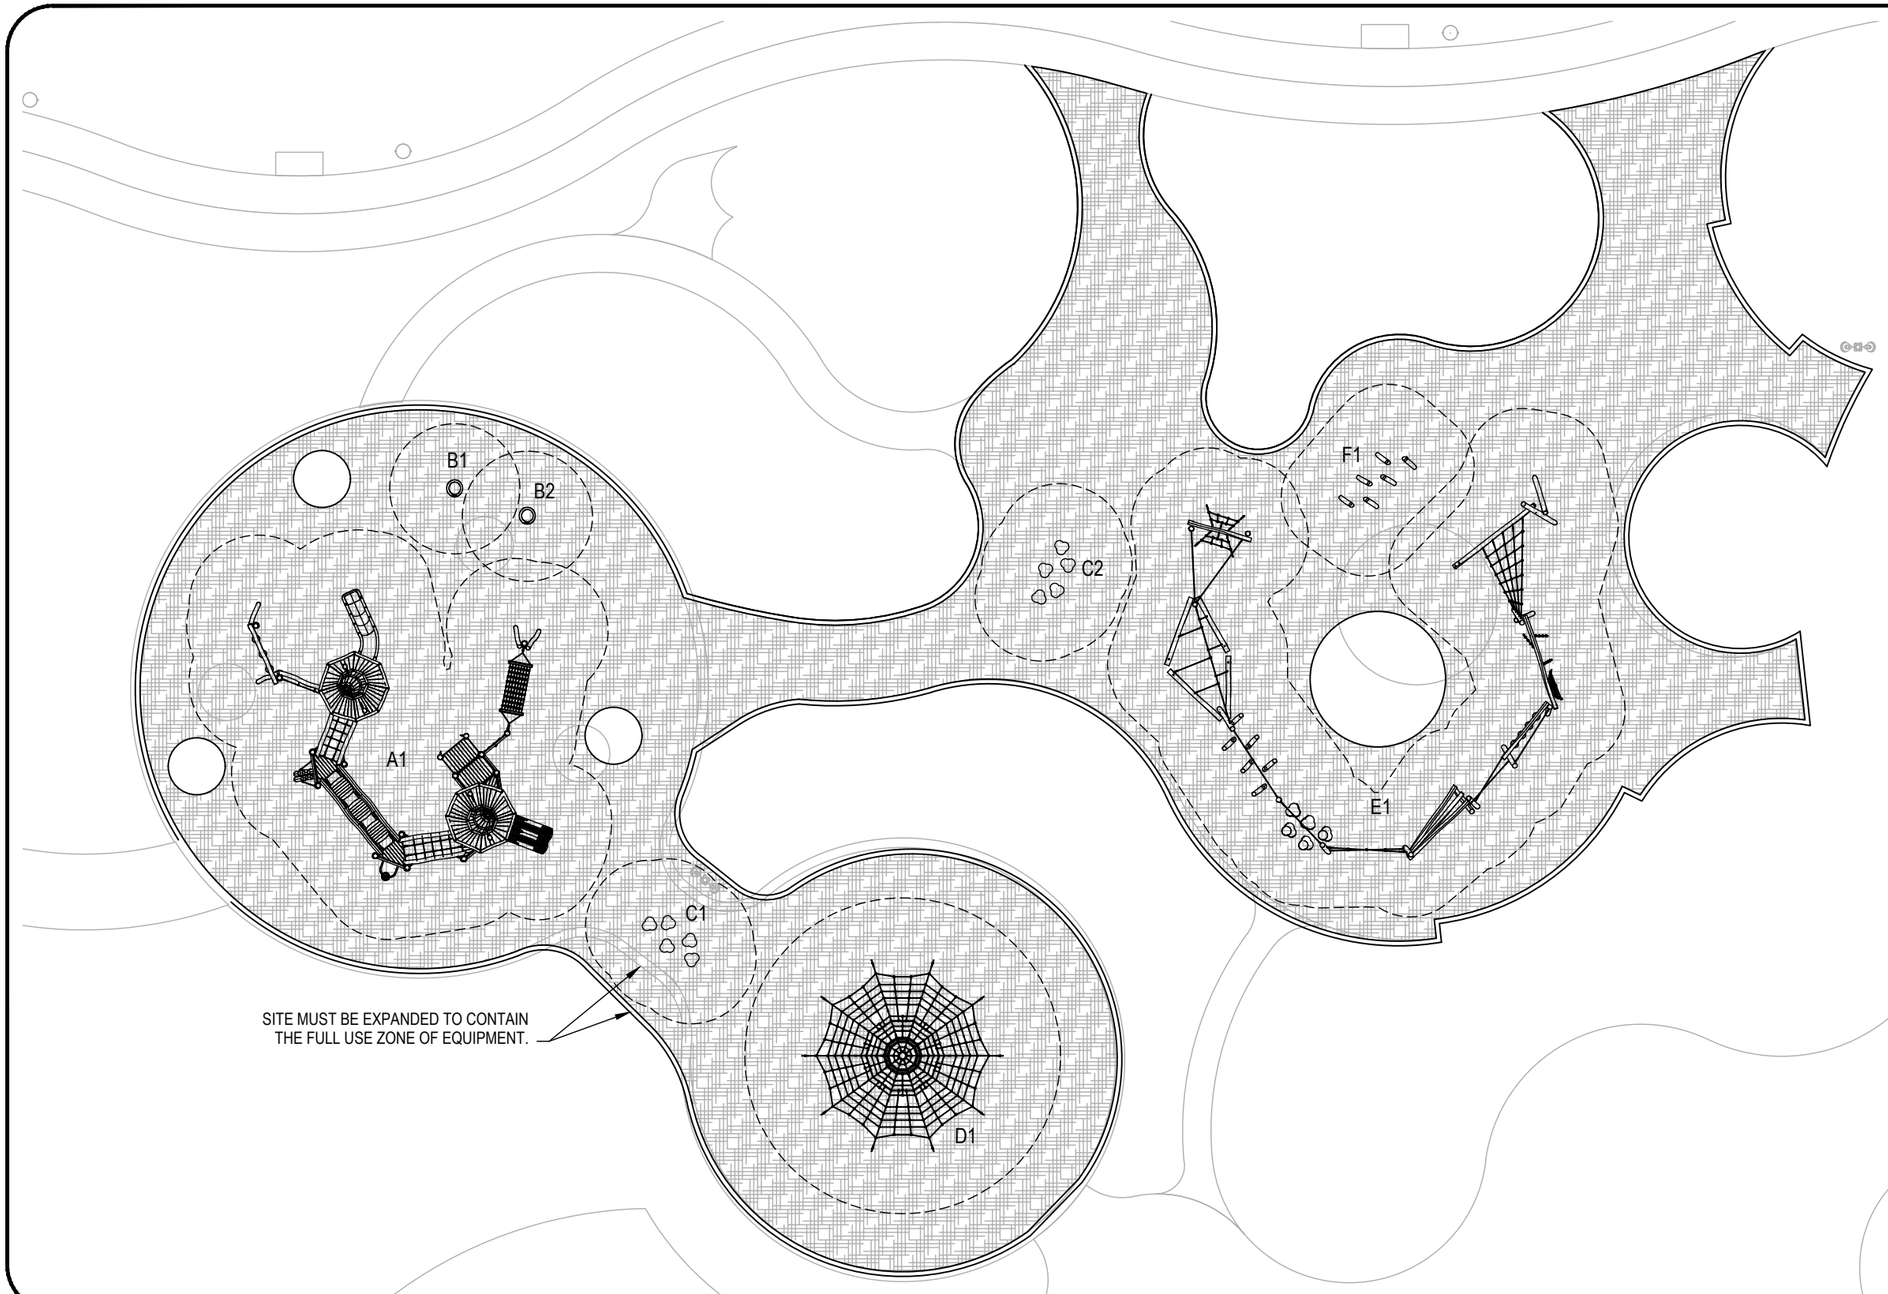



ADA Evaluation

With the introduction of the Americans with Disabilities Act (ADA) in 1990 and the subsequent adoption of standards specific to play areas, accessibility has become an important issue to everyone.

Below is a chart evaluating the play area for your proposed playground. This evaluation assumes that proper resilient surfacing within the play site and an accessible route of travel to the play area and equipment are a part of this proposal package. Also, that no other play equipment is in the site.

This play area meets current ADA requirements.

Play Area for 5-12 Year Olds

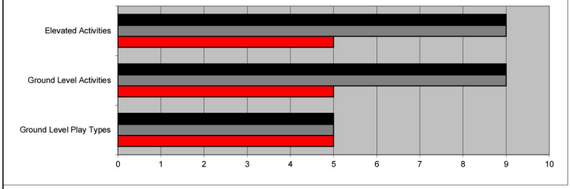

	Elevated Activities	Ground Level Activities	Ground Level Play Types
Quantity Present in Site	9	9	5
Quantity on Accessible Route	9	9	5
Quantity Required to be Accessible	5	5	5

Play Area Accessibility Checklist

KEEP A COPY OF THIS FORM FOR YOUR RECORDS.

Play Areas for 2–5 year olds and 5–12 year olds, as well as geographically separated play areas, should be evaluated separately.

Site Name Gary Matzner
Age Group 5-12
Date January 13, 2025
Prepared By MelEwa

Item Number / Name	Play Activity	Elevated	Accessible	Ground	Accessible	Ground Level Play Type
NRC400101 Warlock's Escape	Double Slide	•	•			
	Inclined Net Bridge	•	•			
	Curly Climber	•	•			
	Waggle Bridge	•	•			
	Log Climber	•	•			
	Inclined Net Bridge	•	•			
	Climbing Wall	•	•			
	Modular Slide	•	•			
	Climbing Net	•	•			
	Sewing Panel			•	•	Experimenting
	Hammock			•	•	Gathering
	Balance Daks			•	•	Balancing
ELE400024 Spinner Bowl				•	•	Spinning
ELE400024 Spinner Bowl				•	•	Spinning
NRO834 Tree Climber				•	•	Climbing/Crawling
NRO857 Parkour 006				•	•	Climbing/Crawling
NRO820 Waterlily Balance 5 pcs.				•	•	Balancing
NRO820 Waterlily Balance 5 pcs.				•	•	Balancing
	TOTALS	9	9	9	9	5
		Elevated Activities	Accessible Elevated	Ground Level Activities	Accessible Ground Level	DIFFERENT Ground Level Play Types

NOTE: If elevated play components exceed 19, the play area requires a ramp structure. https://www.access-board.gov/ada/guides/chapter-10-play-areas/#when-ramps-are-required. ADA 2010, 1008.2, Exception #1.

Accessible Elevated Activities Required 5
50% of elevated activities must be accessible.

Accessible Ground Level Activities Required 5
See table for accessibility requirements.

Accessible Ground Level Play Types Required 5
See table and compare to total number of different ground level play types. The larger number is the number of ground level play types that must be accessible.

NOTE: If a ground level play type is present but not accessible and it is the ONLY ONE, an additional ground level play component with the same play type MUST BE PROVIDED IN THE PLAY AREA TO OFFER EQUITY. (ADA2010, Chapter 2: Scoping Requirements, 240.2.1.1 Minimum Number and Types)

This form is intended to assist the evaluation of accessibility for outdoor play facilities. This form does not represent all factors required for an accessible play facility contained in the regulations, and therefore is not a guarantee, test, or confirmation of accessibility. Requirements for accessibility include appropriate accessible routes, maneuvering spaces and clear floor and ground spaces. Play components must include appropriate transfer heights and/or be accessed by ramp where appropriate. Providing and maintaining accessibility is the responsibility of the Play Facility Owner.

THE SITE PLAN AS SHOWN MEETS THE REQUIREMENTS OF THE F.B.C. (2023) ACCESSIBILITY CODE SECTIONS 240 PLAY AREAS AND 1008.2 ACCESSIBLE ROUTES SERVING PLAY AREAS.

MAINTENANCE OF ASTM F1951 COMPLIANT LOOSE FILL SURFACING IS THE RESPONSIBILITY OF THE SITE OWNER TO ENSURE ADA REQUIREMENTS FOR PATH OF TRAVEL.

#	Product Number	Product Name	M.F.H.	Count
A	NRC400101-1001	Warlock's Escape	9'8"	1
B	ELE400024-xx17DT	Spinner Bowl	2'0"	2
C	NRO820-xx01	Waterlilies Balance Posts - 5 pcs	1'1"	2
D	NRO834-xx01	Tree Climber	6'0"	1
E	NRO857-xx03	Parkour 1	5'7"	1
F	NRO806-xx01	Stilts	3'7"	1

EWF AREA: 9430 SF

CONCRETE CURB: 767' 2"

Gary Matzner Park

6610 N Kendall Dr.
Pinecrest, FL
Site Plan

0 16 32

1/16"=1'-0" ON 11" x 17" SHEET

MANUFACTURER'S SHOP DRAWING:

FOR USE BY CONTRACTOR, ENGINEER, OR DESIGN PROFESSIONAL OF RECORD. SEE SIGNED SALES PROPOSAL FOR COMPLETE SCOPE TO BE PROVIDED BY KOMPAN OR REPRESENTING AGENCY. CONFIRM FINAL PLAN AND SCOPE WITH KOMPAN SALES REP OR PROJECT MANAGER PRIOR TO USE FOR REVIEW, PERMITTING, OR CONSTRUCTION.

TO BE READ CONTINGENTLY WITH KOMPAN'S STANDARDS FOR SITE PREPARATION, MATERIALS AND INSTALLATION PROCESSES; PROVIDED AFTER EQUIPMENT PURCHASE. A COMPLIANT PLAYGROUND TO KOMPAN'S STANDARDS MUST SATISFY ALL REQUIREMENTS IN THE CODE OF CONDUCT.

SLAB BY OTHERS UNLESS OTHERWISE NOTED. FOR SURFACE MOUNT OPTIONS, THE CONCRETE REQUIREMENTS MAY BE UP TO 5½" OF 3,500 PSI MINIMUM COMPRESSIVE STRENGTH. CONTACT KOMPAN FOR SPECIFIC PRODUCT REQUIREMENTS. ALL COMPOSITE STRUCTURES SHOWN REQUIRE A SITE GRADE OF 2% MAXIMUM, 1% OPTIMAL. SPECIFICATIONS FOR EACH KOMPAN STRUCTURE MAY BE FOUND AT KOMPAN.COM/KOMPANMASTER

DIMENSIONS OF PLAY AREA, SIZE AND ORIENTATION, LOCATIONS OF ALL EXISTING UTILITIES, EQUIPMENT AND SITE FURNISHINGS TO BE FIELD VERIFIED PRIOR TO CONSTRUCTION.

PREPARED AND PRINTED IN USA BY KOMPAN © 2025 KOMPAN, INC. AUSTIN, TX. USA 800-426-9788

KOMPAN® Let's play

SALES REPRESENTATIVE			SHEET
OscLop			K1.0
REVIEW BY	DRAWN BY	DATE	
DESIGN	MelEwa	2025-01-13	
REV. NO.	REV. BY	REV. DATE	REVISION NOTES
-	-	-	-

LAYOUT IS IN ACCORDANCE WITH ASTM F1487