

SGM #: 2024-256 **WWW.SGMENGINEERING.COM**
COPYRIGHT ©2024 SGM ENGINEERING, INC.

E

D


C

B

A

PLAN KEY NOTES: #

1. PROVIDE 1" DIA. CONDENSATE DRAIN LINE. ROUTE FROM AHU, BELOW GRADE, BEYOND EXTERIOR WALL AND INTO THE LANDSCAPE AREA. USE TURNED DOWN ELBOW. TERMINATE ELBOW MIN. 6" ABOVE EXTERIOR GRADE. TERMINATE AT LEAST 1FT FROM EXTERIOR WALL. SEE DETAIL ON SHEET M701. PROVIDE MIN. 1/2" INSULATION WHERE INSIDE BUILDING AND WALLS.
2. PROVIDE REFRIGERANT LINES. ROUTE FROM AHU BELOW GRADE IN A SLEEVE PIPE TO EXTERIOR CONDENSER; REFER TO SHEET M801 FOR DETAIL. WHERE REFRIGERANT LINE RUN EXCEEDS 80 EQUIV FEET HORIZONTALLY OR 20 EQUIV FEET VERTICALLY, SIZE REFRIGERANT LINES PER CU MANUFACTURER'S RECOMMENDATIONS FOR THE SPECIFIC LENGTH INVOLVED. ALSO PROVIDE ACCESSORIES AS RECOMMENDED BY MANUFACTURER. FOLLOW THE MANUFACTURER'S RECOMMENDATIONS IN LONG LINE APPLICATION GUIDELINE.
3. PROVIDE AND MOUNT AHU AS INDICATED IN DETAIL ON DRAWING M701.
4. PROVIDE AND MOUNT EXHAUST FAN WITH BACKDRAFT DAMPER IN CEILING. ROUTE GALVANIZED STEEL EXHAUST DUCT UP TO ROOF (8" DUCT FOR EF-1 AND EF-3, AND 4" DUCT FOR EF-2) AND TERMINATE WITH ROOF VENT CAP. PROVIDE WITH BIRD SCREEN AND BACKDRAFT DAMPER.
5. PROVIDE AND MOUNT CU'S ON 4" THICK CONCRETE PADS. PAD DIMENSIONS SHALL EXCEED CU DIMENSIONS BY 6" ON ALL SIDES AND SHALL ALLOW FOR REFRIGERANT PIPING STUB-UP. PLACE CU'S AWAY FROM ROOF DRIP LINE. PROVIDE MANUFACTURER'S RECOMMENDED CLEARANCES. COORDINATE CLOSELY WITH LANDSCAPING PLANS AND ARCHITECTURAL DETAILS. REFER TO SHEET M701 FOR ANCHORING DETAIL.

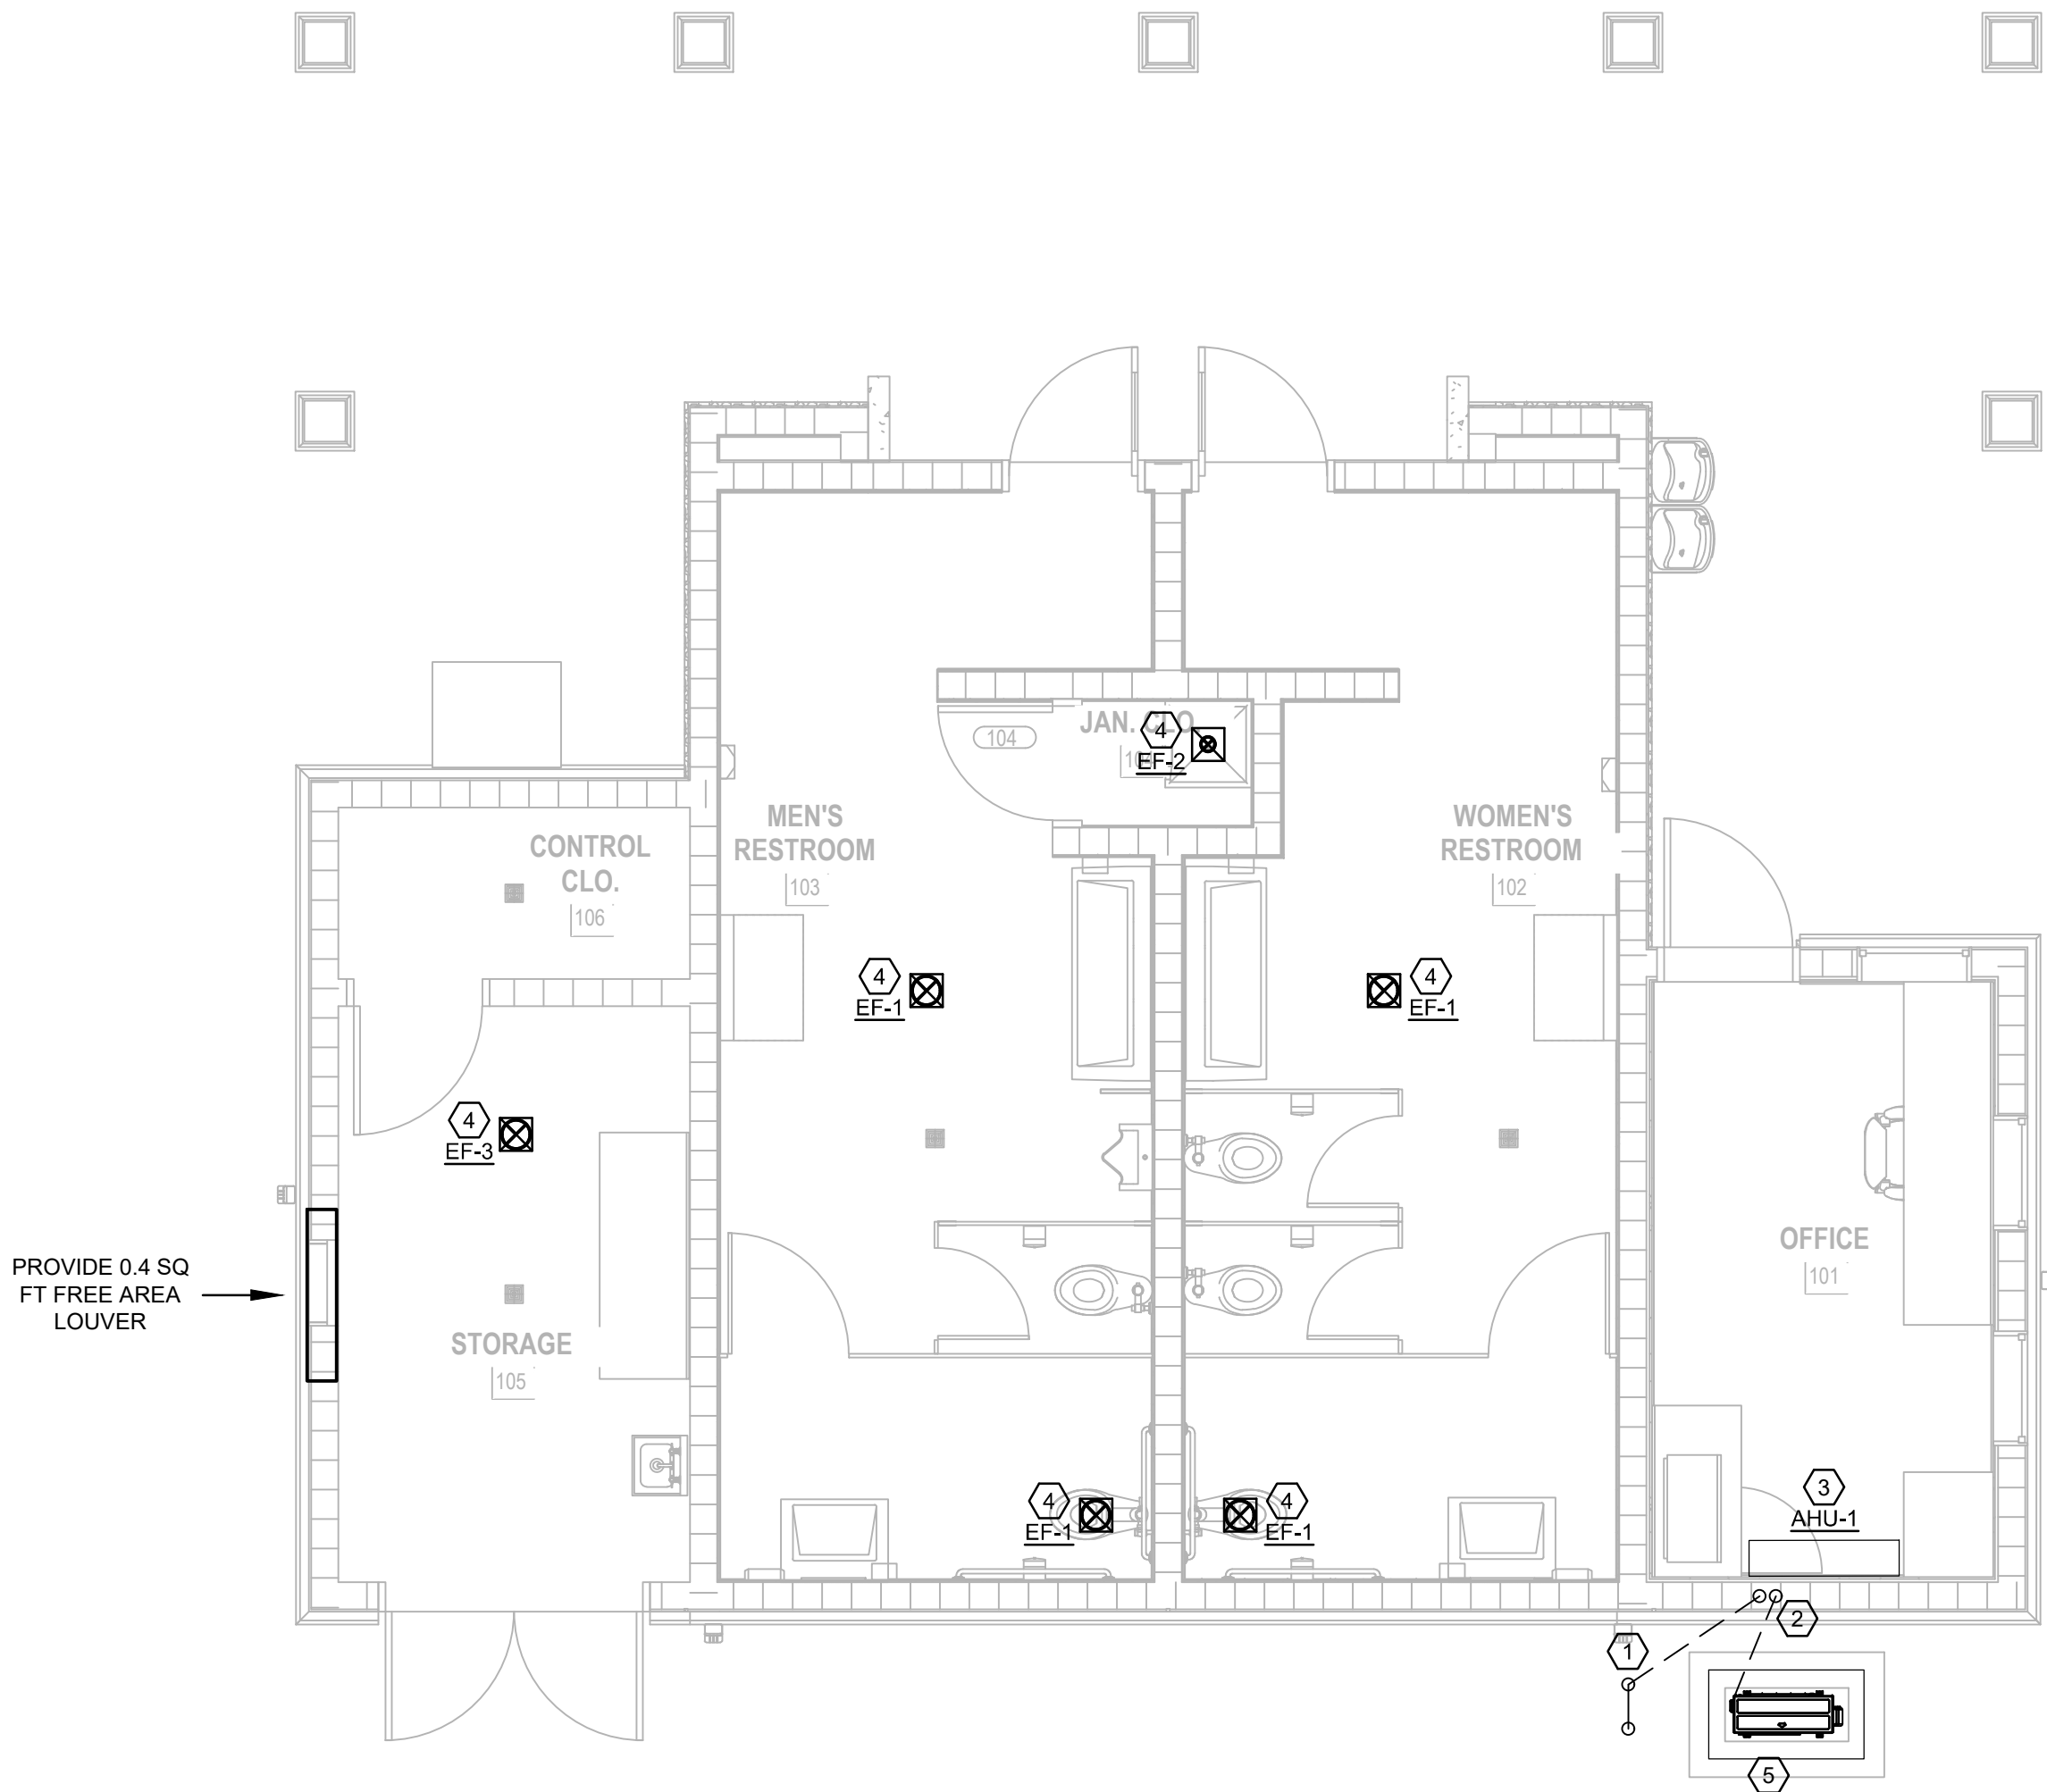


MECHANICAL FLOOR PLANS

SCALE: 1/4"=1'-0"



This item has been digitally signed and sealed by JOHN A. STELLPLUG on the date adjacent to the seal. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

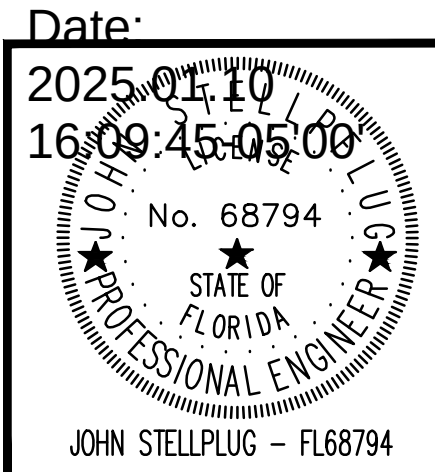

SGMENGINEERING

SGM #:
2024-256

935 LAKE BALDWIN LANE
ORLANDO, FL 32814
TEL: 407-767-5188
FAX: 407-767-5772
CA-00006208

WWW.SGMENGINEERING.COM

©2024 SGM ENGINEERING, INC.

PROJECT LEAD & CIVIL ENGINEERING:

KEITH

301 EAST ATLANTIC BLVD.
POMPAN0 BEACH, FL 33060
PH: (954) 788-3400

Florida Engineering Business License: CA7928
Florida Surveyor and Mapper Business License: LB6860
Florida Landscape Architecture Business License: LC26900457

LANDSCAPE ARCHITECT:

MKSK

801 INTERNATIONAL PARKWAY
LAKE MARY, FL 32746
407.871.9607
MKSKSTUDIOS.COM

ARCHITECT:

WA

WANNEMACHER, JENSEN ARCHITECTS
815 NORTHWEST 57 AVE. SUITE 219
MIAMI, FLORIDA 33126
727-822-5588
WJARG.COM

AA0002277

MECHANICAL, PLUMBING, & ELECTRICAL ENGINEERING:

SGMENGINEERING

5301 WATERFORD DISTRICT DR.
SUITE 750
854-421-1944
SGMENGINEERING.COM

CA-00006208

REVISIONS

NO.	DESCRIPTION	DATE
	ISSUED FOR BUILDING PERMIT	11/21/2024
	REVISED FOR BUILDING PERMIT	01/10/2025

**PRELIMINARY PLAN
NOT FOR CONSTRUCTION**
THESE PLANS ARE NOT FULLY PERMITTED
AND ARE SUBJECT TO REVISIONS MADE
DURING THE PERMITTING PROCESS.

ISSUE DATE:	XX/XX/20
DESIGNED BY:	XXX
DRAWN BY:	XXX
CHECKED BY:	XXX

THOMAS F. DONAHUE, P.E.
FLORIDA REG. NO. 60529
(FOR THE FIRM)

CLIENT
**VILLAGE OF
PINECREST**
PINECREST PARKS & RECREATION

PROJECT

SHEET TITLE

MECHANICAL
FLOOR PLANS

SHEET
NUMBER
M201

KEITH PROJECT
NUMBER
13861.00

STATUS: PRELIMINARY

