


DRAINAGE REPORT

FOR

**PINECREST P8
13100 SW 80 AVENUE
PINECREST, FLORIDA 33156**

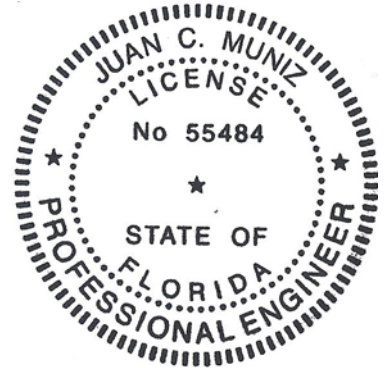

This item has been digitally
signed and sealed by
Juan C. Muniz, PE
on the date adjacent to the seal.
Printed copies of this document
are not considered signed and
sealed and the signature must
be verified on any electronic
copies.

03-11-2025

Juan C. Muniz, PE #55484

Prepared by:

**JCM CONSULTANTS
8401 S.W. 184 STREET
PALMETTO BAY, FLORIDA 33157
305-772-0088**

JANUARY 2025

I. PROJECT DESCRIPTION

The project consists of a new single family home addition.

II. EXISTING CONDITIONS (Vacant)

Site Area = 20,786 SF

Pervious Area = 16,440 SF

Impervious Area = 4,346 SF

III. PROPOSED SITE DISTRIBUTION

Site Area = 20,786 SF

Pervious Area = 9,990 SF

Impervious Area = 10,796 SF

IV. REQUIRED STORAGE

Rainfall Amount (P) = 9.5 inches

Average October Water Table Elevation = 3.50' N.G.V.D.

Average Pervious Elevation = 11.0

$$\text{Depth to water table} = 11.0' - 3.50' = 8.5'$$

Compacted Soil Storage = 8.175'*

**According to Section 8.4.2 "Ground Storage" from the South Florida Water Management District's "Management and Storage of Surface Waters Permit Information Manual, Volume IV", compacted, cumulative water storage.*

Existing Conditions

$$S = (\text{Pervious Area} / \text{Site Area}) * (\text{Compacted Soil Storage}) = (16,440 / 20,786) * 8.175$$

$$S(\text{exist.}) = 6.46 \text{ in}$$

$$\text{Runoff (R)} = (P - 0.2S)^2 / (P + 0.8S) = 4.59 \text{ in}$$

$$\text{Volume of Runoff (V)} = A \cdot R / 12 = \mathbf{7,950 CF}$$

Proposed Conditions

$$S = (\text{Pervious Area} / \text{Site Area}) * (\text{Compacted Soil Storage}) = (9,990 / 20,786) * 8.175$$

$$S(\text{proposed}) = 3.93 \text{ in}$$

$$\text{Runoff (R)} = (P - 0.2S)^2 / (P + 0.8S) = 6.32 \text{ in}$$

$$\text{Volume of Runoff (V)} = A \cdot R / 12 = \mathbf{10,983 \text{ CF}}$$

[illegible]

$$1.0 \text{ in} \times 20,786 \text{ SF} / 12 \text{ in/ FT} = 1,732 \text{ CF}$$

$$2.5 \text{ in} \times 10,796 \text{ SF} / 12 \text{ in/FT} = 2,249 \text{ CF}$$

V. PROVIDED STORAGE

$$\text{Swale Area Storage} = (\text{Top Area} + \text{Bottom Area})/2 * \text{Depth of Swale Area}$$

$$\text{Depth of Swale Area} = 11.00 - 10.0 = 1.0'$$

Area @ elevation 11.00 = 5,700 SF

Swale Area @ elevation 10.00 = 800 SF

$$\text{Total on-site storage} = (5,700 + 800)/2 * 1.00' = 3,250CF$$

>>>>>>>>>>>>>>>>3,250CF > 3,033 CF (OK)<<<<<<<<<<<<<<<<