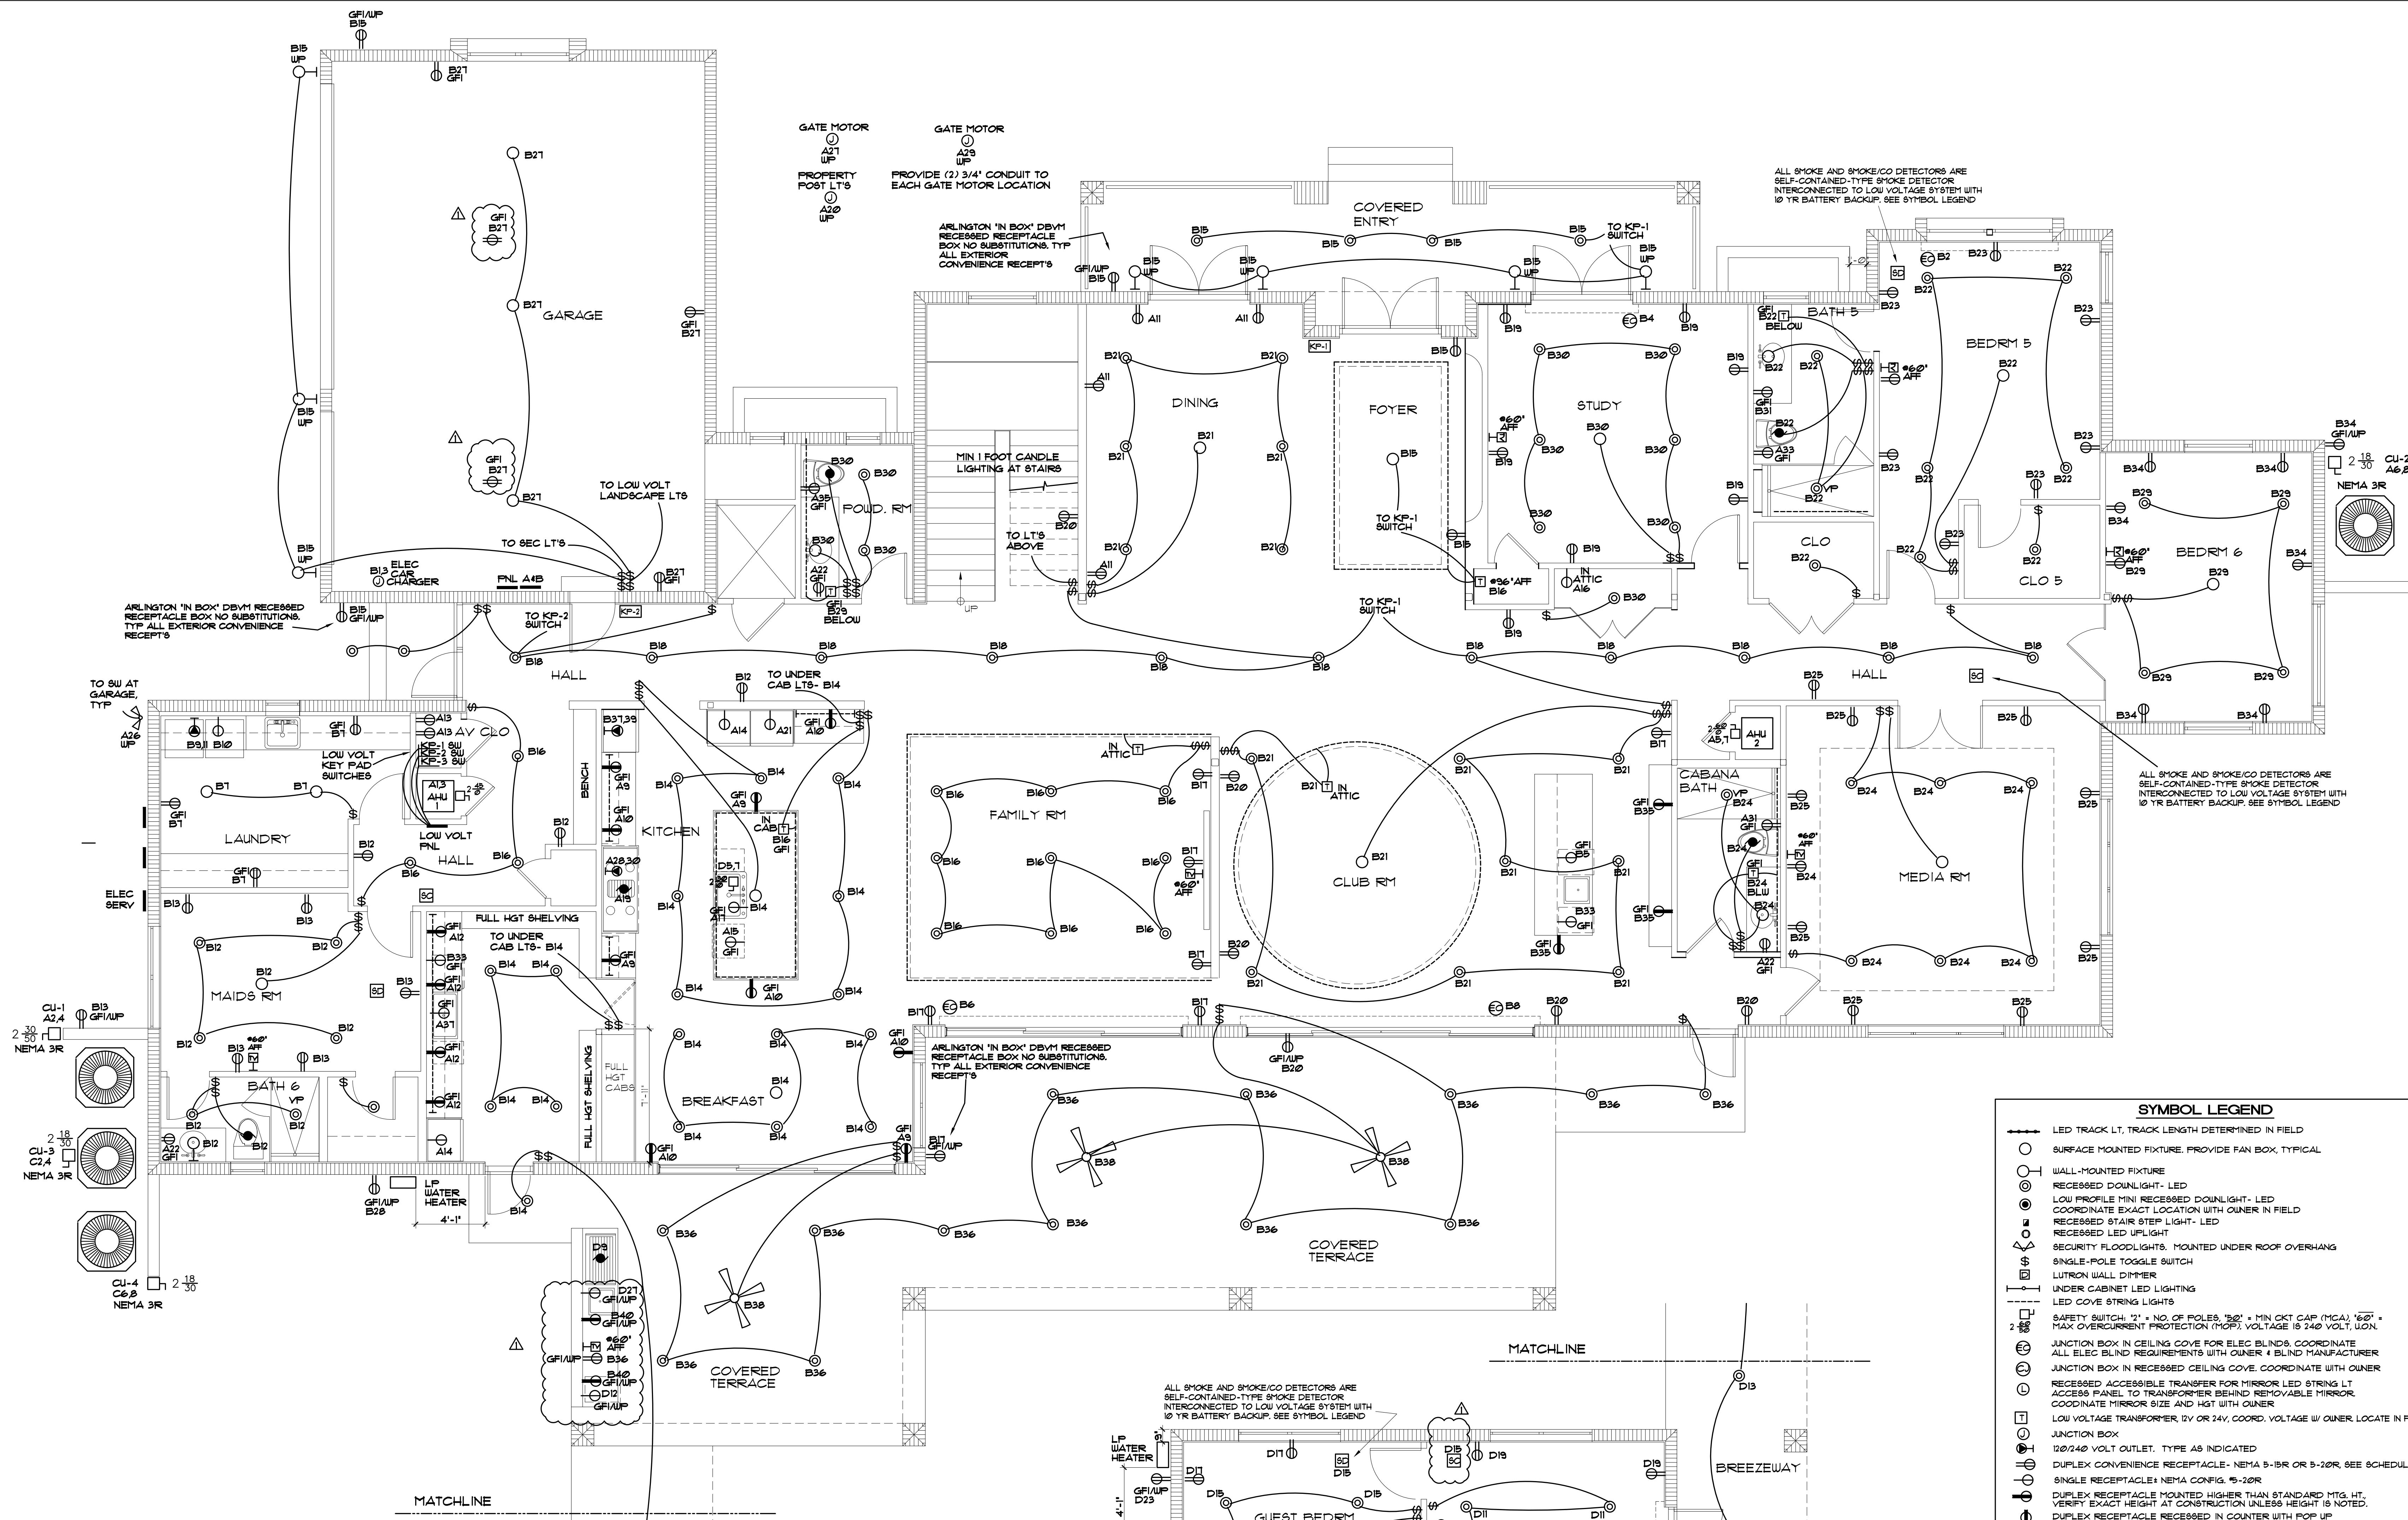


ELECTRICAL PLAN AT GUEST QUARTERS
SCALE: 1/4" = 1'-0"

SYMBOL LEGEND	
	LED TRACK LT, TRACK LENGTH DETERMINED IN FIELD
	SURFACE MOUNTED FIXTURE, PROVIDE FAN BOX, TYPICAL
	WALL-MOUNTED FIXTURE
	RECESSED DOWNLIGHT - LED
	LOW PROFILE MINI RECESSED DOWNLIGHT - LED
	COORDINATE EXACT LOCATION WITH OWNER IN FIELD
	RECESSED STAIR STEP LIGHT - LED
	RECESSED LED UPLIGHT
	SECURITY FLOODLIGHTS, MOUNTED UNDER ROOF OVERHANG
	SINGLE-POLE TOGGLE SWITCH
	LUTRON WALL DIMMER
	UNDER CABINET LED LIGHTING
	LED COVE STRING LIGHTS
	SAFETY SWITCH 1" x NO. OF POLES 1/2" x MIN. OCP CAP (MCA) 1/2" x MAX. OVERCURRENT PROTECTION (MOP), VOLTAGE IS 240 VOLT, U.O.N.
	JUNCTION BOX IN CEILING COVE FOR ELEC. BLINDS, COORDINATE ALL ELEC. BLIND REQUIREMENTS WITH OWNER & BLIND MANUFACTURER
	JUNCTION BOX IN RECESSED CEILING COVE, COORDINATE WITH OWNER
	RECESSED ACCESSIBLE TRANSFER FOR MIRROR LED STRING LT. ACCESS PANEL TO TRANSFORMER BEHIND REMOVABLE MIRROR, COORDINATE MIRROR SIZE AND HGT. WITH OWNER
	LOW VOLTAGE TRANSFORMER, 12V OR 24V, COORD. VOLTAGE W/ OWNER, LOCATE IN FIELD
	JUNCTION BOX
	120/240 VOLT OUTLET, TYPE AS INDICATED
	DUPLEX CONVENIENCE RECEPTACLE - NEMA 5-15R OR 5-20R, SEE SCHEDULES
	SINGLE RECEPTACLE - NEMA CONFIG. 5-20R
	DUPLEX RECEPTACLE MOUNTED HIGHER THAN STANDARD MTS. HGT., VERIFY EXACT HEIGHT AT CONSTRUCTION UNLESS HEIGHT IS NOTED.
	DUPLEX RECEPTACLE RECESSED IN COUNTER WITH POP UP ACTIVATION
	TELEPHONE OUTLET - CAT 6 CABLE
	TV RECEPTACLE - CAT 6 CABLE & RG6 CABLE & AUDIO CABLES
	MOTOR, SIZE AS NOTED
	INDICATES WEATHERPROOF NEMA 4 OR 5R
	INDICATES ABOVE FINISHED FLOOR
	INDICATES GROUND FAULT INTERRUPTOR
	LOW VOLTAGE KEYPAD, OWNER TO SELECT LOW VOLTAGE LIGHTING SYSTEM
	SELF-CONTAINED-TYPE SMOKE DETECTOR INTERCONNECTED TO LOW VOLTAGE SYSTEM WITH 10 YR BATTERY BACKUP
	SELF-CONTAINED-TYPE SMOKE & CARBON MONOXIDE DETECTOR INTERCONNECTED TO LOW VOLTAGE SYSTEM WITH 10 YR BATTERY BACKUP
	52" FAN PER OWNER'S SPECIFICATIONS
	W/ LUTRON ADJUSTABLE SPEED SWITCH


NOTE:

APPLICABLE CODES - 2023 FLORIDA BUILDING CODE - RESIDENTIAL
2020 NEC - COMPLY WITH NEC210.8(A) Dwelling Units: Receptacles in dwelling rooms & areas listed require GFCI protection for all 125-volt, through 250-volt receptacles.
ALL SMOKE DETECTORS TO BE INTERCONNECTED, THIS HOUSE CONTAINS 12 OR LESS DETECTORS, A HOUSEHOLD FIRE WARNING SYSTEM PANEL IS NOT REQUIRED.
ALL 15A AND 20A RECEPTACLES TO BE LISTED TAMPER RESISTANT RECEPTACLES.
90% OF LIGHTING TO BE RATED ENERGY EFFICIENT AS PER 2023 FBC

REVISION BY
1- 3/30/26 BLD DEPT CORR


MR MARK REARDON R.A.
architect
LEED ACCREDITED
stixandstones@bellsouth.net
phone: 786-355-6910

15790 SW 88TH AVE
MIAMI, FL 33157
AR 0017521
786-355-6910



NOTE:
ALL DRAWINGS FOR THIS PROJECT ARE TO BE READ IN CONJUNCTION WITH EACH OTHER. THESE INCLUDE, BUT ARE NOT LIMITED TO: ARCHITECTURAL, SURVEYING, STRUCTURAL, CIVIL, MECHANICAL, ELECTRICAL, SPECIALTY DRAWINGS, & WRITTEN SPECIFICATIONS

THE G.C. IS TO VERIFY ALL EXISTING SITE CONDITIONS AND THOROUGHLY CHECK ELEVATIONS & DIMENSIONS BEFORE COMMENCING WORK. REPORT TO THE ARCHITECT OR ENGINEER ANY DISCREPANCIES, ERRORS OR CONDITIONS THAT WILL ALTER CONSTRUCTION AS INTENDED BY THESE DRAWINGS. ARCHITECT IS NOT RESPONSIBLE FOR ANY WORK AND/OR MATERIALS FURNISHED ON THE JOB.

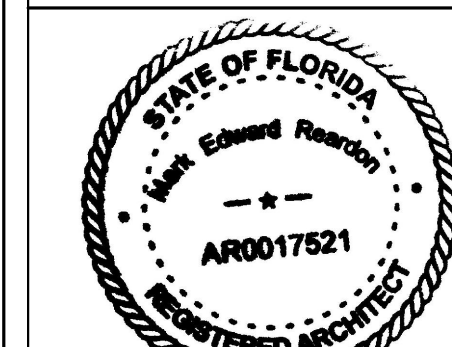

NEW HOUSE FOR:
RKTA 6300 LLC
6300 SW 98 ST
PINECREST, FL


DRAWN BY:

DATE:

SCALE:

SHEET NO.:

E-1



SCALE: 1/4" = 1'-0"



APPLICABLE CODES- 2023 FLORIDA BUILDING CODE- RESIDENTIAL

2020 NEC- COMPLY WITH NEC210.8(A) Dwelling units- Receptacles in dwelling rooms & areas listed require GFCI protection for all 125-volt, through 250-volt receptacles.

ALL SMOKE DETECTORS TO BE INTERCONNECTED. THIS HOUSE CONTAINS 12 OR LESS DETECTORS, A HOUSEHOLD FIRE WARNING SYSTEM PANEL IS NOT REQUIRED.

ALL 15A AND 20 A RECEPTABLES TO BE LISTED TAMPER RESISTANT RECEPTABLES. 90% OF LIGHTING TO BE RATED ENERGY EFFICIENT AS PER 2023 FEC

