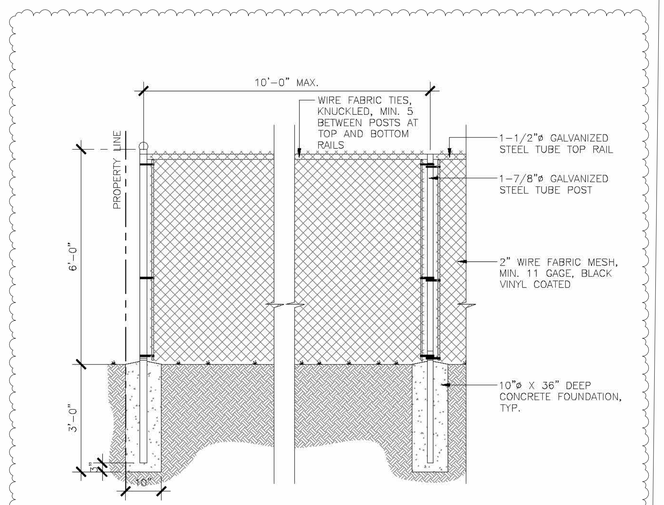


CHAIN LINK FENCE DETAIL

****** IMPORTANT FOR USE AS A POOL BARRIER ******

RESIDENTIAL SWIMMING POOLS BARRIERS SHALL COMPLY WITH SECTIONS 454.2.17.1 THROUGH 454.2.17.3.
OUTDOOR SWIMMING POOLS SHALL BE PROVIDED WITH A BARRIER COMPLYING WITH FLORIDA BUILDING CODE SECTIONS 454.2.17.1.1 THROUGH 454.2.17.1.14.
ACCESS GATES SHALL BE EQUIPPED WITH A SELF-CLOSING SELF-LATCHING LOCKING DEVICE LOCATED NO LESS THAN 54 INCHES FROM THE BOTTOM OF THE GATE. THE DEVICE RELEASE MECHANISM SHALL BE LOCATED ON THE POOL SIDE OF THE GATE AND SO PLACED THAT IT CANNOT BE REACHED BY A YOUNG CHILD OVER THE GATE OR THROUGH ANY OPENING OR GAP. GATES THAT PROVIDE ACCESS TO THE SWIMMING POOL MUST OPEN OUTWARD AWAY FROM THE POOL.
THE TOP OF THE BARRIER SHALL BE AT LEAST 48 INCHES ABOVE GRADE MEASURED ON THE SIDE OF THE BARRIER WHICH FACES AWAY FROM THE SWIMMING POOL.
THE MAXIMUM VERTICAL CLEARANCE BETWEEN GRADE AND THE BOTTOM OF THE BARRIER SHALL BE 2 INCHES MEASURED ON THE SIDE OF THE BARRIER WHICH FACES AWAY FROM THE SWIMMING POOL.
MAXIMUM MESH SIZE FOR CHAIN LINK FENCES SHALL BE A 2 ¼INCH SQUARE UNLESS THE FENCE IS PROVIDED WITH SLATS FASTENED AT THE TOP OR BOTTOM WHICH REDUCE THE OPENINGS TO NO MORE THAN 1 ¾INCHES.


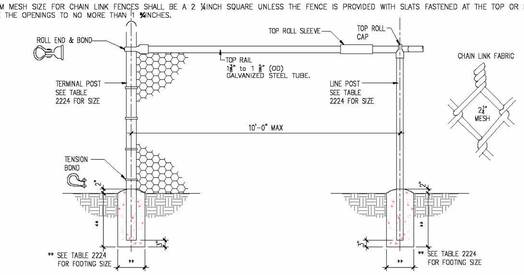



TABLE 2224
CHAIN LINK FENCE MINIMUM REQUIREMENTS

Fence Height (ft)	Terminal Post Dimensions (o.d. x wall thickness) (in inches)	Line Post Dimensions (o.d. x wall thickness) (in inches)	Terminal Post Concrete Foundation Size (diameter x depth) (in inches)	Line Post Concrete Foundation Size (diameter x depth) (in inches)
Up to 4	2 3/8 × 0.042	1 7/8 × 0.047	10 × 24	8 × 24
Over 4 to 5	2 3/8 × 0.042	1 7/8 × 0.055	10 × 24	8 × 24
Over 5 to 6	2 3/8 × 0.042	1 7/8 × 0.065	10 × 24	8 × 24
Over 6 to 8	2 7/8 × 0.110	2 3/8 × 0.095	10 × 36	10 × 36
Over 8 to 10	2 7/8 × 0.110	2 3/8 × 0.130	12 × 40	10 × 40
Over 10 to 12	2 7/8 × 0.160	2 7/8 × 0.120	12 × 42	12 × 42

NOTES:
1. THIS TABLE IS APPLICABLE ONLY TO FENCES WITH UNRESTRICTED AIRFLOW.
2. FABRIC: 121/2 GAUGE MINIMUM.
3. TENSION BANDS: USE ONE LESS THAN THE HEIGHT OF THE FENCE IN FEET EVENLY SPACED.
4. FABRIC TIES: MUST BE MINIMUM THE SAME GAUGE OF THE FABRIC.
5. FABRIC TIE SPACING ON THE TOP RAIL: FIVE TIES BETWEEN POSTS, EVENLY SPACED.
6. FABRIC TIE SPACING ON LINE POSTS: ONE LESS THAN HEIGHT OF THE FENCE IN FEET, EVENLY SPACED.
7. EITHER TOP RAIL OR TOP TENSION WIRE SHALL BE USED.
8. BRACES MUST BE USED AT TERMINAL POSTS IF TOP TENSION WIRE IS USED INSTEAD OF TOP RAIL.
9. POST SPACING: 10 FOOT (3 M) ON CENTER MAXIMUM.
10. POSTS SHALL BE EMBEDDED TO WITHIN 6 INCHES (152 MM) FROM THE BOTTOM OF THE FOUNDATION.
11. IN ORDER TO FOLLOW THE CONTOUR OF THE LAND, THE BOTTOM OF THE FENCE MAY CLEAR THE CONTOUR OF THE GROUND BY UP TO 5 INCHES (127 MM) WITHOUT INCREASING TABLE VALUES TO THE NEXT HIGHER LIMIT.

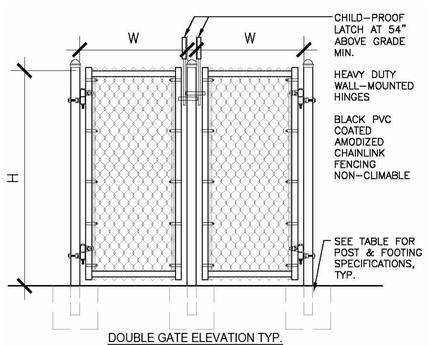

DOUBLE GATE ELEVATION TYP.

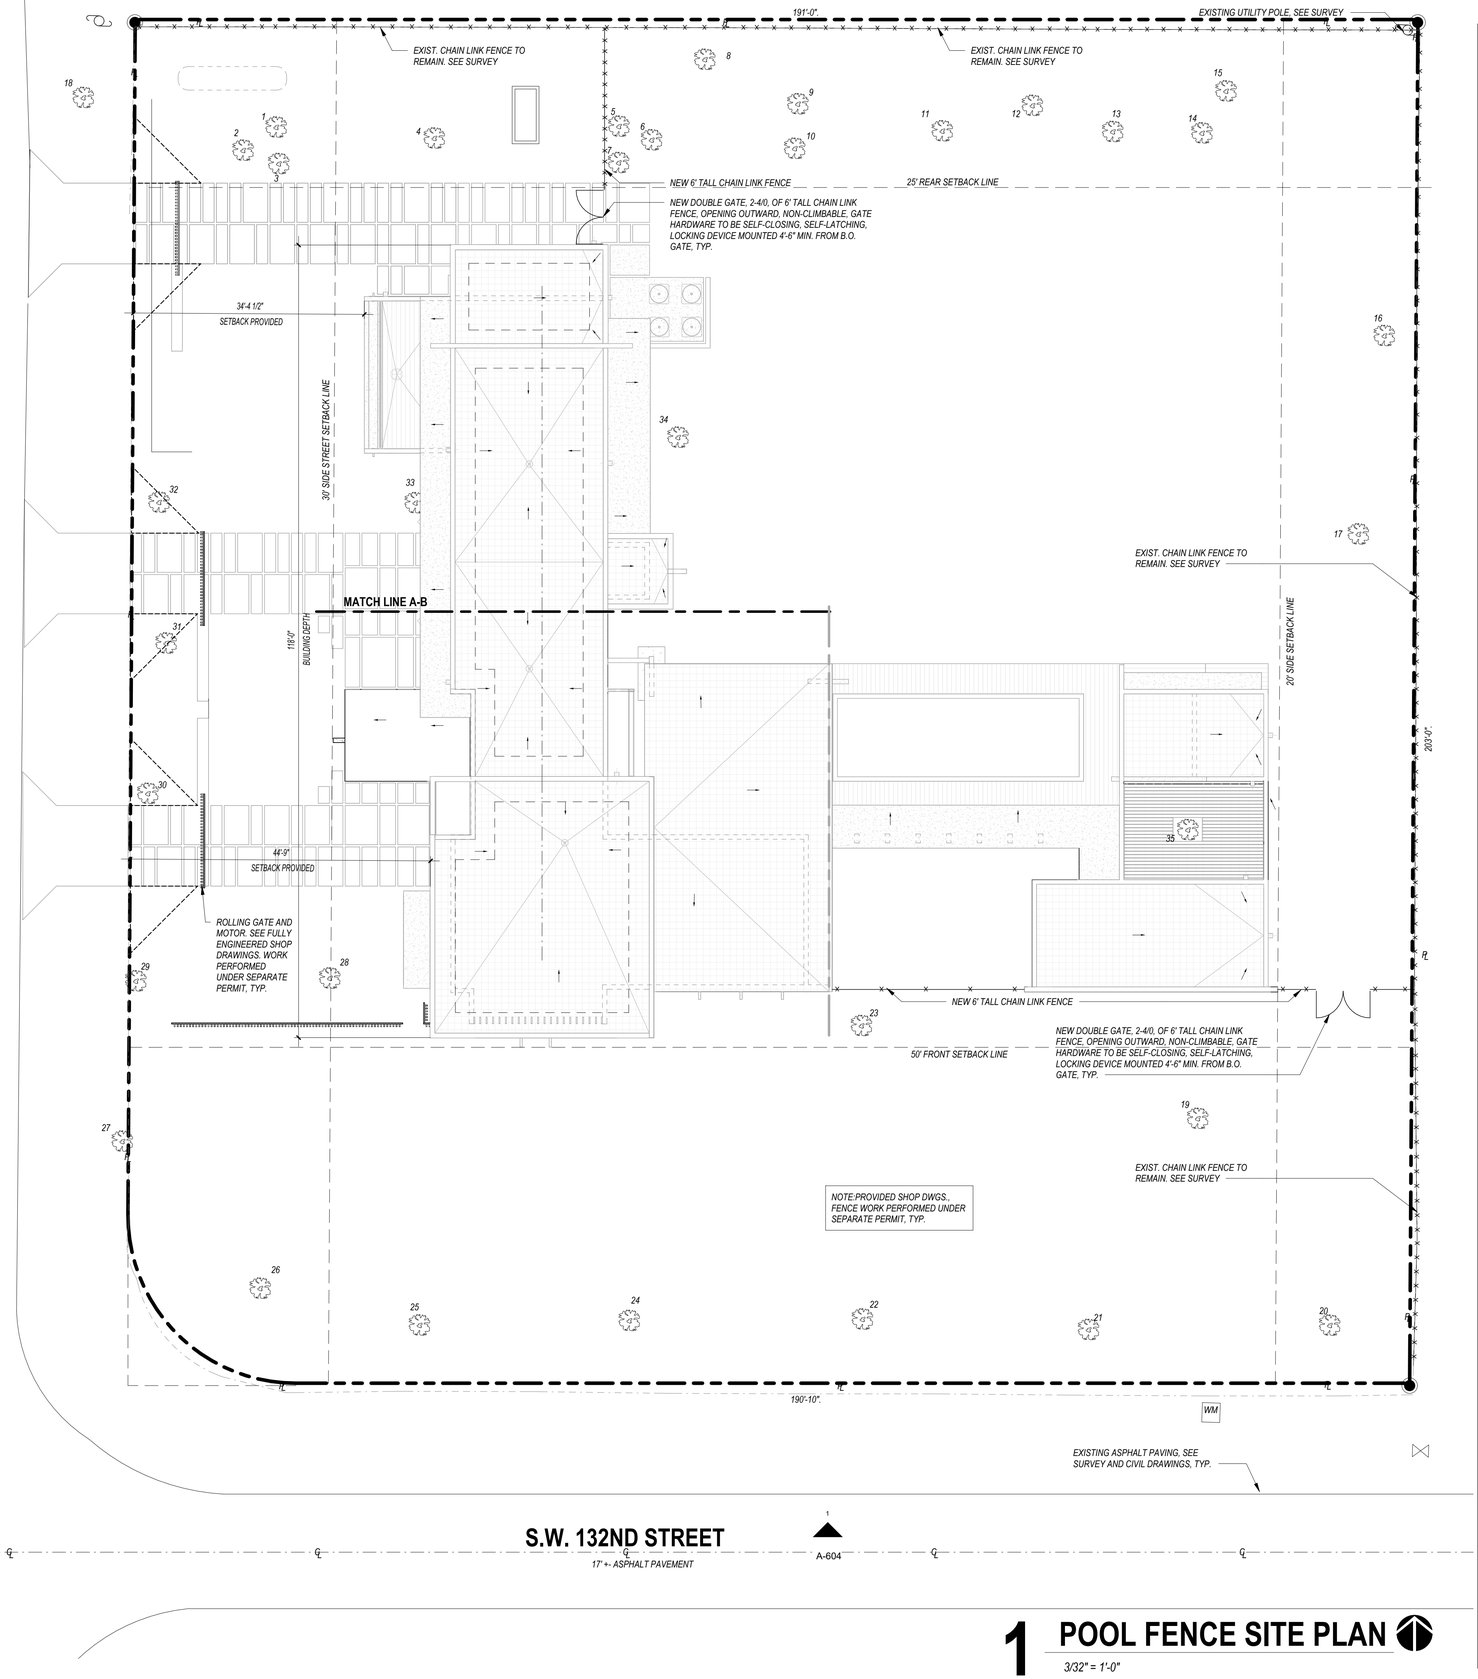

1 POOL FENCE SITE PLAN

3/32" = 1'-0"

#26000522

MATEU

8887 SOUTHWEST 131 STREET
MIAMI, FLORIDA 33176
305.233.3304 DESIGN@MATEU.CO

ARCHITECTURE INTERIOR DESIGN PLANNING

SEAL:

Digitally signed by Roney J. Mateu
Date: 2026.07.08 11:26:46 -04'00'

RONEY J. MATEU, FAIA
AR0008220

G.F. CONSULTING ENGINEERS, INC.
STRUCTURAL ENGINEERING
13170 SW 128 STREET, SUITE 204
MIAMI, FLORIDA 33186

JMM CONSULTING ENGINEERS
MECH., ELEC., PLUMB. ENGINEERING
10251 SUNSET DRIVE, SUITE 103
MIAMI, FLORIDA 33173

CARLAB, INC.
CIVIL ENGINEERING
8730 SW 25 STREET
MIAMI, FLORIDA 33165

CARLOS MAURICIO & FERNANDA ROCA
MA 2405
13125 SW 63 AVENUE
PINECREST, FLORIDA 33156

CASA @ 63RD AVENUE

NEW SINGLE-FAMILY RES. EU-1 RESIDENTIAL ESTATE

MATEU ARCHITECTURE INC

THIS DRAWING IS THE PROPERTY OF MATEU ARCHITECTURE INC. UNLESS OTHERWISE PROVIDED FOR BY CONTRACT. THE CONTENTS OF THIS DRAWING ARE CONFIDENTIAL AND SHALL NOT BE TRANSMITTED TO ANY PARTY EXCEPT AS AUTHORIZED BY THE ARCHITECT / ENGINEERS OF RECORD

COPYRIGHT © BY MATEU ARCHITECTURE INC.

PHASE
Project Status

FILE NAME:
M:\2405 Casa Pa' Fernanda_CD\MODEL\ARCH\Casa on 63rd ave_RVM25.rvt

PROJECT NO:
MA 2405

DRAWN BY:
DY

CHECKED BY:
RJM

ISSUE DATE:
11/14/24

REVISIONS
6 07/08/26 Pool Barrier Comments

SHEET TITLE
SITE PLAN, POOL BARRIER FENCE DETAILS

SHEET: A-100.PF OF: