


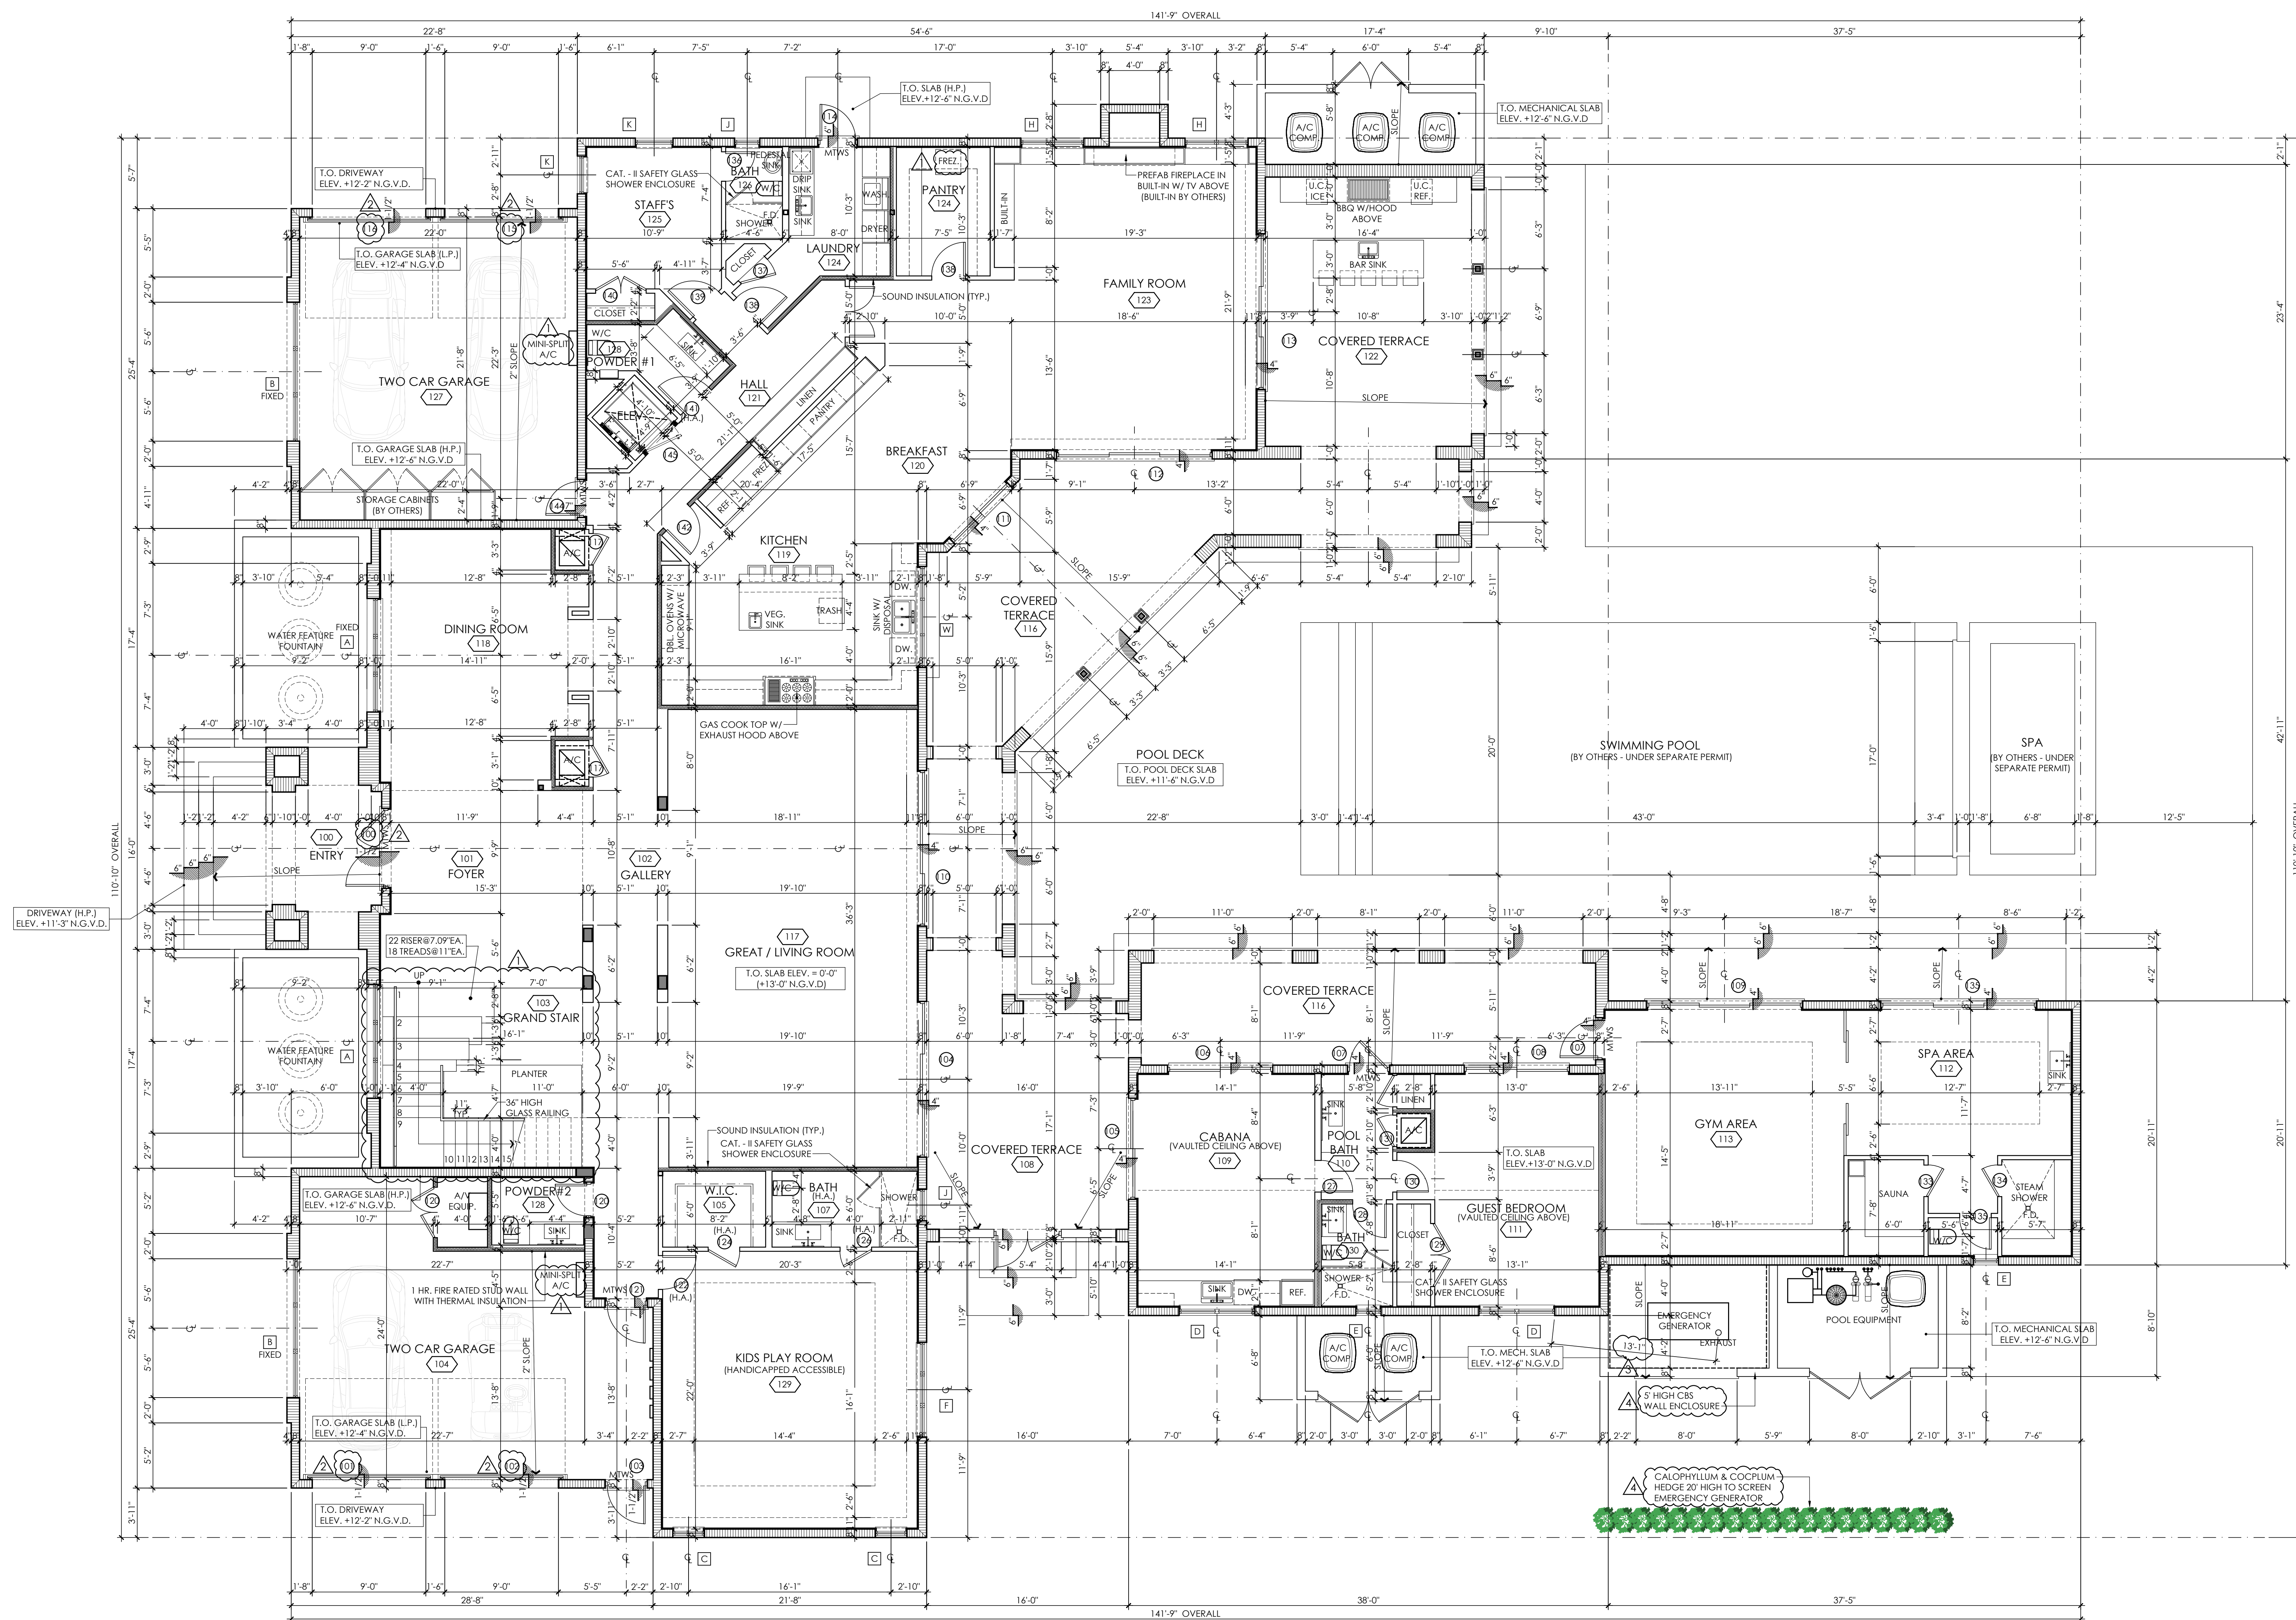

LEGEND

	NEW C.M.U. WALL
	INTERIOR METAL STUD WALL
	INTERIOR METAL STUD WALL WITH ACOUSTIC INSULATION
	DOOR NO. - REFER TO DOOR SCHEDULE SHEET
	WINDOW TYPE - REFER TO SCHEDULE SHEET
	FLOOR TYPE - REFER TO SCHEDULE SHEET

FLOOR PLAN NOTES

1. SWIMMING POOL SPA BY OTHERS AND UNDER SEPARATE PERMIT BY POOL CONTRACTOR. ALL FINISHES AS SELECTED BY OWNER.
2. EXTERIOR AREAS TO BE TIELED WITH A NON-SLIP RESISTANT TILE MATERIAL AS SELECTED BY OWNER.
3. INSIDE FACE OF EXTERIOR WALLS SHALL BE INSULATED WITH R-5 MINIMUM EXTERIOR WALL INSULATION.
4. ALL OPENINGS TO BE INSULATED WITH A MINIMUM OF R-30 SPRAYED INPLACE SPRAYED INSULATION INCLUSIVE OF GARAGE ATTACH SPACE.
5. ALL BATHROOMS SHALL RECEIVE 5/8" DURLOCK BOARD OR MOISTURE RESISTANT BOARD AS A TILE BASE.
6. DOOR MANUFACTURER SHALL COORDINATE SLIP RESCESS REQUIRED AT ALL EXTERIOR DOORS.
7. COORDINATE ALL WINDOW AND DOOR MASONRY OPENINGS WITH WINDOW & DOOR MANUFACTURER PRIOR TO BLOCK WALL INSTALLATION. PROVIDE SHOP DRAWINGS FOR REVIEW PRIOR TO INSTALLATION.
8. ALL WINDOWS AND DOORS SHALL RECEIVE IMPACT RESISTANT GLASS AND SHALL COMPLY W/ ENERGY CALCULATIONS & FIC-R-2020 (LATEST EDITION).

GARAGE NOTES

1. PROVIDE SLOPE THAT MEETS:
"DANGER - DO NOT OPERATE CAR WITH ENGINE WITH DOOR CLOSED, CARBON MONOXIDE EMISSIONS ARE LETHAL."
2. GARAGE INSIDE WALLS SHALL RECEIVE SKIN COAT - SMOOTH STUCCO FINISH.
3. PROVIDE 40 SQ. IN. OF VENT OPENING PER CAR GARAGE WITH SCHEDULED VENTER BLOCKS PER R-30 W/20TH F11.
4. CEILING SHALL RECEIVE 5/8" TYPE "C" GYPSUM BOARD (1-HR FIRE RATING) PER FIRE RATING NOTES.
5. GARAGE DOOR MUST HAVE UP/LIFT MECHANISM & SHALL BE

