

Date: Jun 9th, 2026

To: Inspector reviewer


RE: **13100 SW 80T Pinecrest**
Narrative Letter – Job Number 24 1560 P8

Inspector,

The size of the footing F11.67 has been updated under Revision #3, please refer to Sheet S-2.0 Schedule

2	F7.0A	7'-0" x 5'-6"	12"	8-#5 T&B	5-#5 T&B	ISOLATED FOOTING	3000 PSI	
	F12.0	12'-0" x 9'-0"	15"	13-#5 T&B	12-#5 T&B	ISOLATED FOOTING	3000 PSI	
3	F11.67	11'-8" x 3'-6"	12"	#5 @12"	3-#5	ISOLATED FOOTING	3000 PSI	12

NOTES

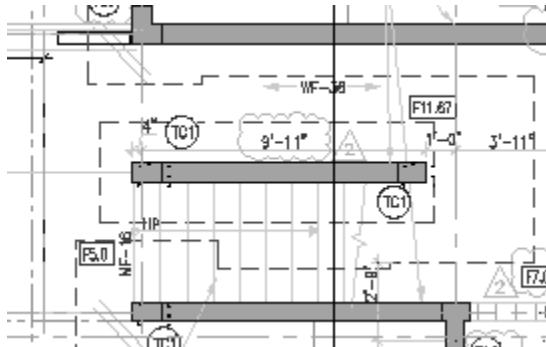

If you have any questions or require additional information, please do not hesitate to contact our office for further assistance.

Raissa R. Lopez, P
Lic No. 59399

