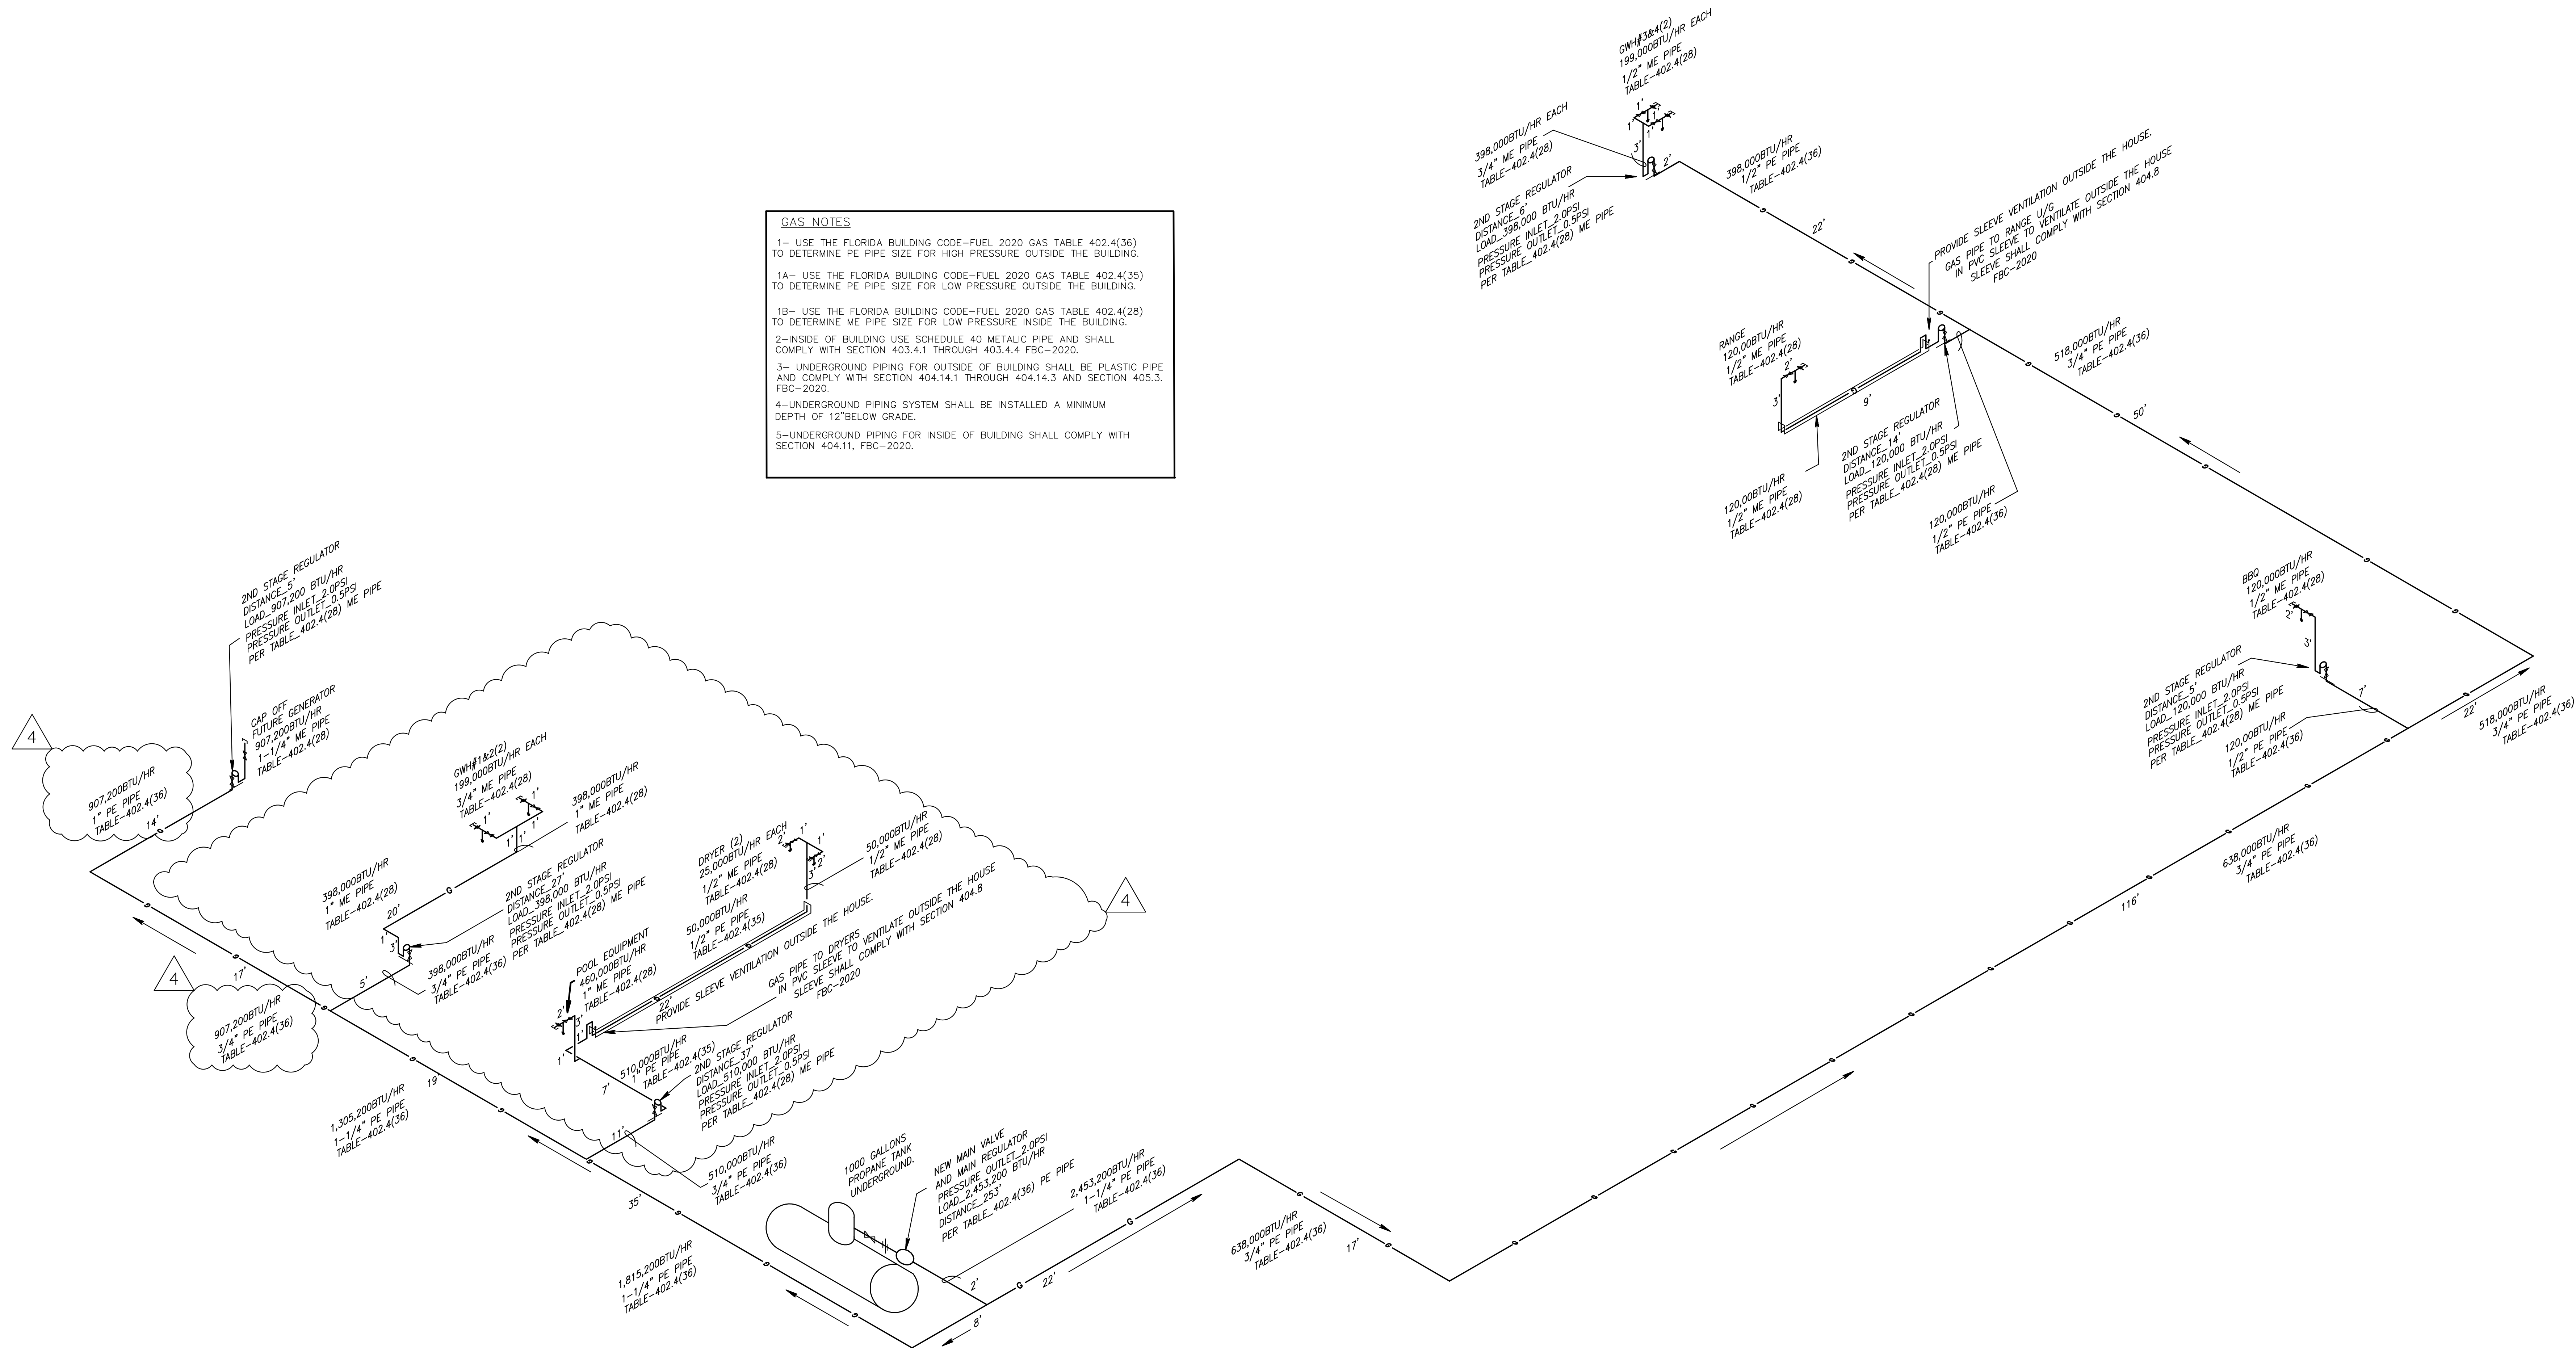


## GAS NOTES

- 1- USE THE FLORIDA BUILDING CODE-FUEL 2020 GAS TABLE 402.4(36) TO DETERMINE PE PIPE SIZE FOR HIGH PRESSURE OUTSIDE THE BUILDING.
- 1A- USE THE FLORIDA BUILDING CODE-FUEL 2020 GAS TABLE 402.4(35) TO DETERMINE PE PIPE SIZE FOR LOW PRESSURE OUTSIDE THE BUILDING.
- 1B- USE THE FLORIDA BUILDING CODE-FUEL 2020 GAS TABLE 402.4(28) TO DETERMINE ME PIPE SIZE FOR LOW PRESSURE INSIDE THE BUILDING.
- 2- INSIDE OF BUILDING USE SCHEDULE 40 METALIC PIPE AND SHALL COMPLY WITH SECTION 403.4.1 THROUGH 403.4.4 FBC-2020.
- 3- UNDERGROUND PIPING FOR OUTSIDE OF BUILDING SHALL BE PLASTIC PIPE AND COMPLY WITH SECTION 404.14.1 THROUGH 404.14.3 AND SECTION 405.3, FBC-2020.
- 4- UNDERGROUND PIPING SYSTEM SHALL BE INSTALLED A MINIMUM DEPTH OF 12" BELOW GRADE.
- 5- UNDERGROUND PIPING FOR INSIDE OF BUILDING SHALL COMPLY WITH SECTION 404.11, FBC-2020.

GAS ISOMETRIC  
NOT TO SCALEThis item has been digitally signed and sealed by Amarilis Rodriguez, P.E. on the date adjacent to the seal.  
Printed copies of this document are not considered signed and sealed and the signature must be verified  
on any electronic copies.**arpe**  
Engineering inc  
2020 Ponce de Leon Blvd., Suite 1002  
Coral Gables, Florida 33134  
Phone > 305.444.9809  
Fax > 305.444.9827Engineering Design  
> Mechanical > Electrical  
> Plumbing > Fire Protection  
www.arpe-eng.comAmarilis Rodriguez, P.E.  
License Number 33236  
State of Florida  
Professional Engineer  
Date: 2026-07-06  
12:13:43 -04'00'